



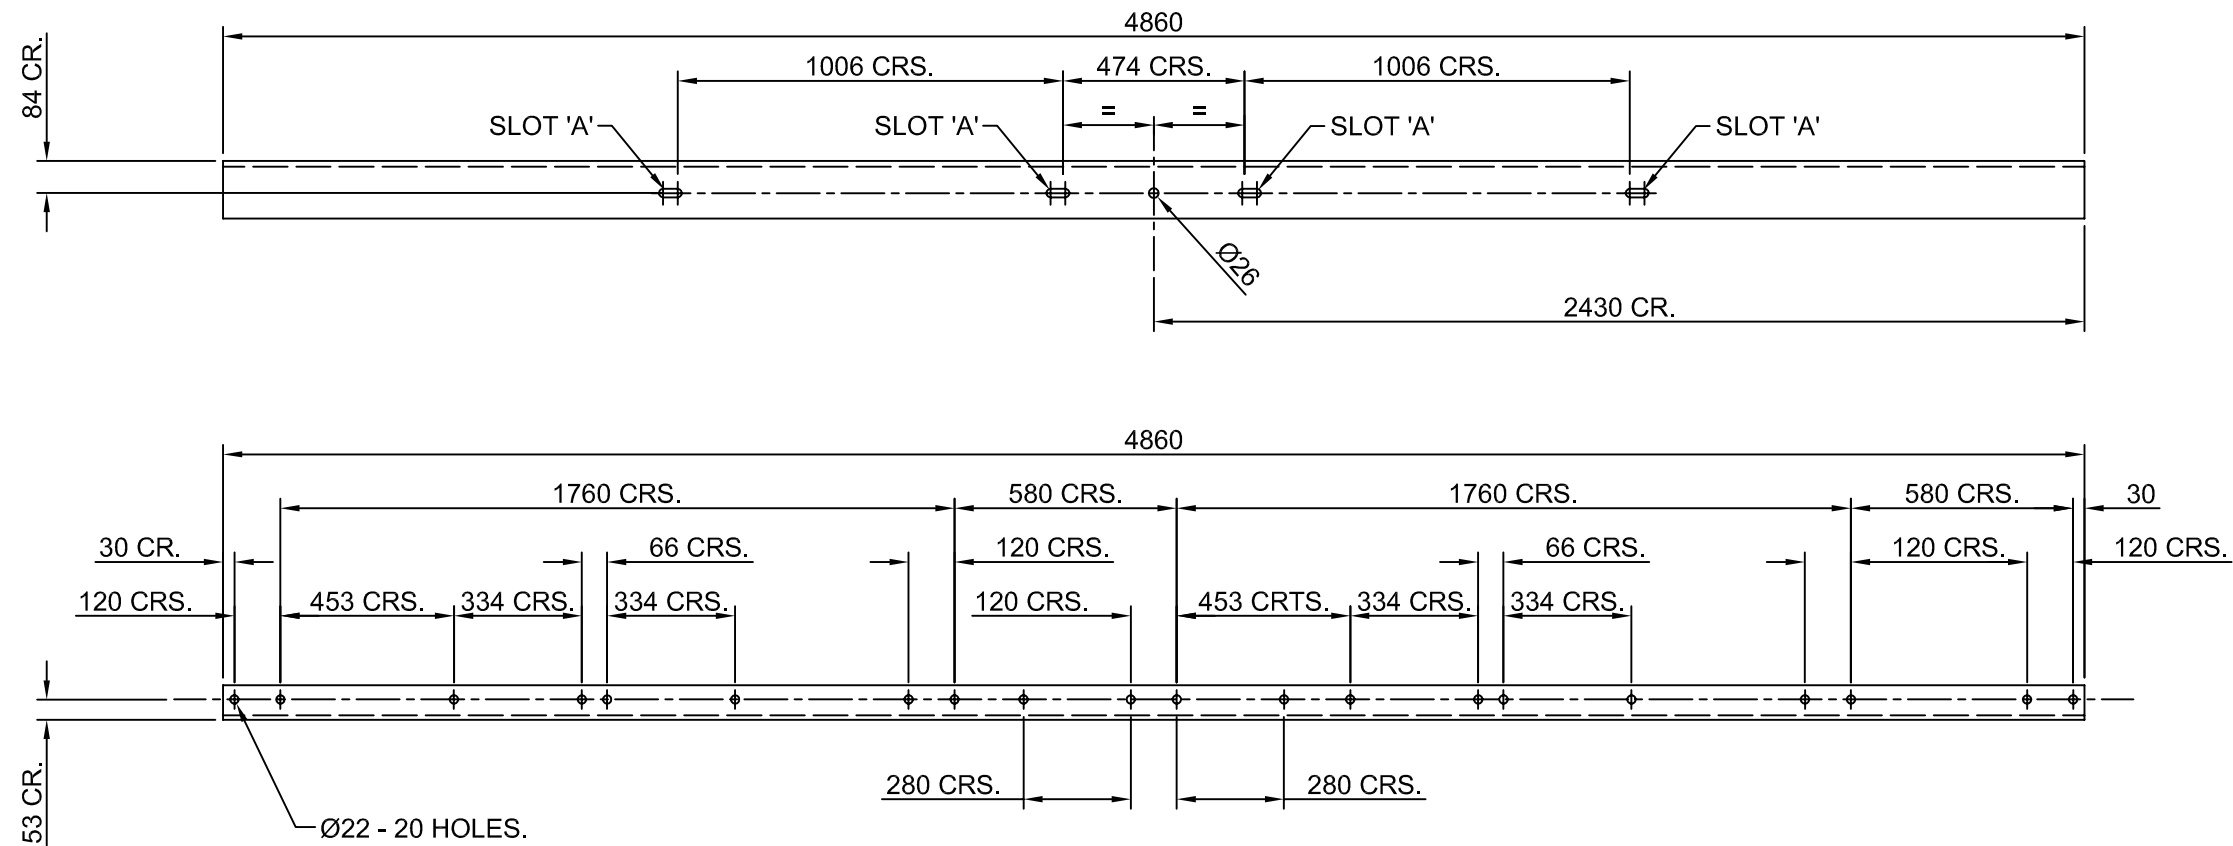

ITEM 2. 4860 LONG x 150 x 90 x 12 UNEQUAL ANGLE.

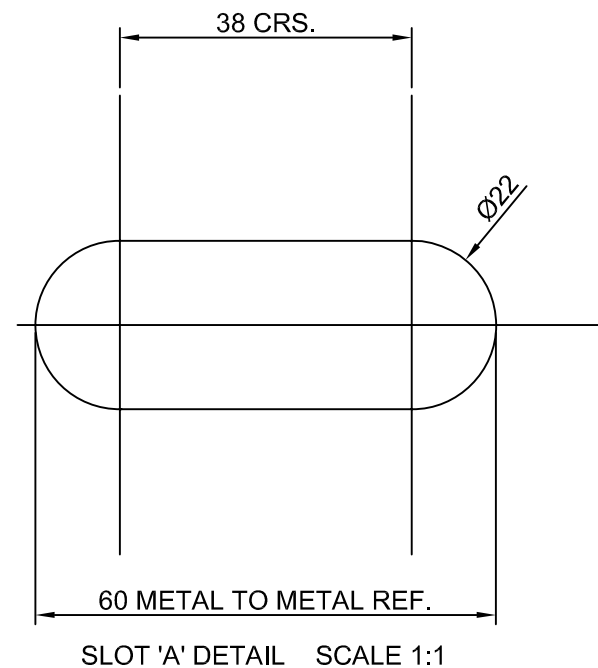

- NOTES:-
1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
 2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
 3. ALL BURRS TO BE REMOVED.
 4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132kV OVERHEAD LINES RUTTER POLE CROSSARM 0° - 5° DEVIATION ITEM No.31	
Manufacturer Details		Type OVERHEAD	
Sheet No. 31	Scale 1:20		
Prepared By TREVOR R. WILKIN		DOCUMENT_SUB_CLASS	
Revised	Grid Reference	Ref No.	62470B
Date Issued 13/06/2006	Checked By	Revision	Notes
		Historic Drg.No.	1 09 101 0675