



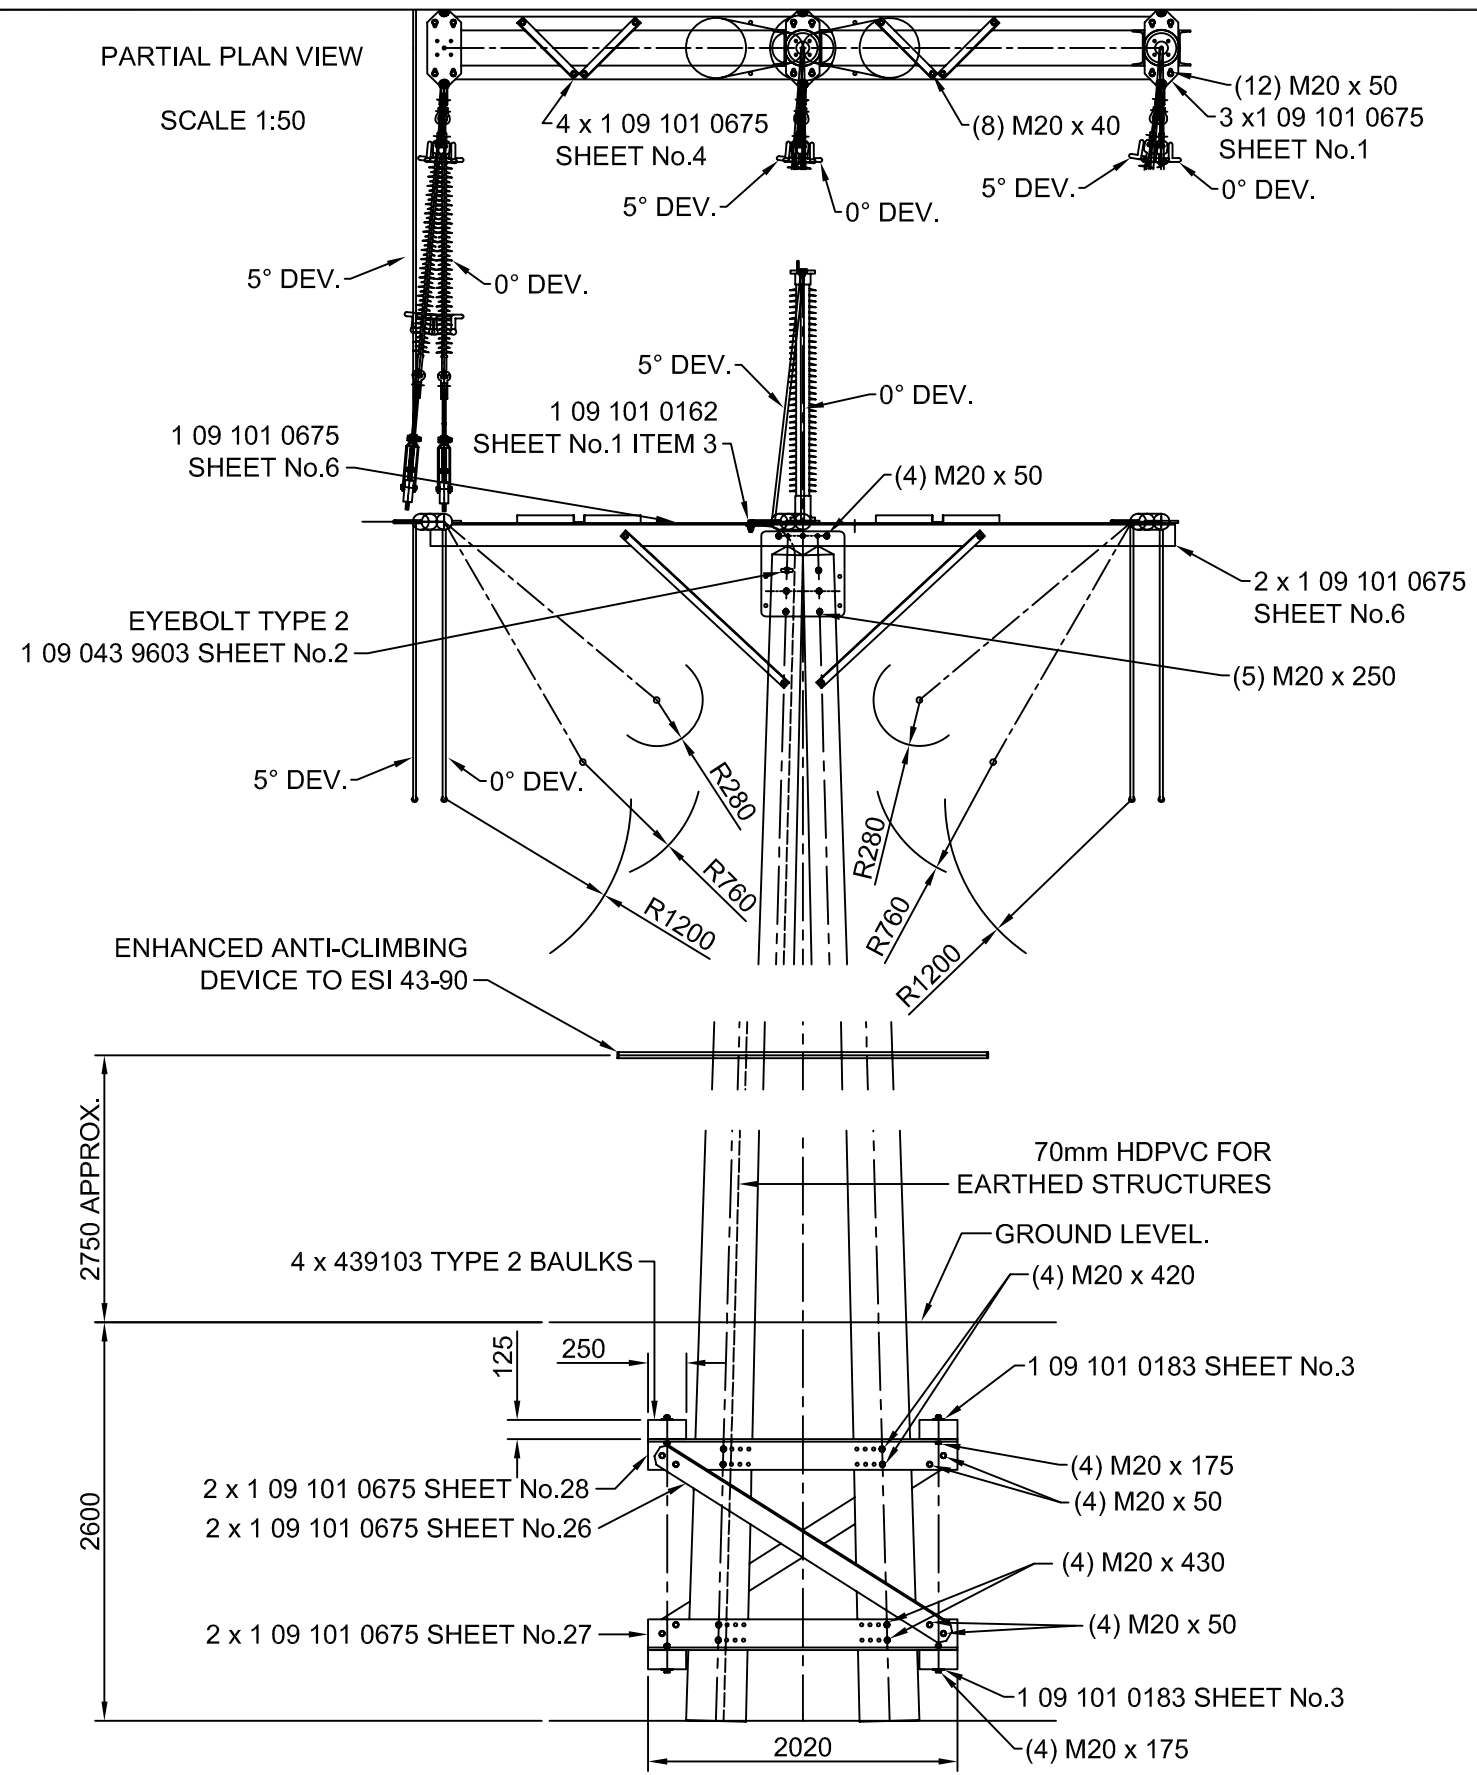

NOTES:

1. ALL STEELWORK FIXINGS BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER BOLT HEAD & 1 ROUND WASHER UNDER NUT, UNLESS STATED OTHERWISE. WHERE A CHANNEL IS USED A 5° TAPER WASHER SHOULD BE FITTED TO LEGS ONLY.
2. FOR DETAIL DRAWINGS PREFIXED 43 REFER TO E.S.I. DRAWINGS FOR OTHER DETAIL DRAWINGS REFER TO 1.09.101.0675 SERIES.
3. POST INSULATORS FITTED USING M16 HEX HD. BOLT x 70mm LONG PLUS NUT.

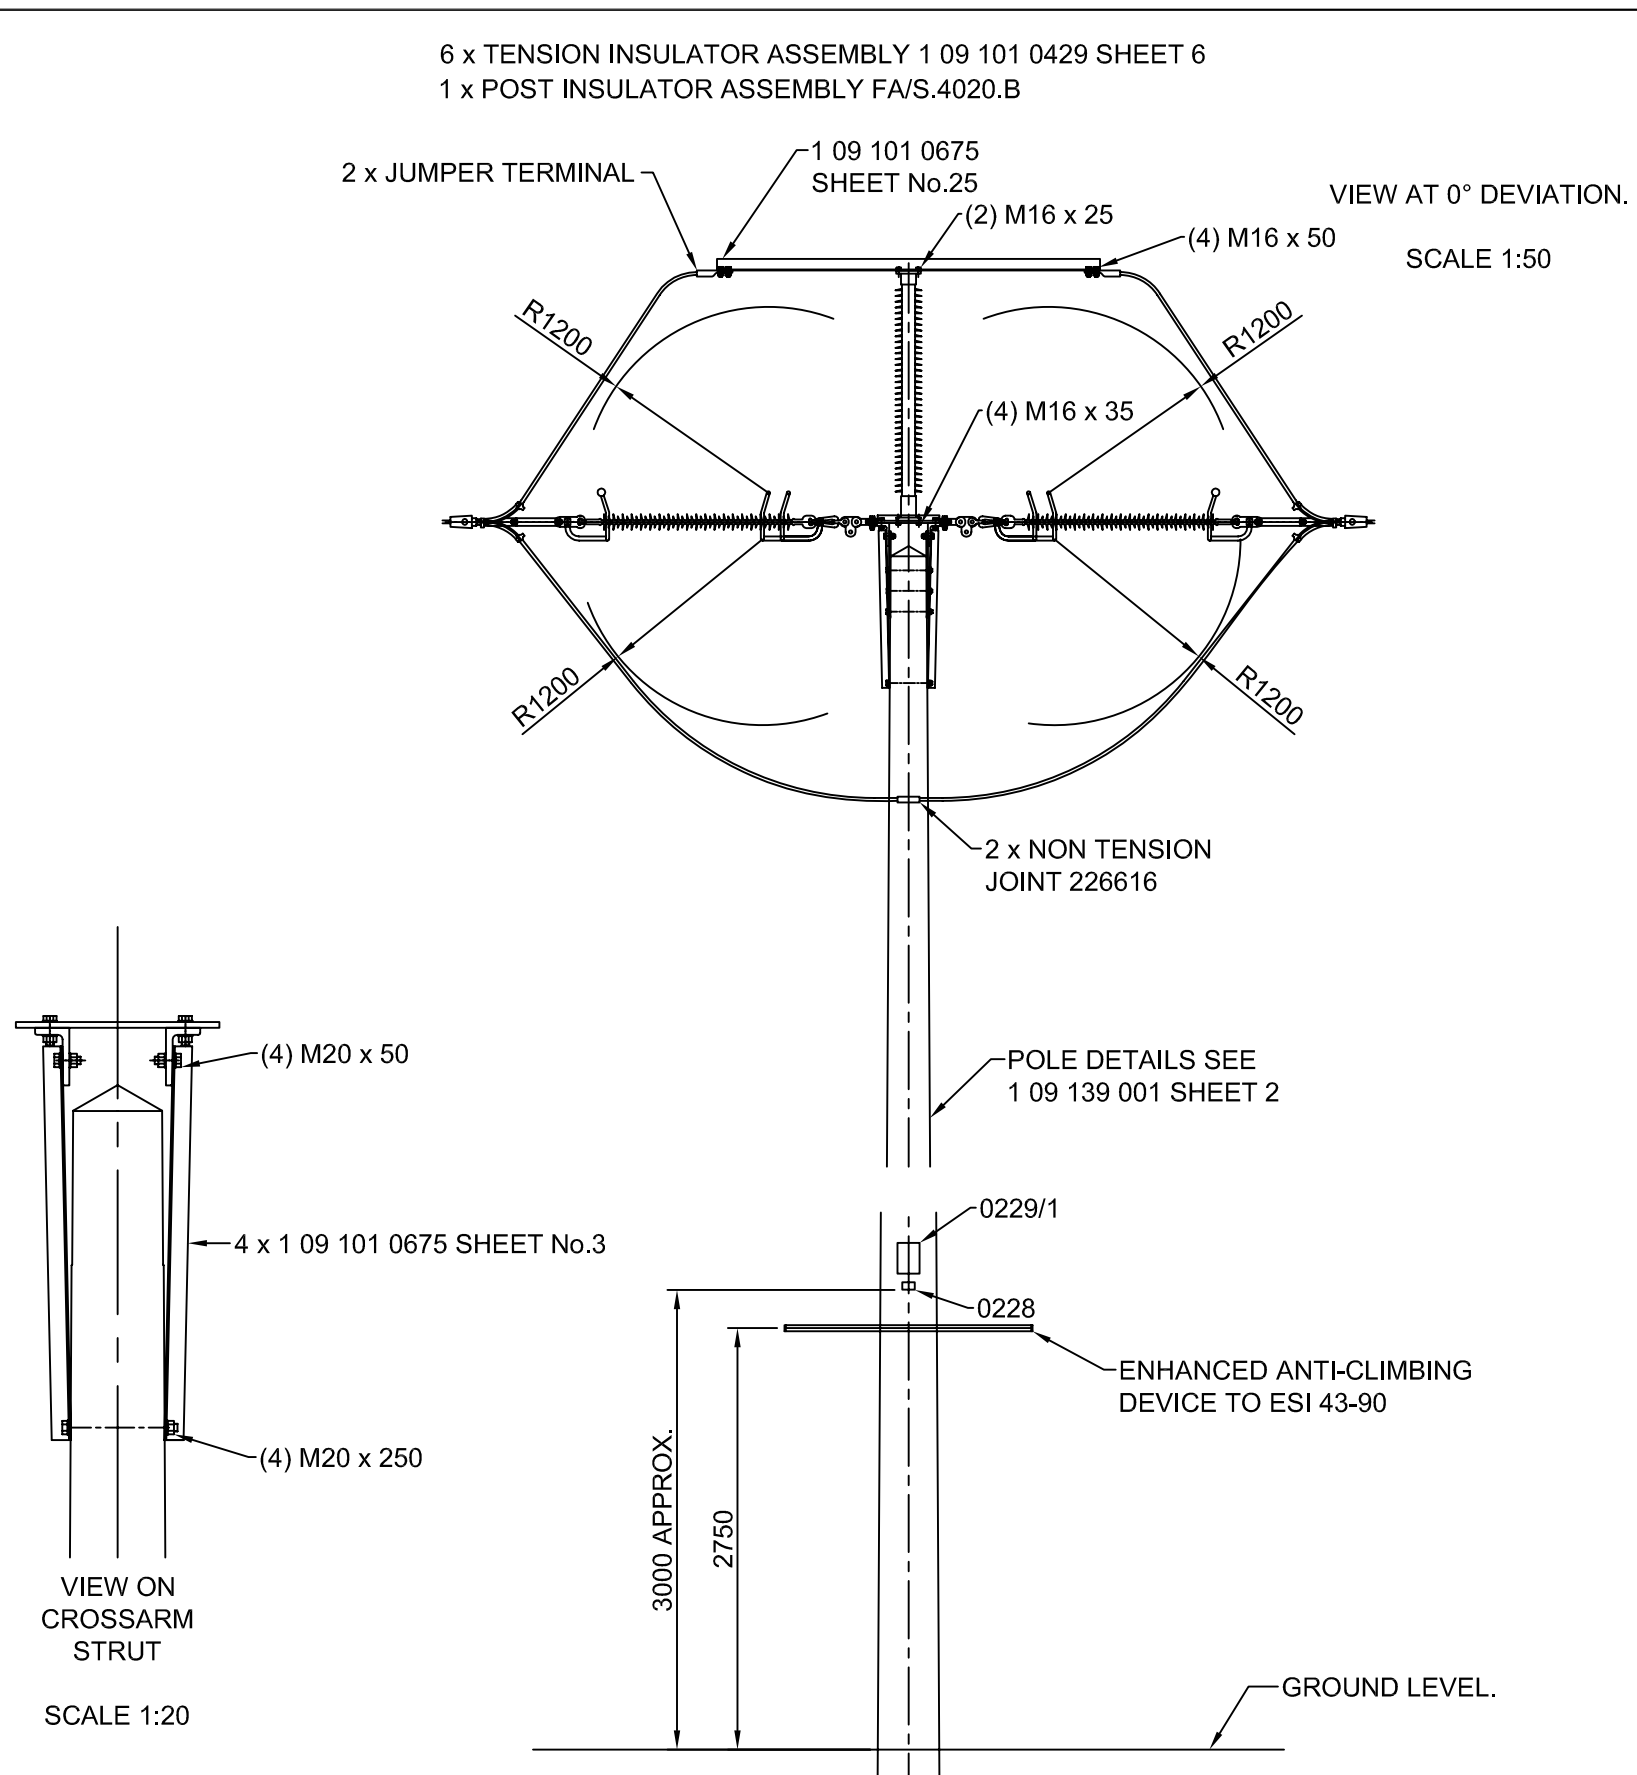

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132kV OVERHEAD LINES ASSEMBLY OF 'A' FRAME SECTION POLE 0° - 5° DEVIATION	
Manufacturer Details		Type OVERHEAD	
Sheet No. 1	Scale 1:50		
Prepared By TREVOR R. WILKIN		DOCUMENT_SUB_CLASS	
Revised	Grid Reference	Ref No.	62470A
Date Issued 02/03/2006	Checked By	Historic Drg.No.	1 09 139 0002
		Revision	Notes