



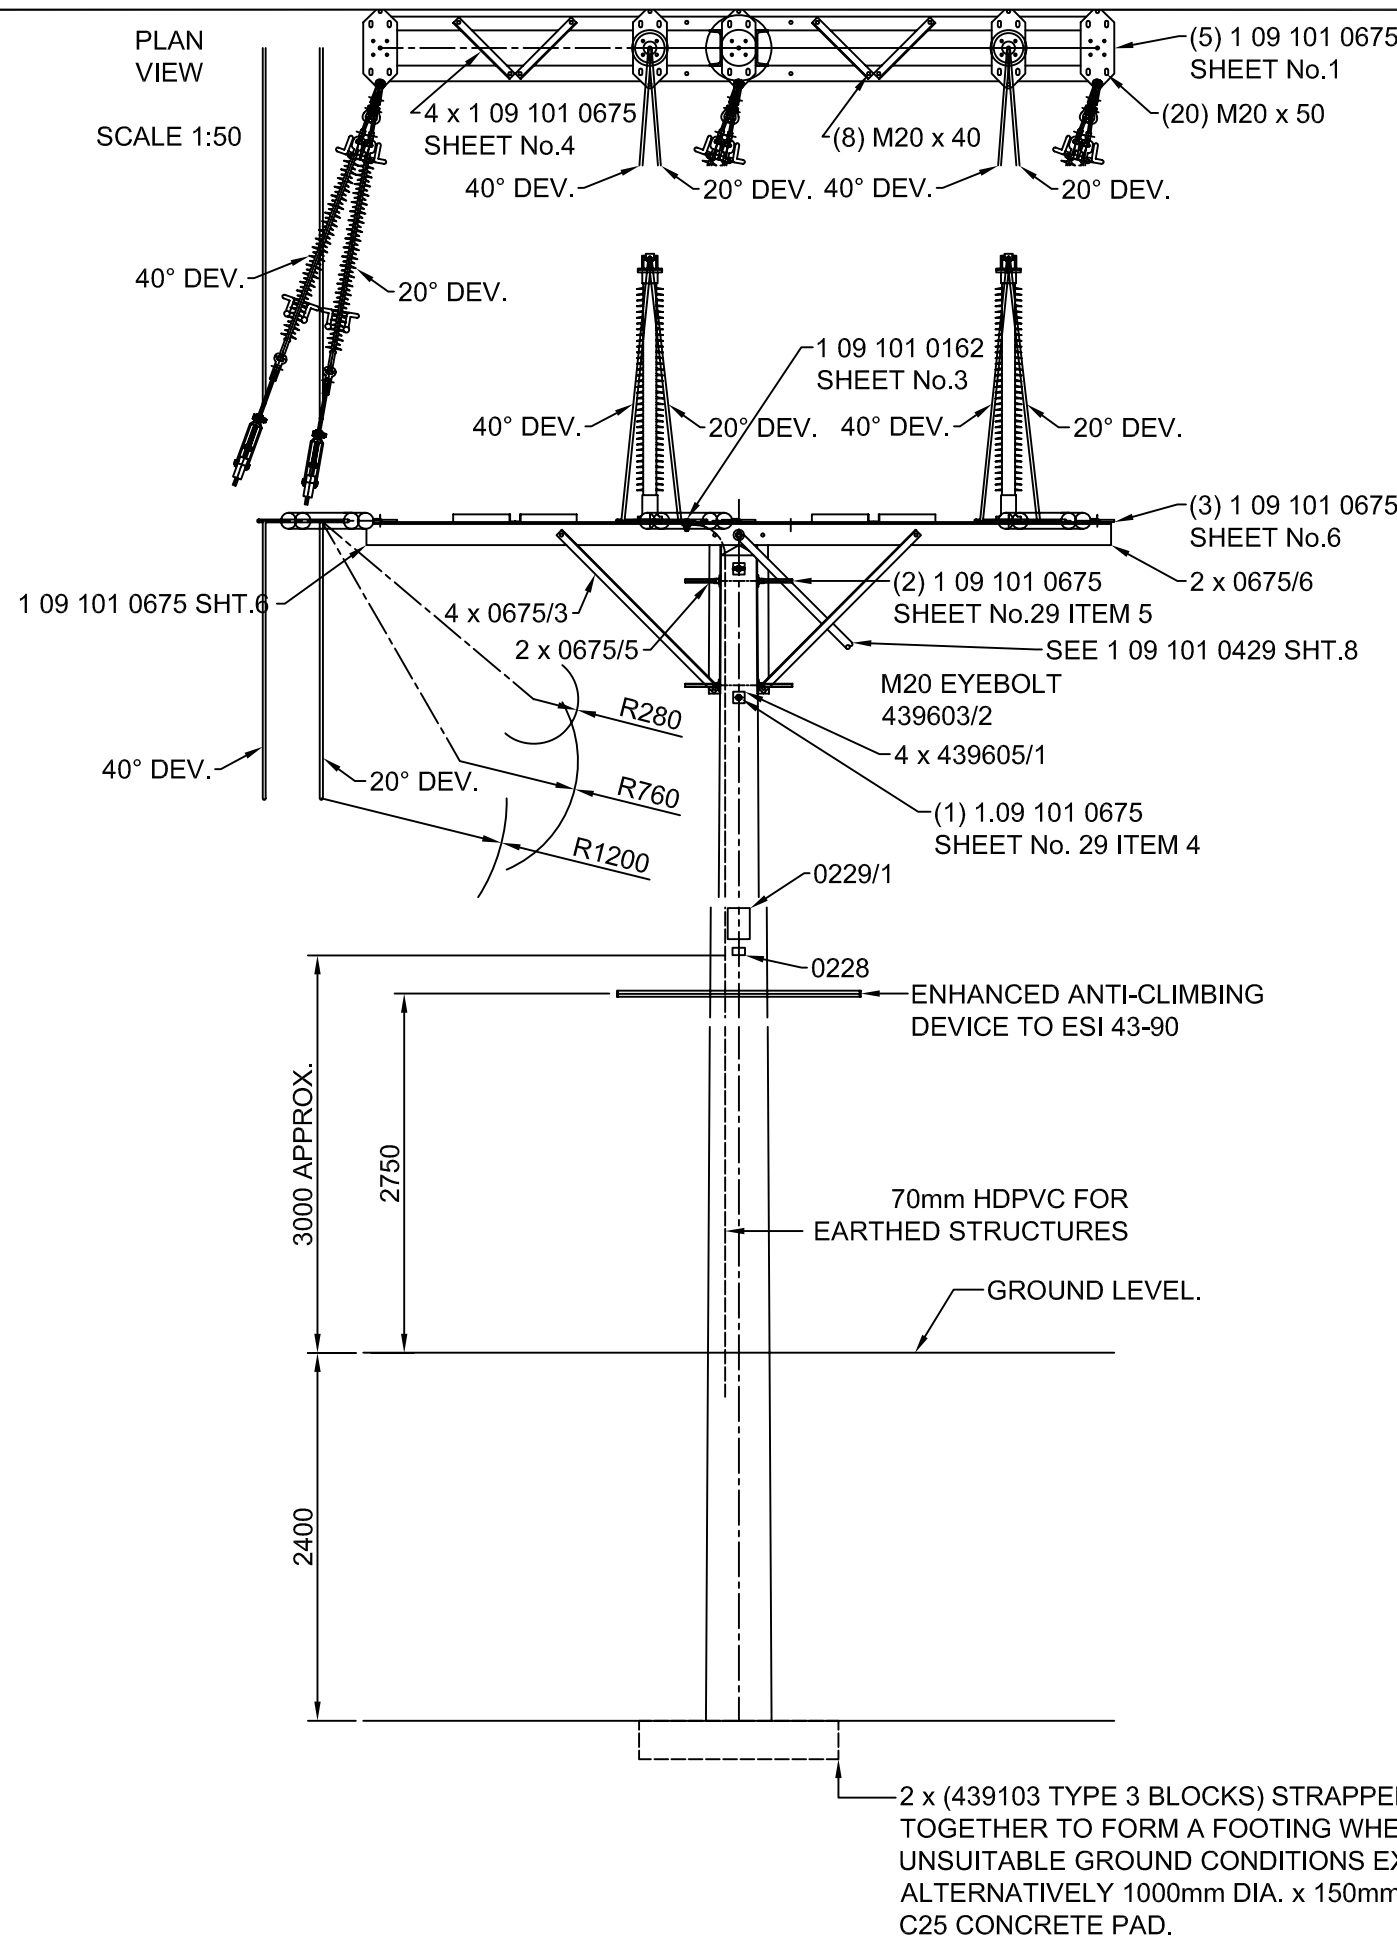

- NOTES:
1. ALL STEELWORK FIXINGS BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER BOLT HEAD & 1 ROUND WASHER UNDER NUT, UNLESS STATED OTHERWISE. WHERE A CHANNEL IS USED A 5° TAPER WASHER SHOULD BE FITTED TO LEGS ONLY.
 2. FOR DETAIL DRAWINGS PREFIXED 43 REFER TO E.S.I. DRAWINGS FOR OTHER DETAIL DRAWINGS REFER TO 1.09.101.0675 SERIES.
 3. POST INSULATORS FITTED USING M16 HEX HD. BOLT x 70mm LONG PLUS NUT.

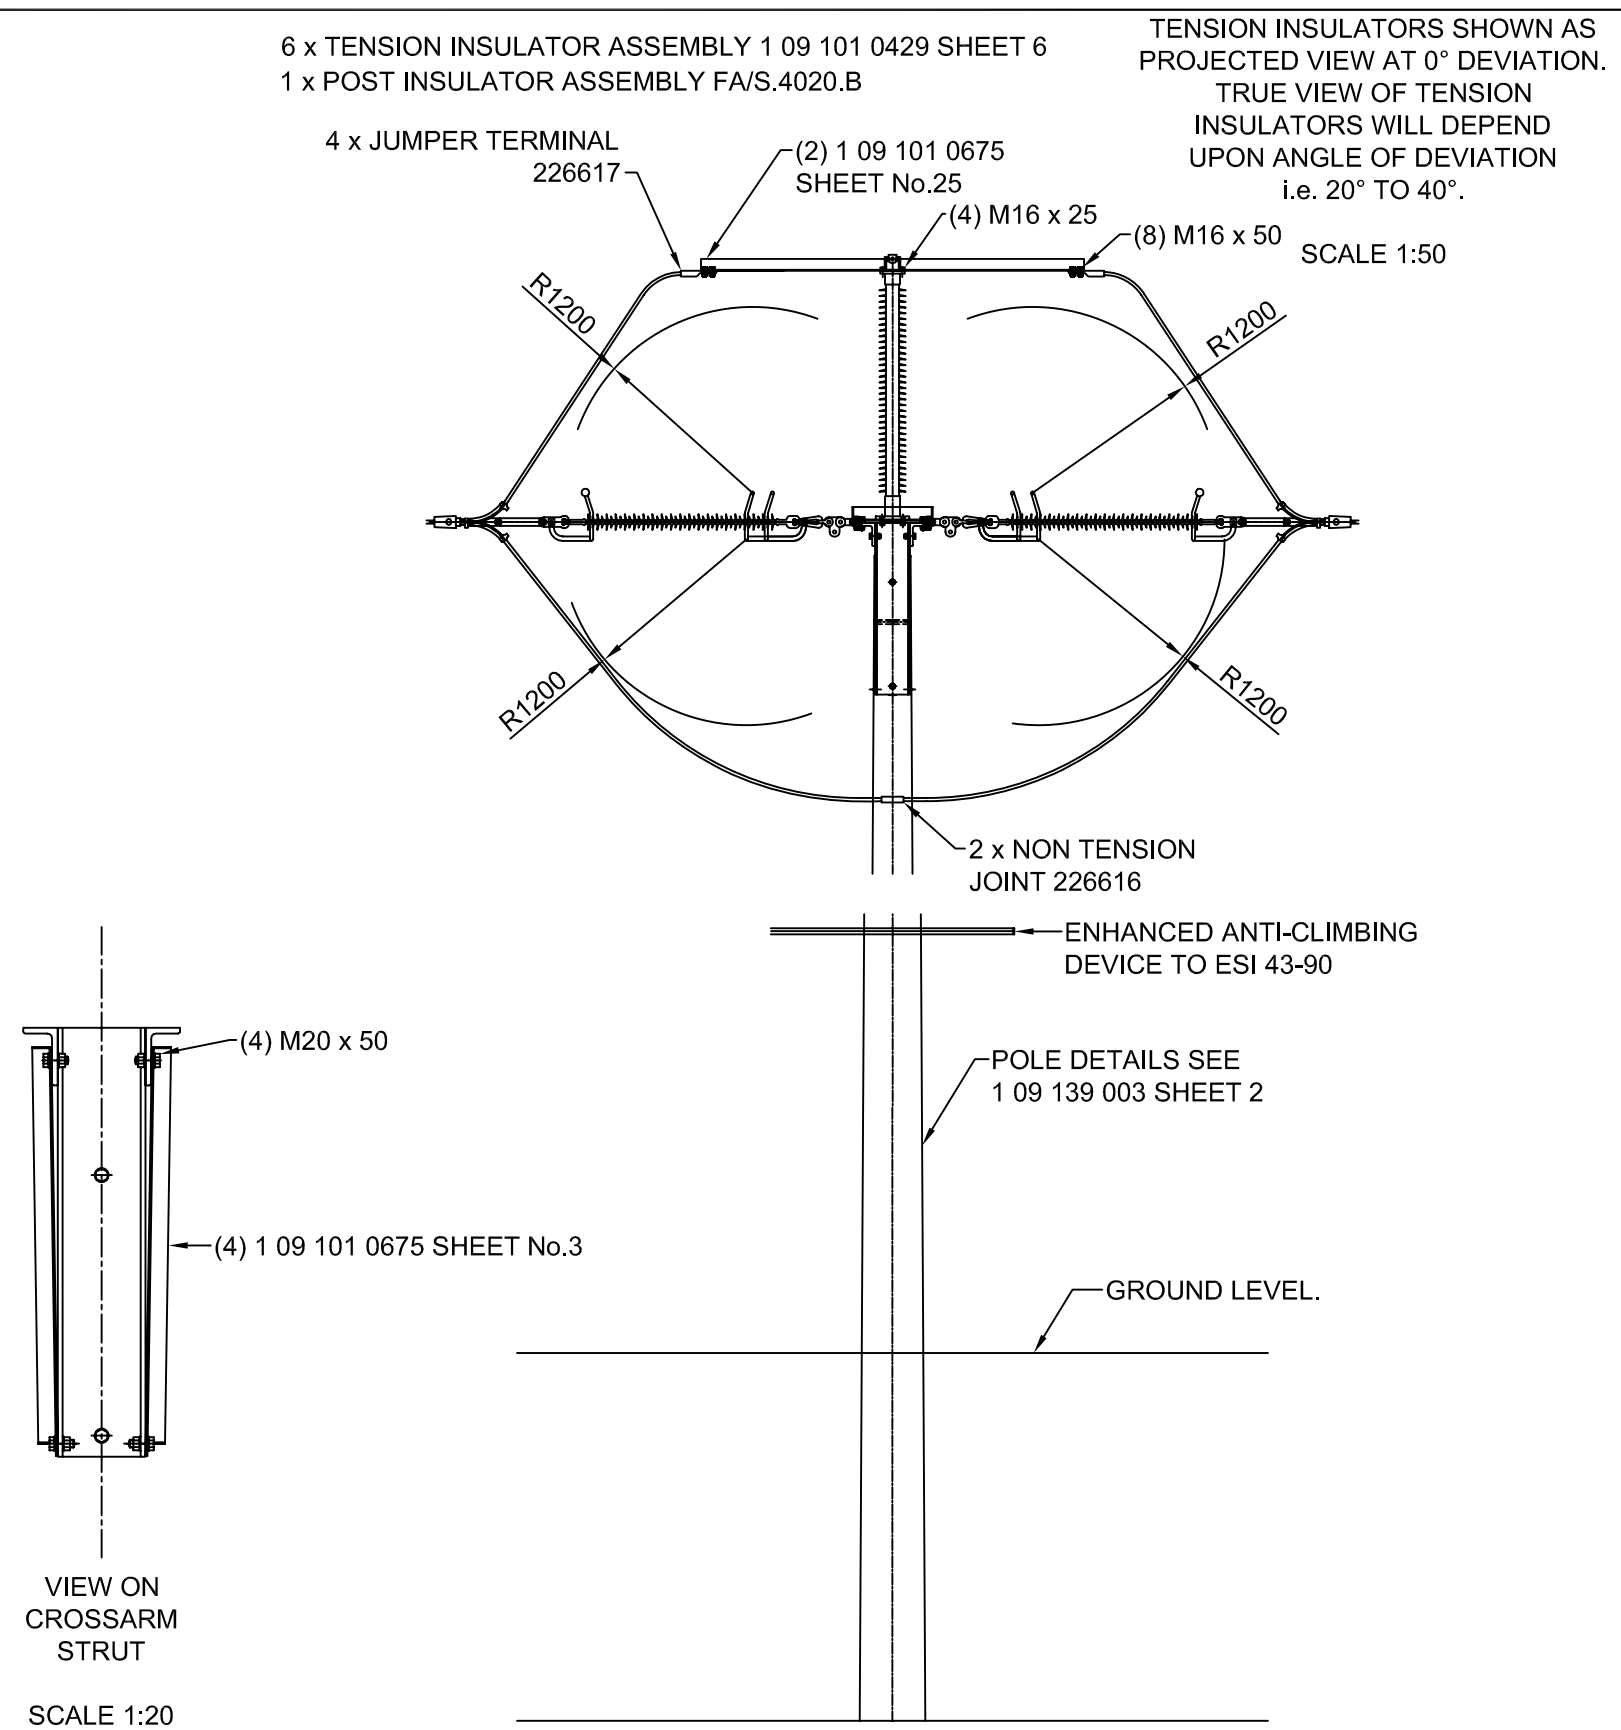

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
		132kV OVERHEAD LINES ASSEMBLY OF SINGLE POLE DEVIATION 20°-40°	
Manufacturer Details			
Sheet No. 1	Scale 1:50		
Prepared By TREVOR R. WILKIN	Type OVERHEAD	DOCUMENT_SUB_CLASS	
Revised	Grid Reference	Ref No. 62470A	Historic Drg.No. 1 09 139 0004
Date Issued 10/03/2006	Checked By	Revision	Notes