


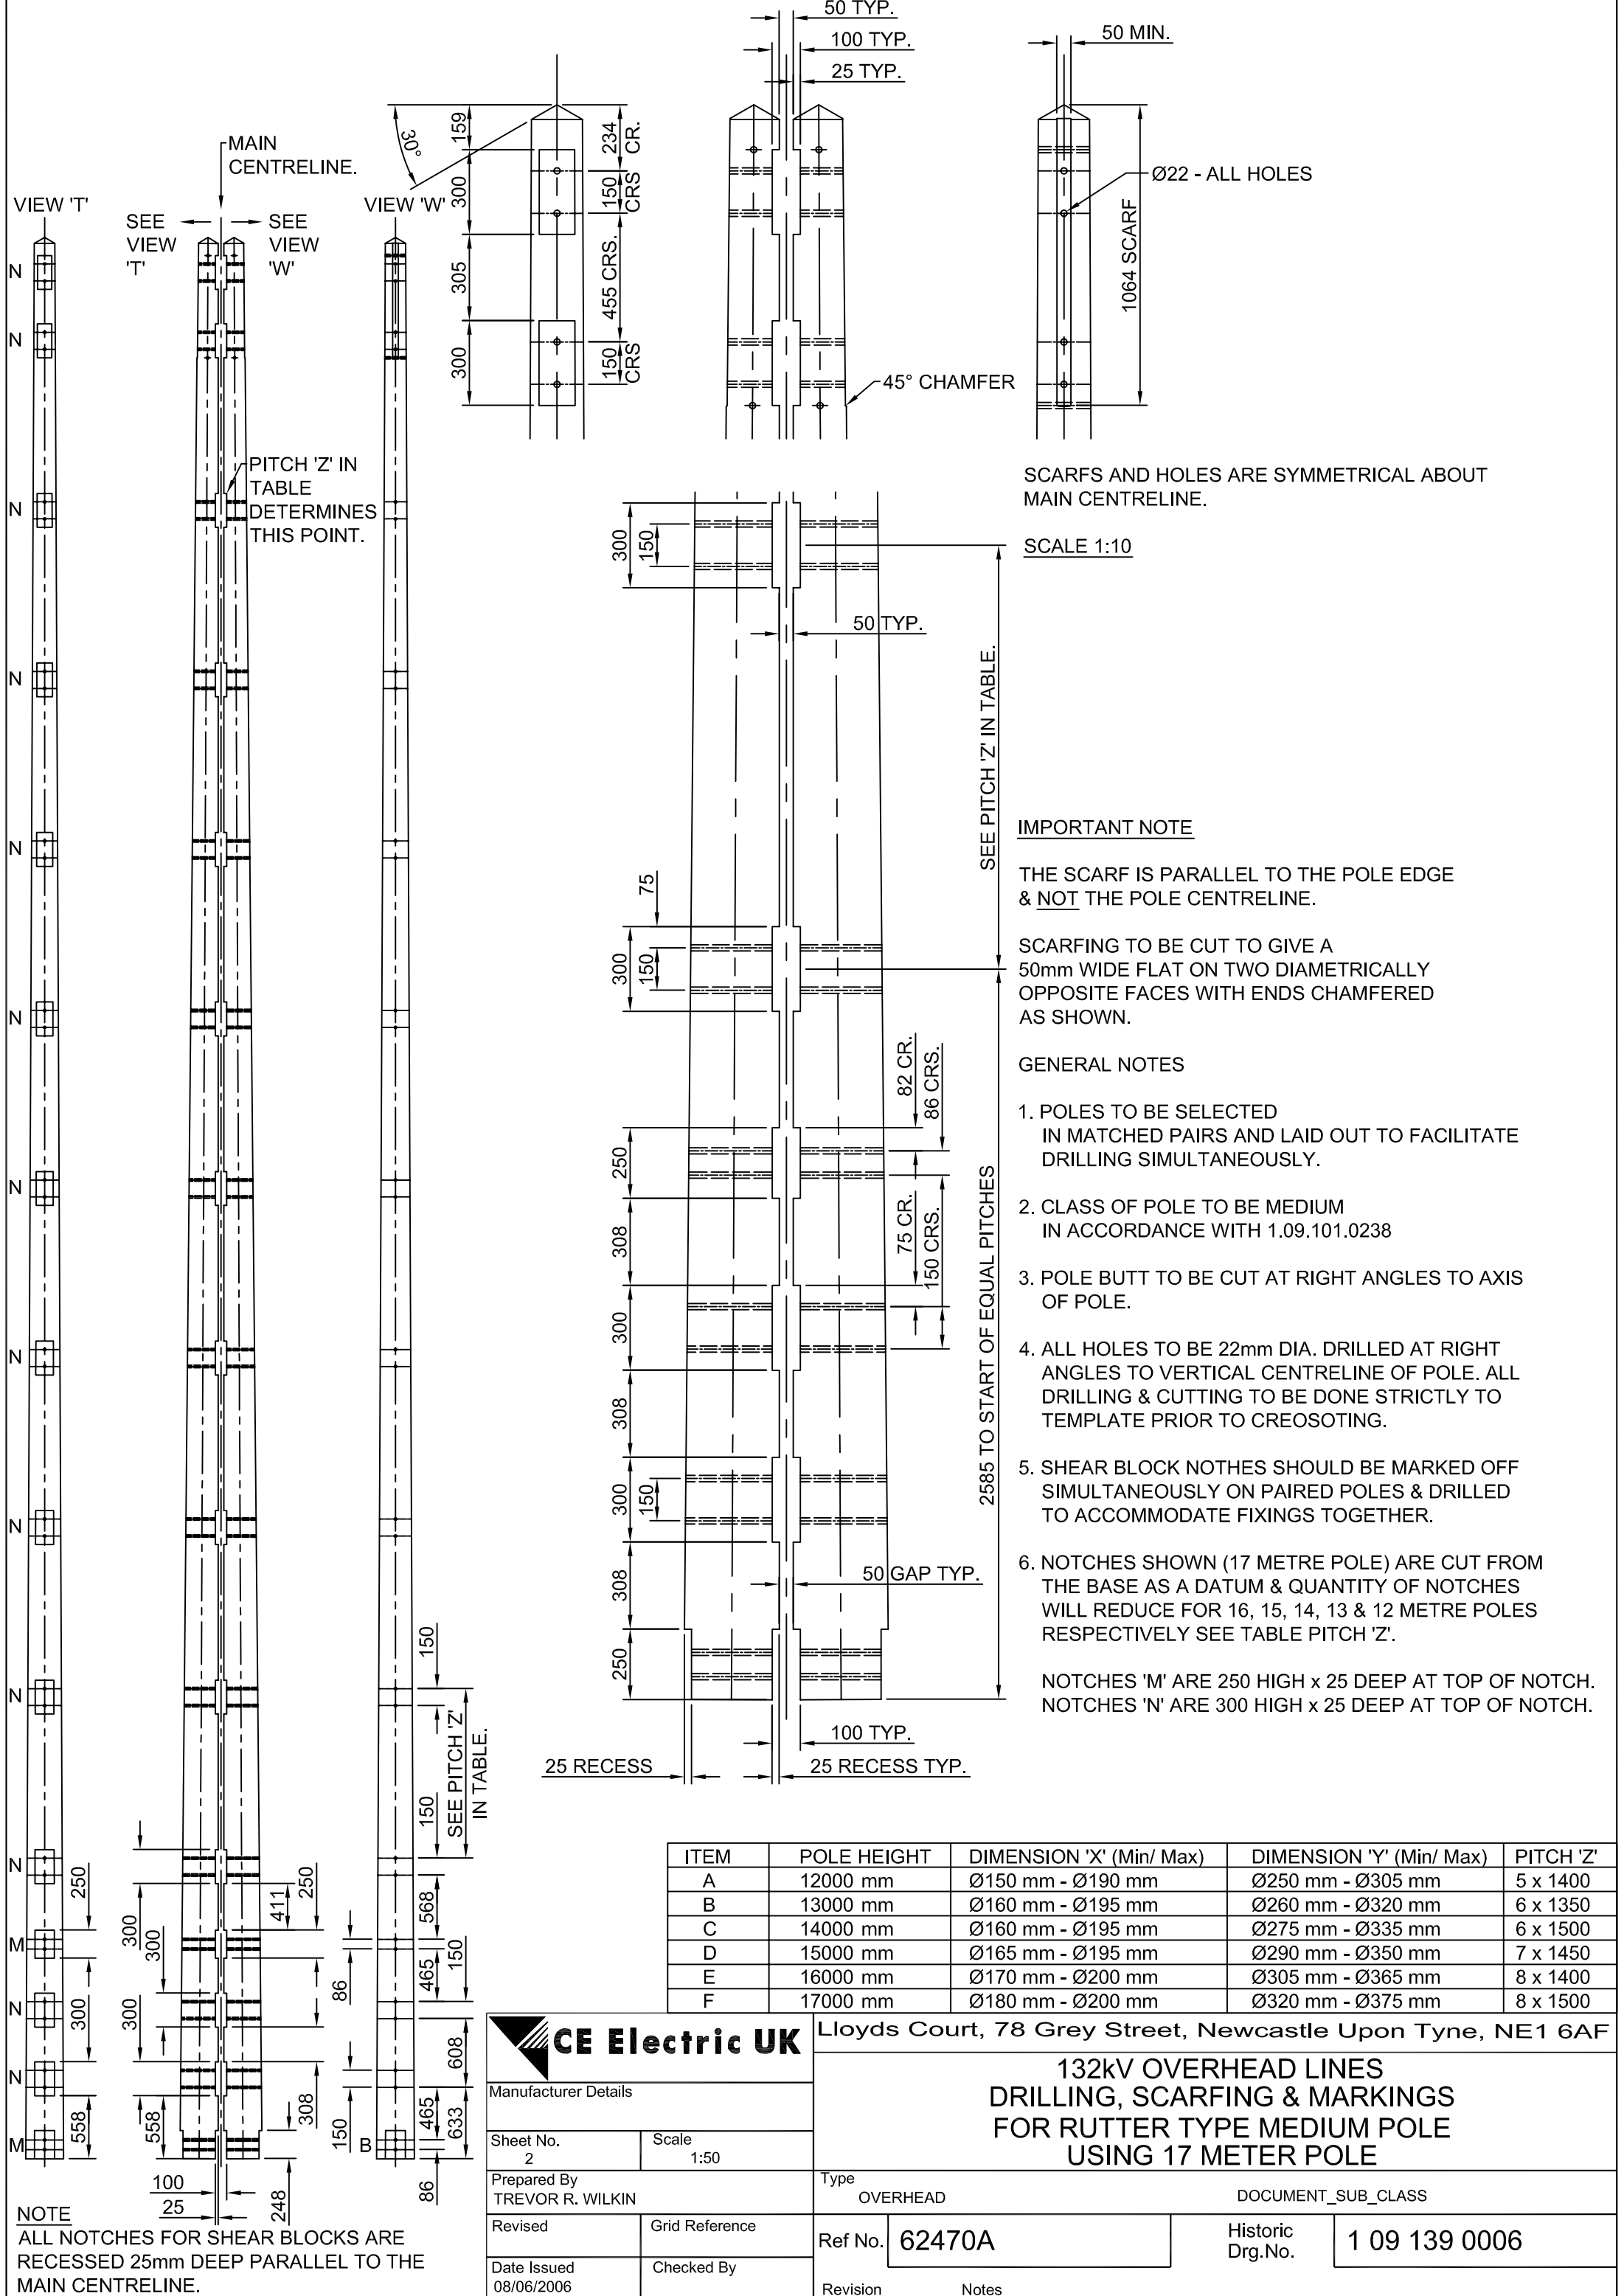

NOTE
ALL NOTCHES FOR SHEAR BLOCKS ARE RECESSED 25mm DEEP PARALLEL TO THE MAIN CENTRELINE.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF		
Manufacturer Details		132kV OVERHEAD LINES DRILLING, SCARFING & MARKINGS FOR RUTTER TYPE MEDIUM POLE USING 17 METER POLE		
Sheet No. 2	Scale 1:50	Type OVERHEAD		
Prepared By TREVOR R. WILKIN		DOCUMENT_SUB_CLASS		
Revised	Grid Reference	Ref No.	62470A	Historic Drg.No. 1 09 139 0006
Date Issued 08/06/2006	Checked By	Revision	Notes	