


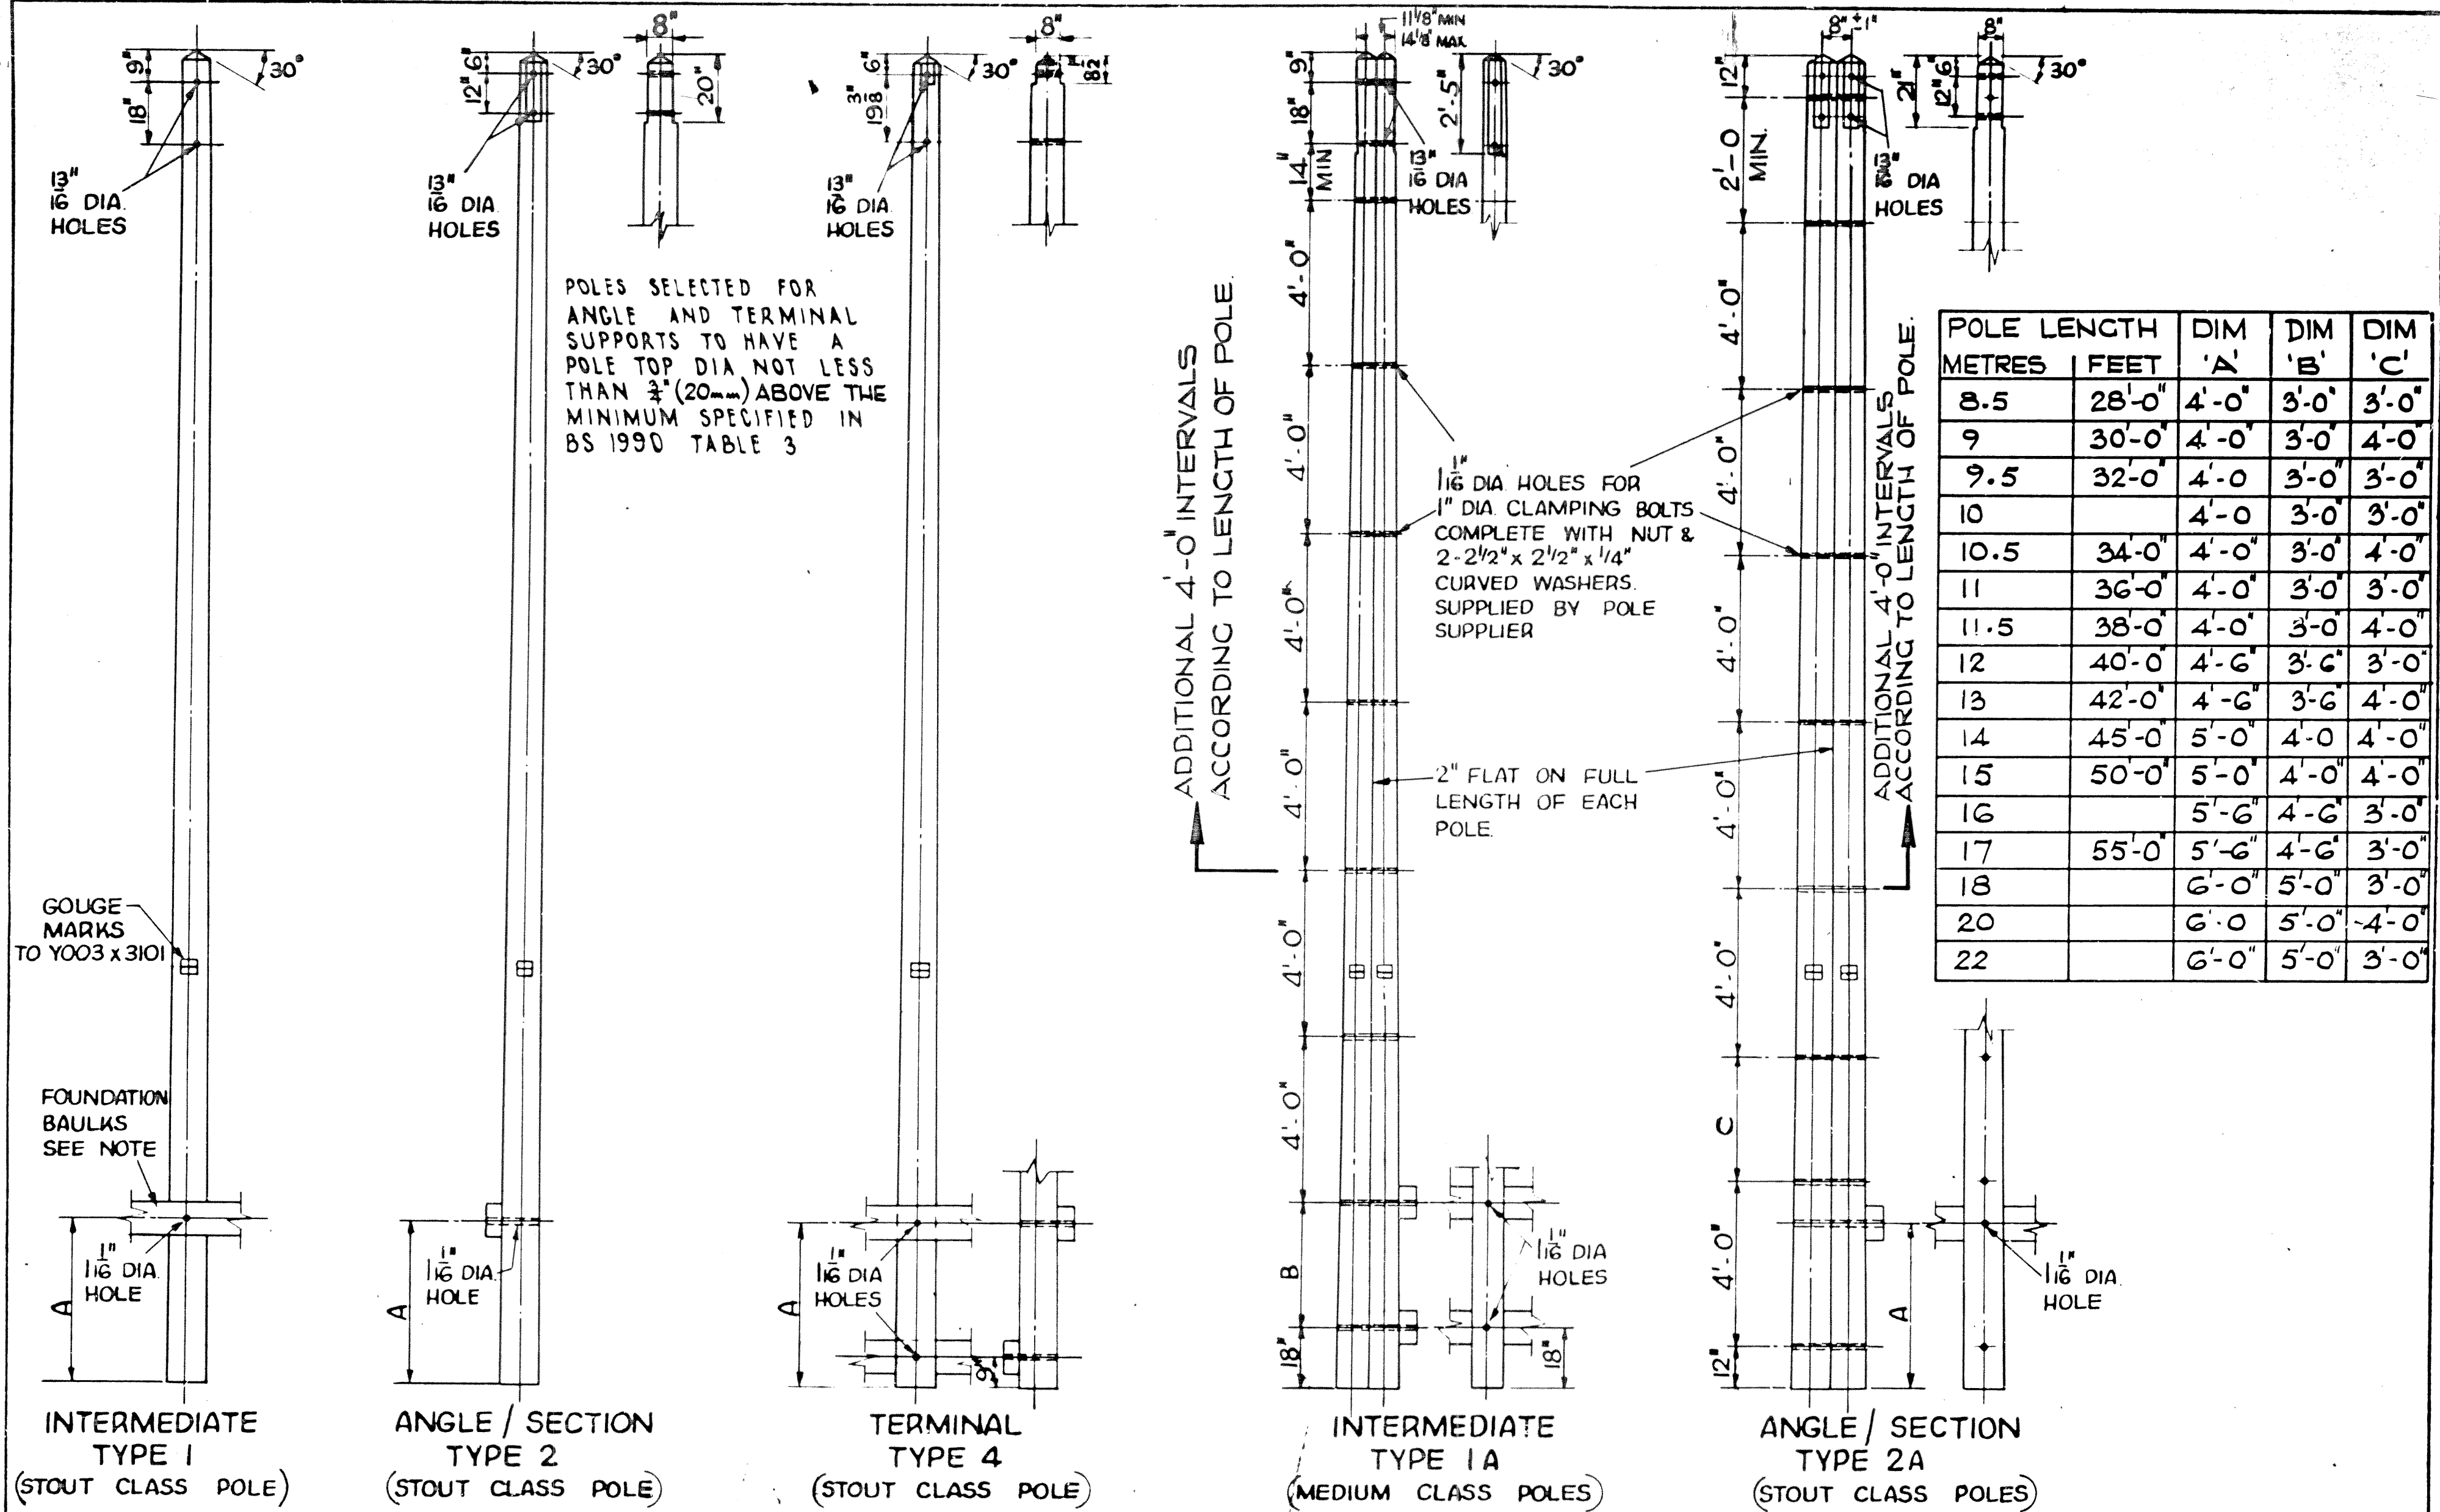

POLE APPLICATION

SUPPORT	11kV CE/C/31	33kV CE/C/36	SCA	SCA
	Cu/Al ALLOY	COPPER	NORMAL SPINNING UP TO 20	SCA
INTER	1	1	1	1A
ANGLE / SECTION	2	2	2A	2A
TERMINAL	4			

MATERIALS

POLES TO BS 1990.

BOLTS TO BS 916 THREADED B.S. WHIT. GALVANISED TO BS 729.

CREOSOTING TO BS 913 RUPPING PROCESS.

TWIN POLES TO BE BOLTED TOGETHER BEFORE CREOSOTING WITH NUTS SLACKENED 2 FULL TURNS. NUTS FULLY TIGHTENED AFTER CREOSOTING

NOTE FOUNDATION BAULKES TO Y003 x 3201 (TYPE 2)
POLE DRILLED ONLY WHEN BAULKES REQUIRED

drawn E.W.	HV OVERHEAD LINES
traced J.M.W.	
checked	
date 2.4.69	
scale 1/4" = 1'	POLE DETAILS FOR SINGLE SUPPORT LINES UNEARTHED CONSTRUCTION

Yorkshire Electricity Board Y003 X 3102