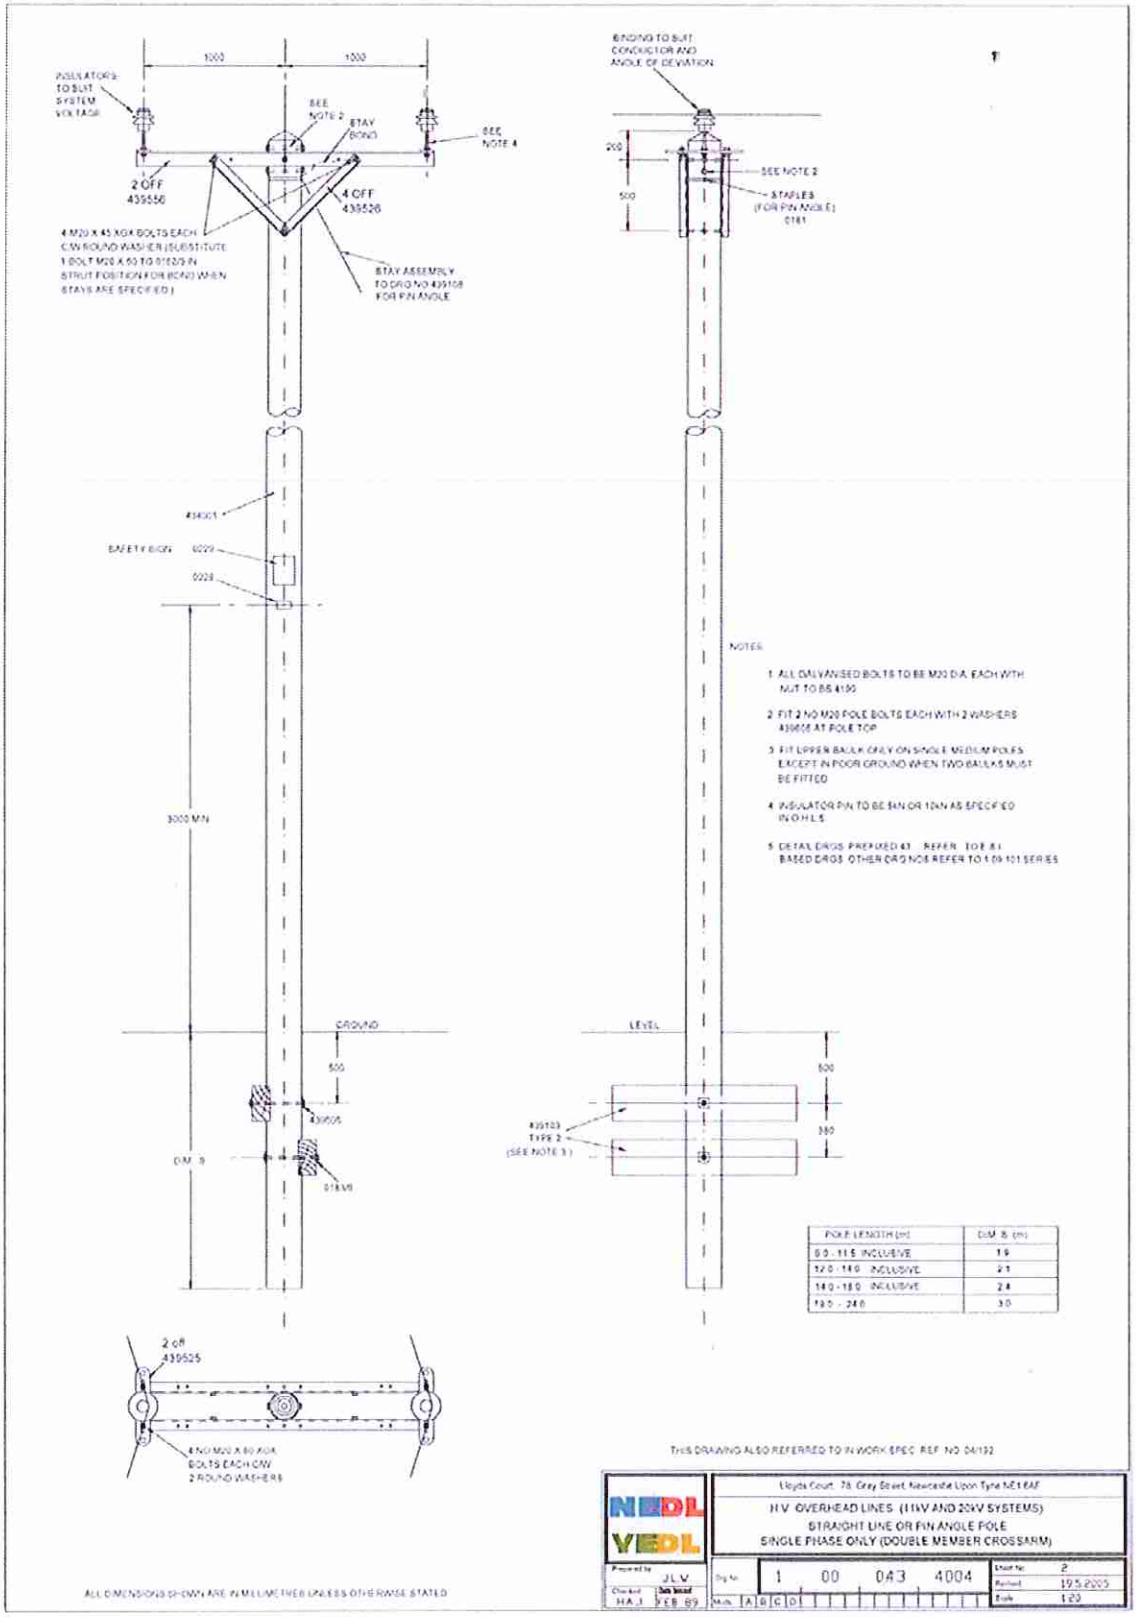

1000
1000
INSULATORS TO SUIT SYSTEM VOLTAGE
SEE NOTE 2
STAY (BOND)
SEE NOTE 4
2 OFF 439556
4 OFF 439526
4 M20 X 45 XGX BOLTS EACH C/W ROUND WASHER (SUBSTITUTE 1 BOLT M20 X 50 TO 0102/0 IN STRUT POSITION FOR BOND WHEN STAYS ARE SPECIFIED)
STAY ASSEMBLY TO DRG NO 439108 FOR PIN ANGLE
BINDING TO SUIT CONDUCTOR AND ANGLE OF DEVIATION
200
500
SEE NOTE 2
STAPLES (FOR PIN ANGLE) 0161
439001
SAFETY SIGN 0229
0228
3000 MIN
GROUND
500
439505
DIM 'B'
0161/0
LEVEL
500
300
439103 TYPE 2 (SEE NOTE 3)
2 off 439525
4 NO M20 X 80 XGX BOLTS EACH C/W 2 ROUND WASHERS
NOTES
1 ALL GALVANISED BOLTS TO BE M20 DIA. EACH WITH NUT TO BS 4190
2 FIT 2 NO M20 POLE BOLTS EACH WITH 2 WASHERS 439606 AT POLE TOP
3 FIT UPPER BAULK ONLY ON SINGLE MEDIUM POLES EXCEPT IN POOR GROUND WHEN TWO BAULKS MUST BE FITTED
4 INSULATOR PIN TO BE 5kN OR 10kN AS SPECIFIED IN O.H.L.S.
5 DETAIL DRGS PREPARED 43... REFER TO E.81 BASED DRGS. OTHER DRG NOS REFER TO 1.09.101 SERIES
POLE LENGTH (m) | DIM 'B' (m)
9.0 - 11.5 INCLUSIVE | 1.9
12.0 - 14.0 INCLUSIVE | 2.1
14.0 - 18.0 INCLUSIVE | 2.4
18.0 - 24.0 | 3.0
THIS DRAWING ALSO REFERRED TO IN WORK SPEC REF NO 04/102
ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED
NEDL
YEDL
Lloyds Court, 78, Grey Street, Newcastle Upon Tyne NE1 6AF
H.V. OVERHEAD LINES (11kV AND 20kV SYSTEMS)
STRAIGHT LINE OR PIN ANGLE POLE
SINGLE PHASE ONLY (DOUBLE MEMBER CROSSARM)
Prepared by JLV
Checked HAJ FEB 89
Dwg No. 1 00 043 4004
Mods. A B C D
Sheet No. 2
Revised 19.5.2005
Scale 1:20