

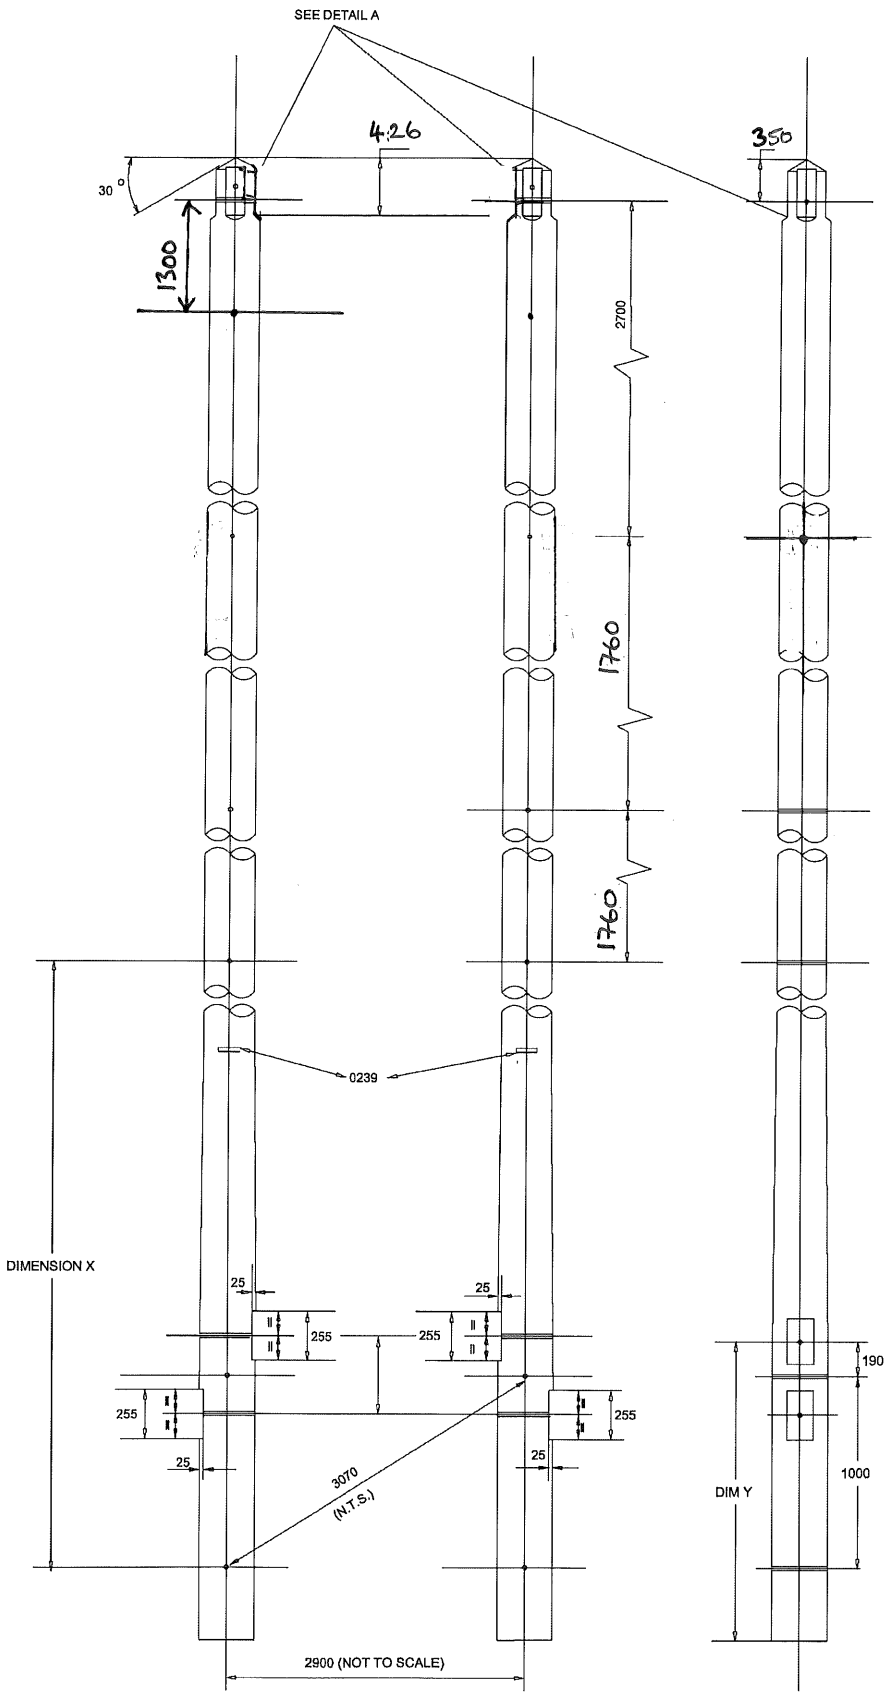


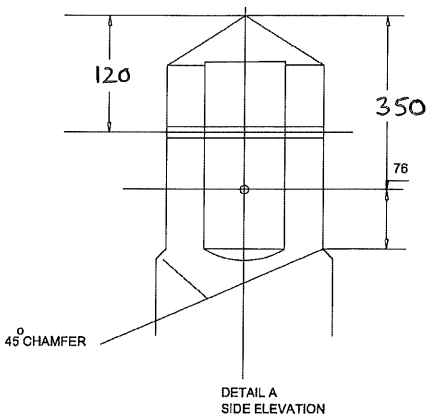

DETAIL A
SIDE ELEVATION

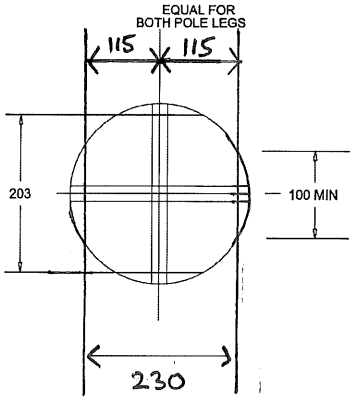

DETAIL A

NOTES:

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 230mm
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
3. POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
5. POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
6. HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	4920	1700
13.0m	5920	1700
14.0m	6920	1700
15.0m	7920	1700
16.0m	8720	1900

CE Electric UK
Manufacturer Details

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

66KV SINGLE CIRCUIT LINES
DRILLING SCARFING AND MARKING FOR TERMINAL SUPPORT WITH SURGE ARRESTORS AND HEAT SHRINK TERMINATION AS SHOWN ON 1.09.123.1173 SHEET 9

Sheet No. 10	Scale 1:20
Prepared By Barbara.Gordon	
Revised 01/07/09	Grid Reference
Date Issued 24/06/09	Checked By S.SALKELD

Type OVERHEAD POLES

Ref No. C976718 | Historic Drg.No. 1091231173

Revision Notes

AMENDED 08.08.18