


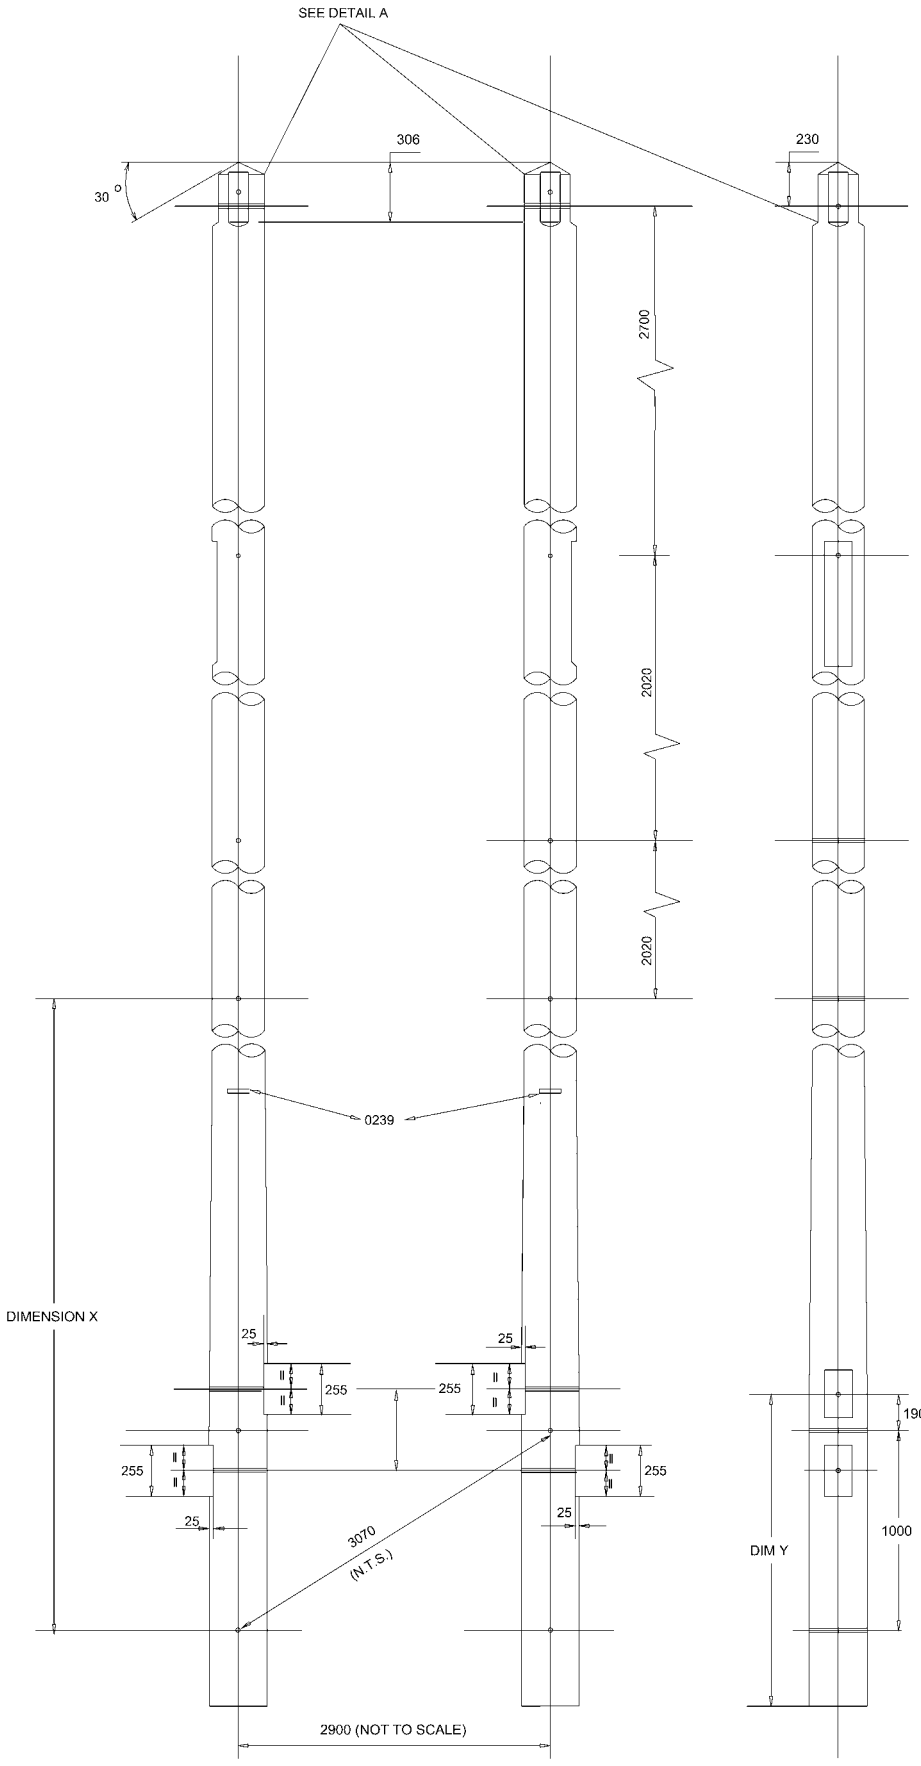


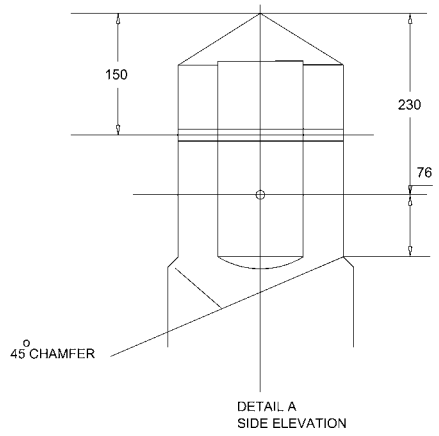

DETAIL A
SIDE ELEVATION

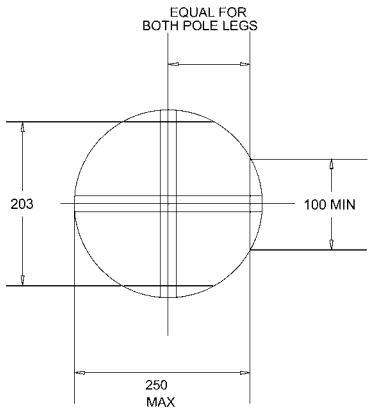

DETAIL A



DETAIL B
PLAN

NOTES:

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 230mm
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
3. POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
5. POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
6. HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

POLE LENGTH	DIM X	DIM Y
12.0m	5655	1700
13.0m	6655	1700
14.0m	7655	1700
15.0m	8655	1700
16.0m	9655	1900

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

CE Electric UK

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

66KV SINGLE CIRCUIT LINES
DRILLING SCARFING AND MARKING FOR TERMINAL SUPPORT WITH SURGE ARRESTORS AND HEAT SHRINK TERMINATION AS SHOWN ON 1.09.123.1173 SHEET 9

Sheet No. 10	Scale 1:20
Prepared By Barbara.Gordon	Type OVERHEAD POLES
Revised 01/07/09	Grid Reference
Date Issued 24/06/09	Checked By S.SALKELD
Ref No. C976718	Historic Drg.No. 1091231173
Revision	Notes