


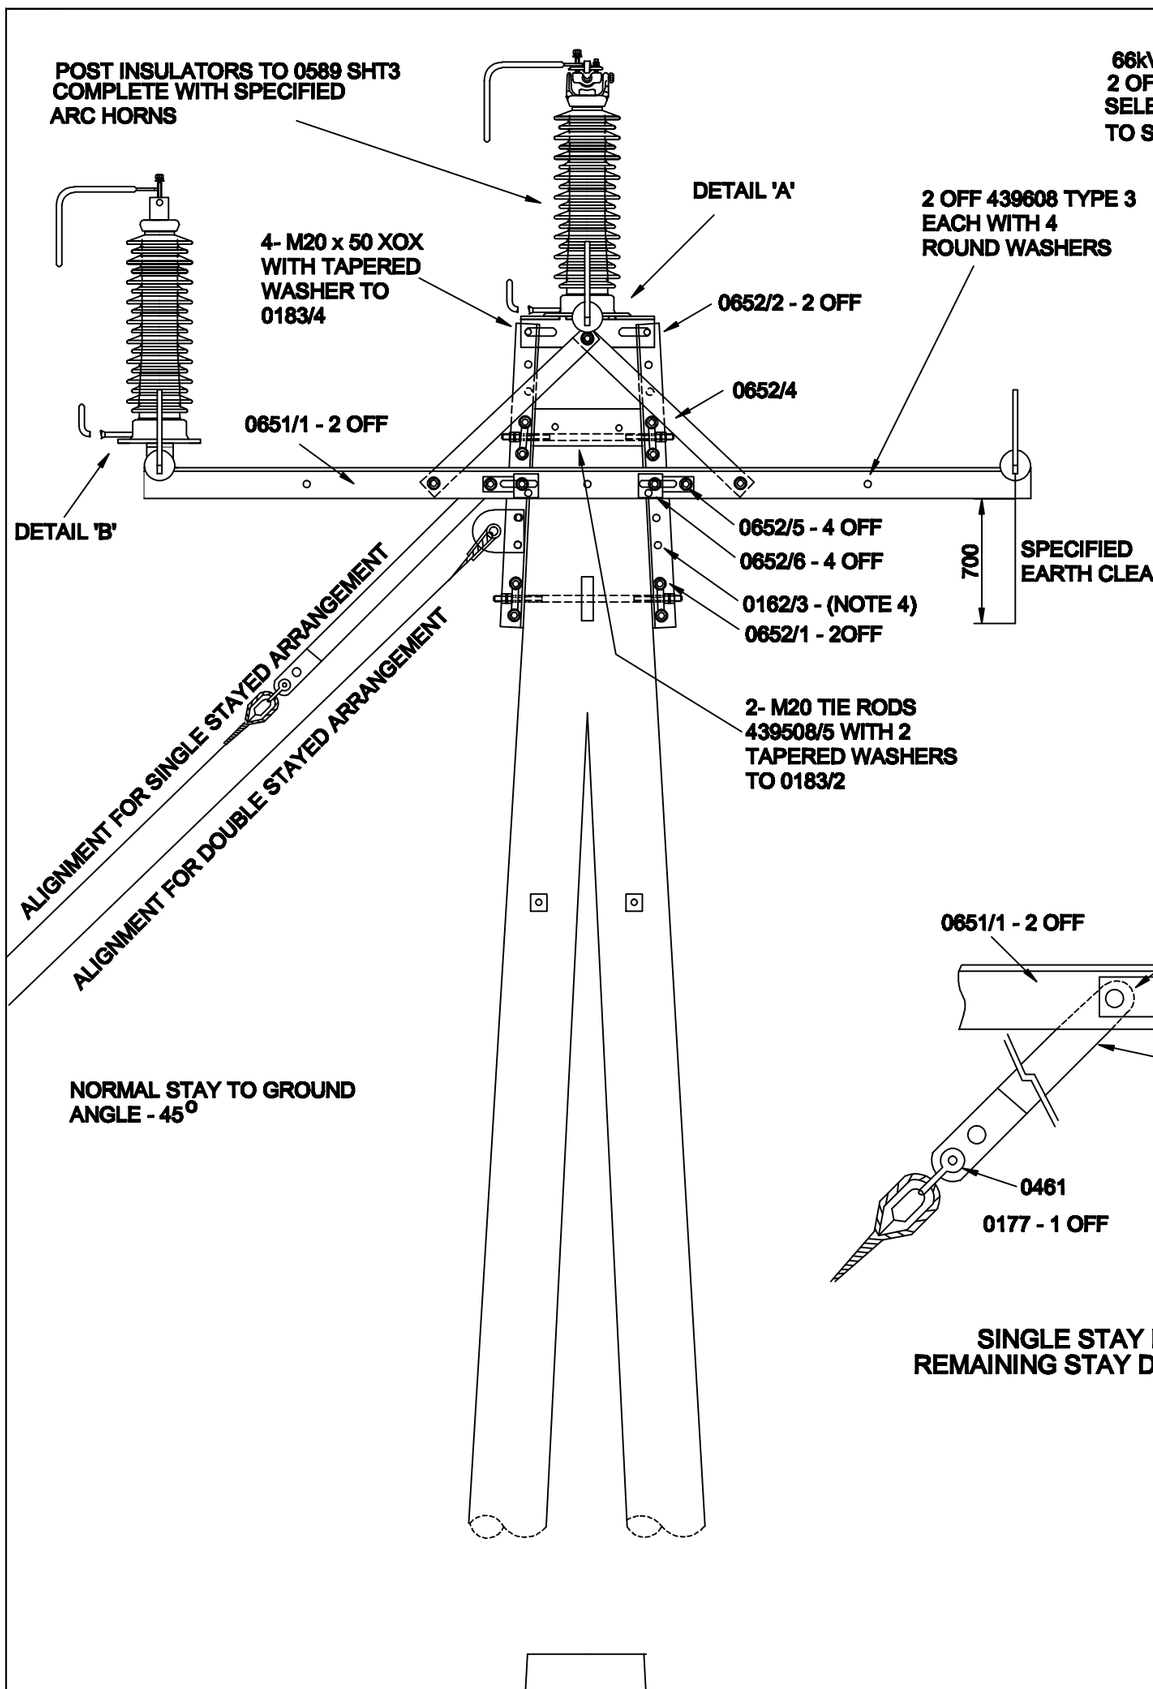


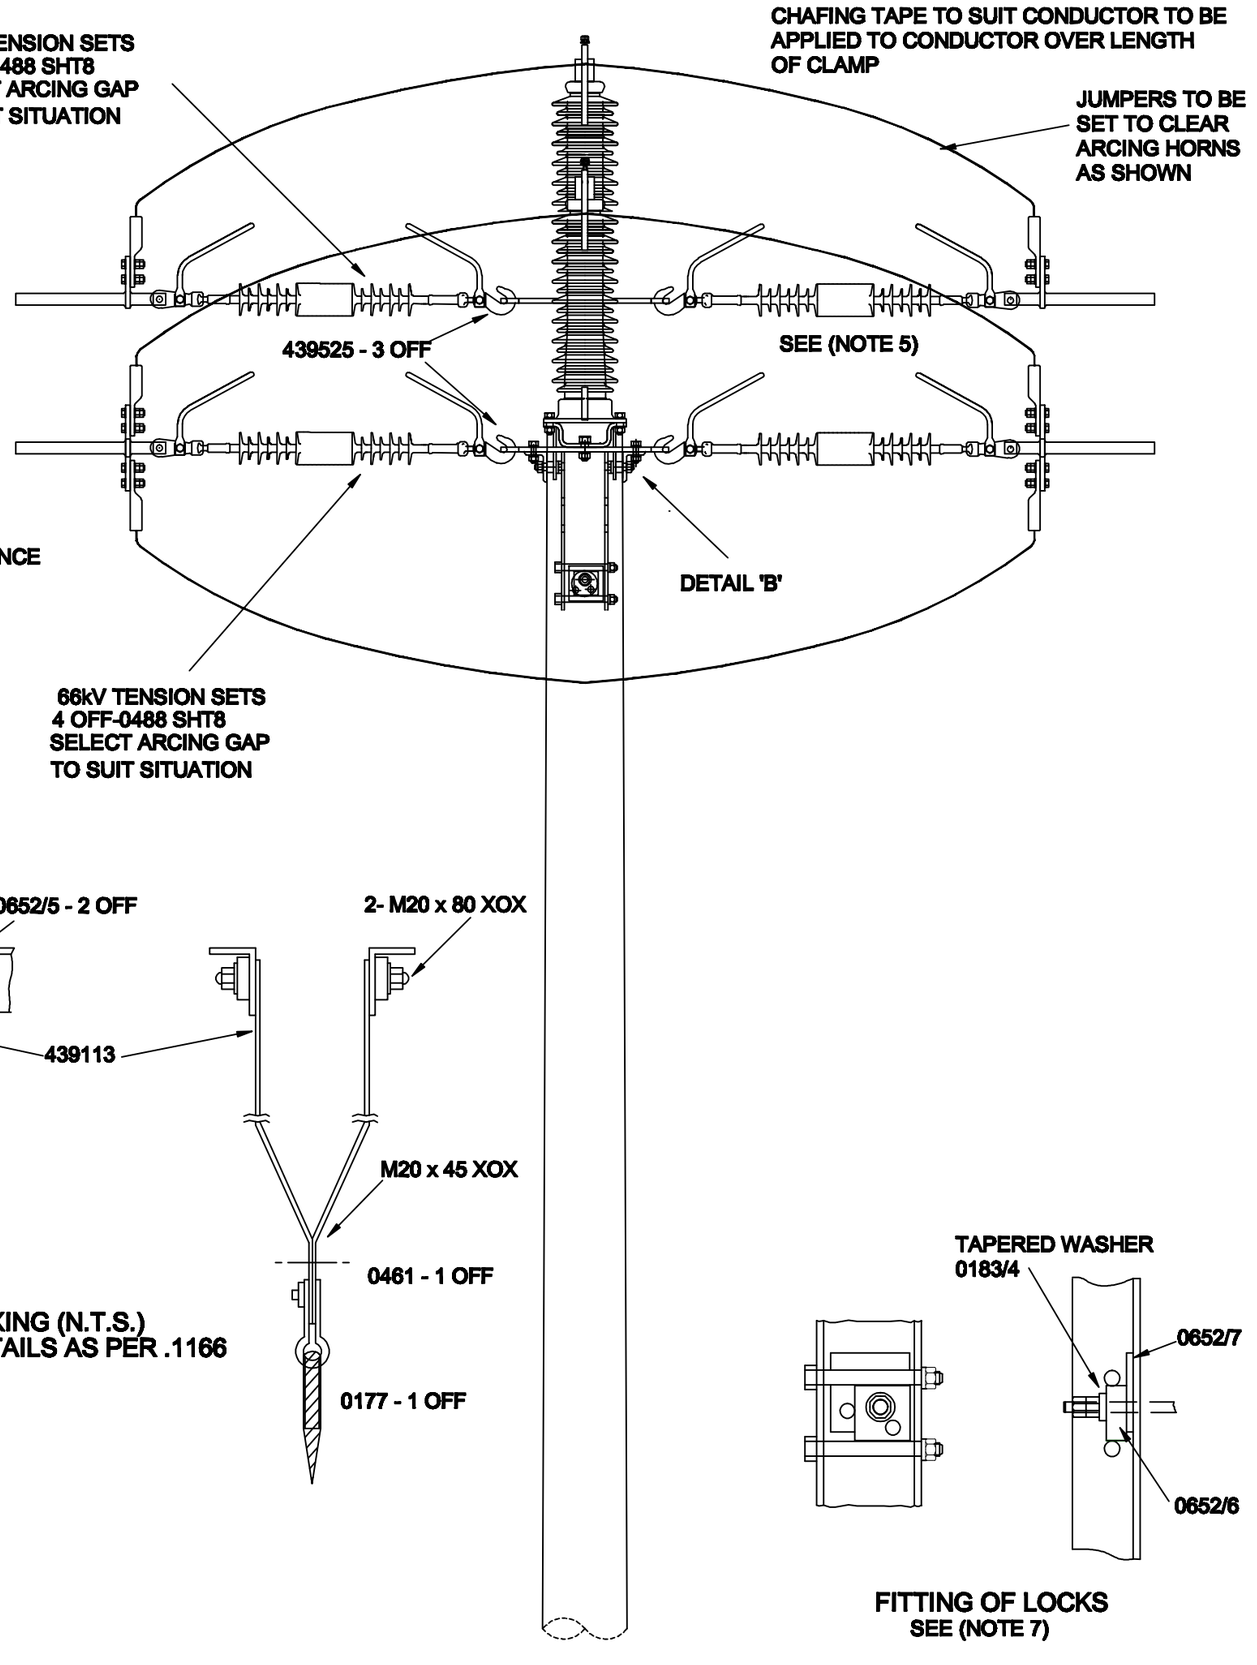

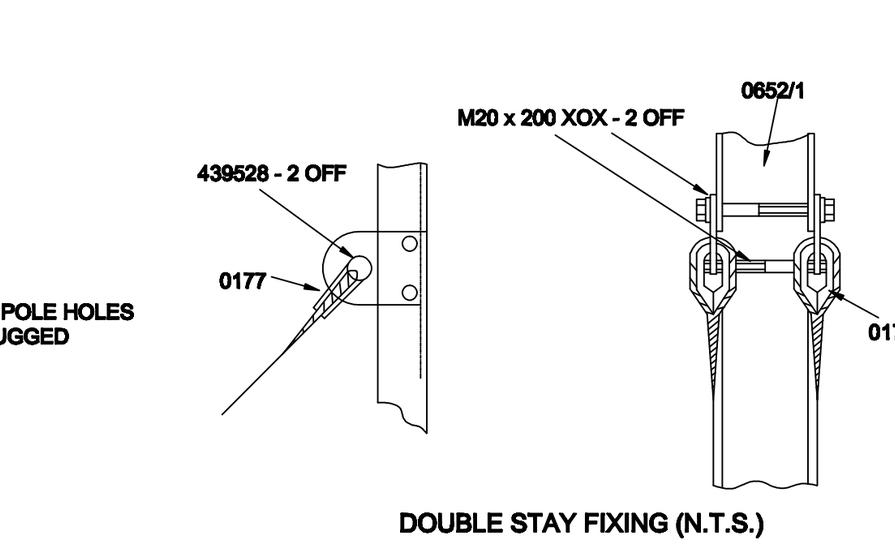


SINGLE STAY FIXING (N.T.S.)
REMAINING STAY DETAILS AS PER .1166

FITTING OF LOCKS
SEE (NOTE 7)

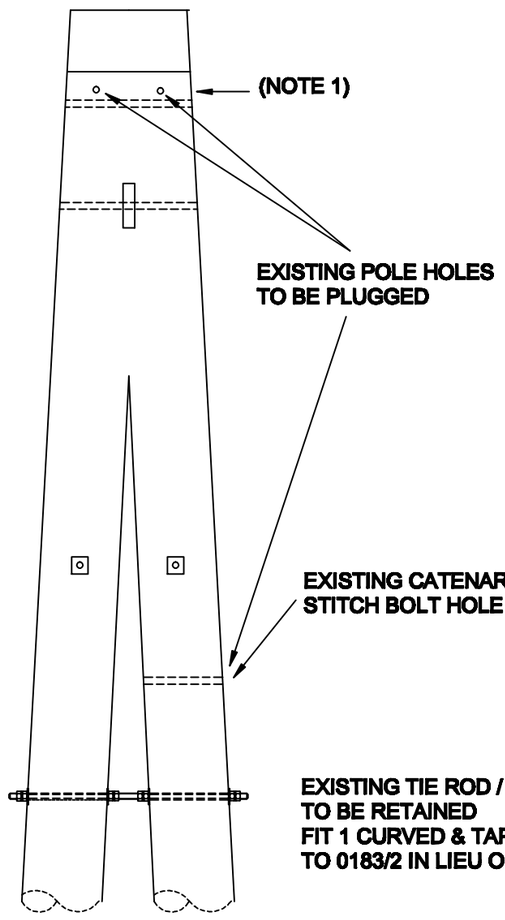


POLE TOP REFABRICATION DETAILS

DOUBLE STAY FIXING (N.T.S.)

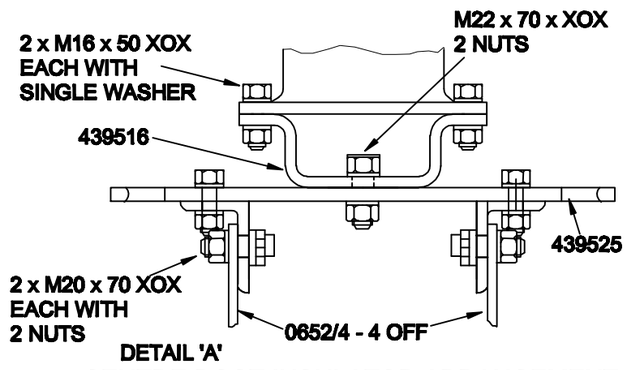

CENTRE POST INSULATOR ARRANGEMENT

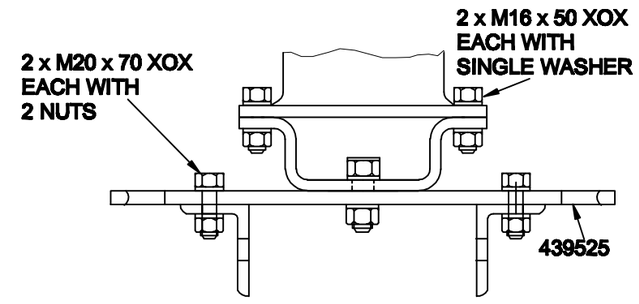

DETAIL 'B'
CROSSARM END POST INSULATOR ARRANGEMENT

POLE LENGTH	DIM. 'Y'
8.5m - 12.0m INCLUSIVE	2.0m
13.0m - 15.0m INCLUSIVE	2.2m
16.0m - 18.0m INCLUSIVE	2.4m
20.0m - 24.0m INCLUSIVE	3.0m

WORK SPEC. 04/242

NOTES

1. ON LARGER DIAMETER POLES EXISTING POLE SCARFING TO BE MODIFIED.
 ONLY IF NECESSARY TO PROVIDE FIRM BEARING ON VERTICAL CHANNELS
2. DETAIL DRAWINGS PREFIXED 43 REFER TO ESI DRAWINGS, OTHER DETAIL DRAWINGS REFER TO 1.09.101 SERIES
3. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER NUT, 1 ROUND WASHER UNDER BOLT HEAD EXCEPT WHERE SPECIFIED OTHERWISE.
4. **WHERE IT IS NECESSARY TO PROVIDE EARTHED STEELWORK, THE REQUIRED COMPRESSION LUG TO BOLTED THROUGH 22mm DIA. HOLE IN VERTICAL CHANNEL COMPRESSION LUG TO BE** VPCL 1.4 (22)
5. CROSSARM PACKS AS FOLLOWS :-
 0652/5 ON CHANNEL FIXING IMMEDIATELY BEHIND CROSSARM
 0652/3 ON TIE STRAP AND CHANNEL FIXING
 A-IN FRONT OF CROSSARM AND 0652/6 RESPECTIVELY ON STOUT POLES
 B-BEHIND CROSSARM AND 0652/5 RESPECTIVELY ON EXTRA STOUT POLES
6. LOCKS TO BE ROTATED/FITTED TO ENSURE CONTACT BETWEEN OUTER FACE AND 0652 ITEM 5
7. LOCK 0652 ITEM 7 TO BE ROTATED/FITTED TO LOCK TIE ROD BETWEEN CHANNEL SIDES WHILST MAINTAINING CHANNEL PLUMB AND CENTRAL POLE FACE.
 LOCK 0652 ITEM 6 TO BE ROTATED/FITTED TO LOCK TIE ROD BETWEEN 2-M20 BOLTS WHILST PROVIDING LEVEL MOUNTING FOR POST ANGLES

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

CE Electric UK

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

Sheet No. 2	Scale 1:20
Prepared By Joan.Oakley	
Revised 26/08/10	Grid Reference
Date Issued 13/08/10	Checked By G HAMMEL

66KV CIRCUIT LINES SECTIONED 'A' POLE SMALL ANGLE APPLICATION

Type OVERHEAD POLES

Ref No. C990069 | Historic Drg.No. 1091231192

Revision A Notes