

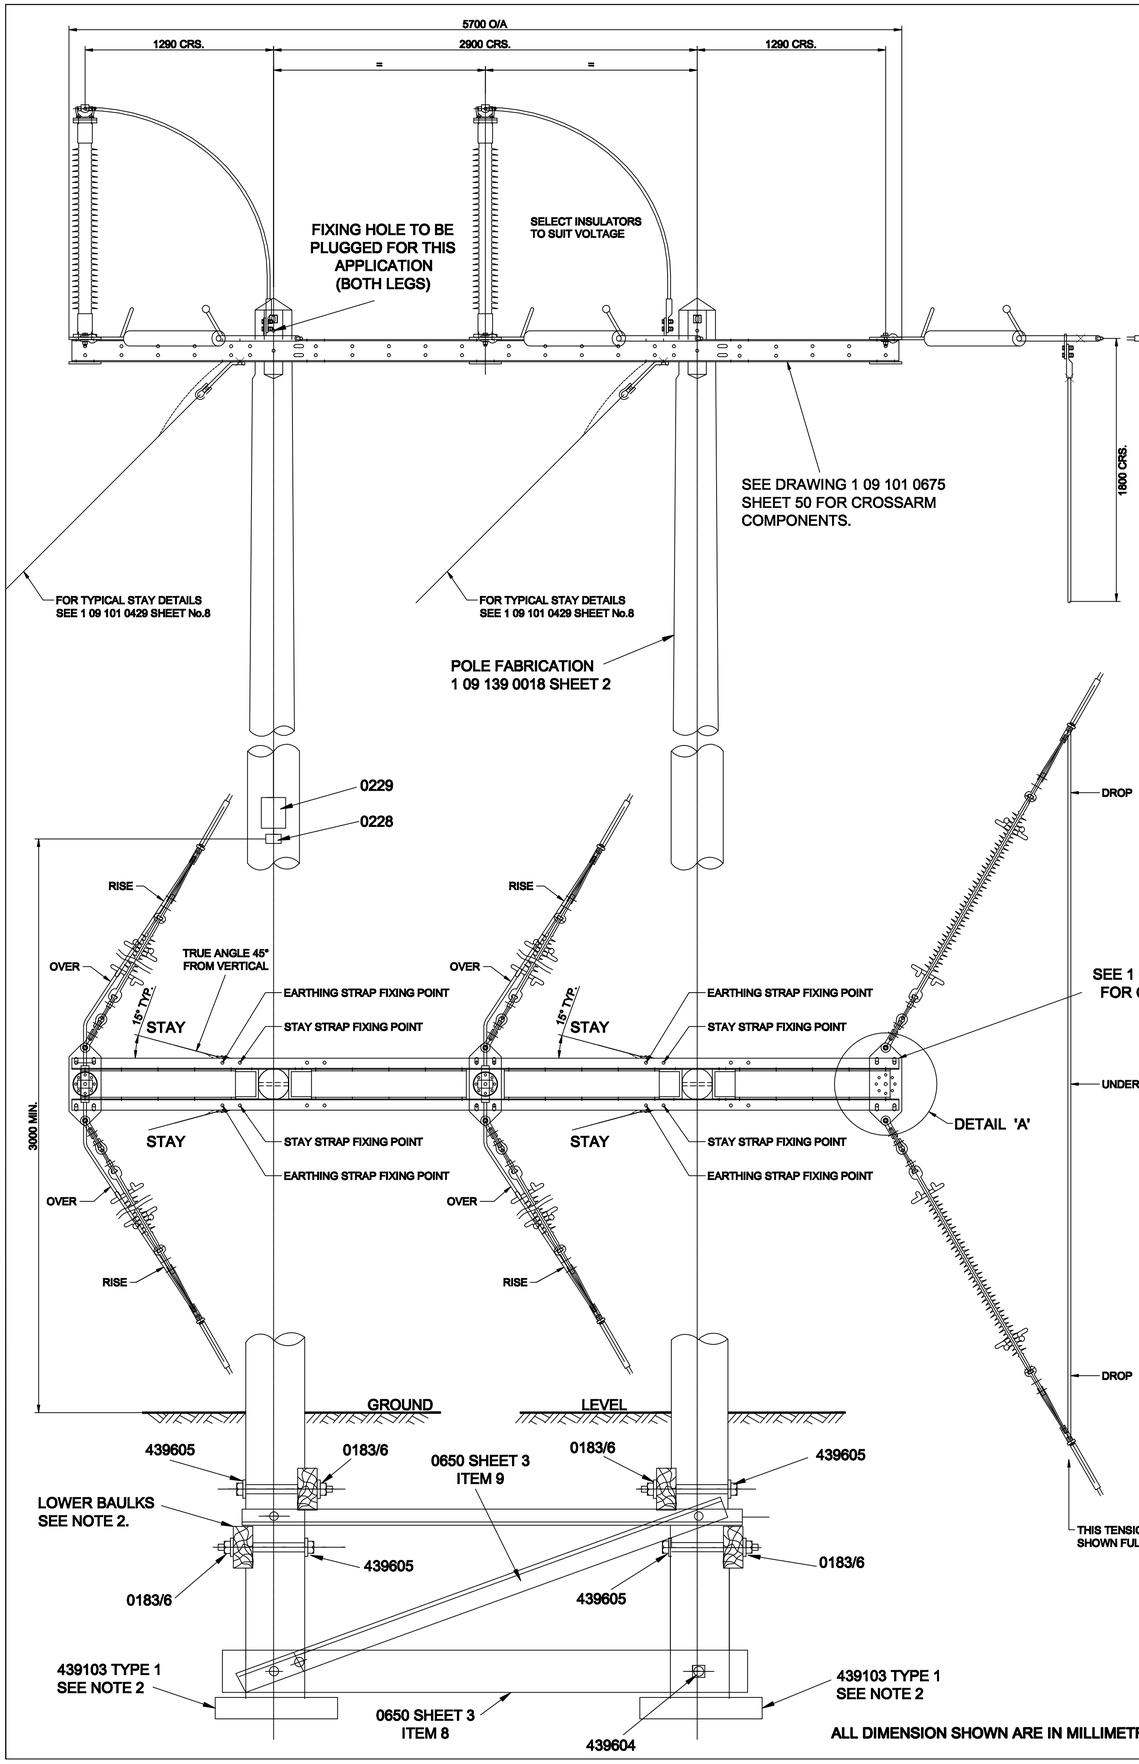


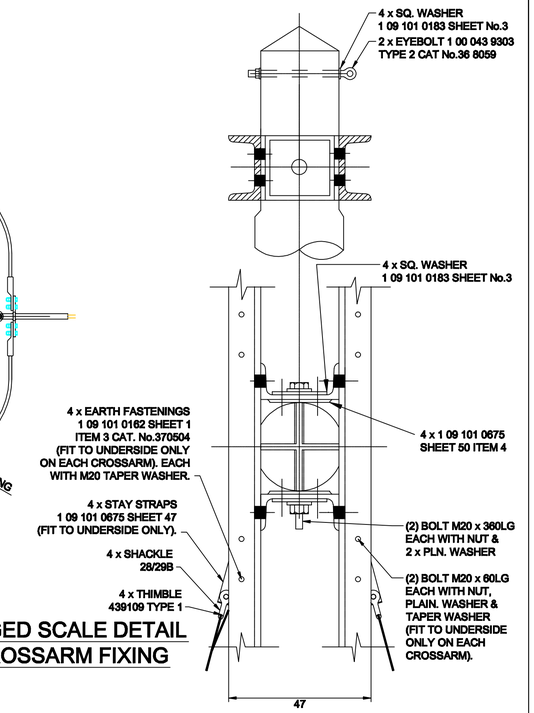

ENLARGED SCALE DETAIL OF CROSSARM FIXING

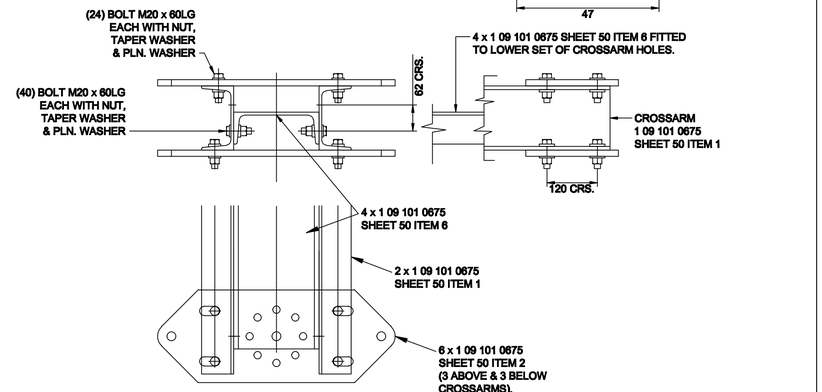

ENLARGED SCALE DETAIL 'A'

NOTES:

1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED.
2. LOWER TIMBER BAULKS MAY BE OMITTED WHERE GOOD GROUND CONDITIONS WARRANT IT. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF TWO WOOD BAULKS LAID TOGETHER TO FORM A 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 1200min CLEARANCE BETWEEN PHASES TO BE 1500min
5. CONDUCTOR TO BE TAPED TO AVOID CHAFING OVER LENGTH OF TRUNNION CLAMP AT HEAD OF POST INSULATOR.
6. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 x PLAIN WASHER UNDER NUT AND 1 x PLAIN WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE.
7. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS.
8. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

POLE LENGTH	Dim 'X'
11.0m and 12.0m	2.0m
13.0m to 15.0m inclusive	2.2m
16.0m and 17.0m	2.4m

WORK SPEC No 04/226

ALL DIMENSION SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

CE Electric UK
Manufacturer Details

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

66/132KV SINGLE CIRCUIT OVERHEAD LINES
LARGE ANGLE STRUCTURE
2.9 METRE CENTRE

Sheet No. 1	Scale N.T.S.
Prepared By Joan.Oakley	
Revised 17/08/10	Grid Reference
Date Issued 17/09/07	Checked By G HAMMEL

Type OVERHEAD STANDARDS
Ref No. C952173
Historic Drg.No. 1091390018
Revision D
Notes