


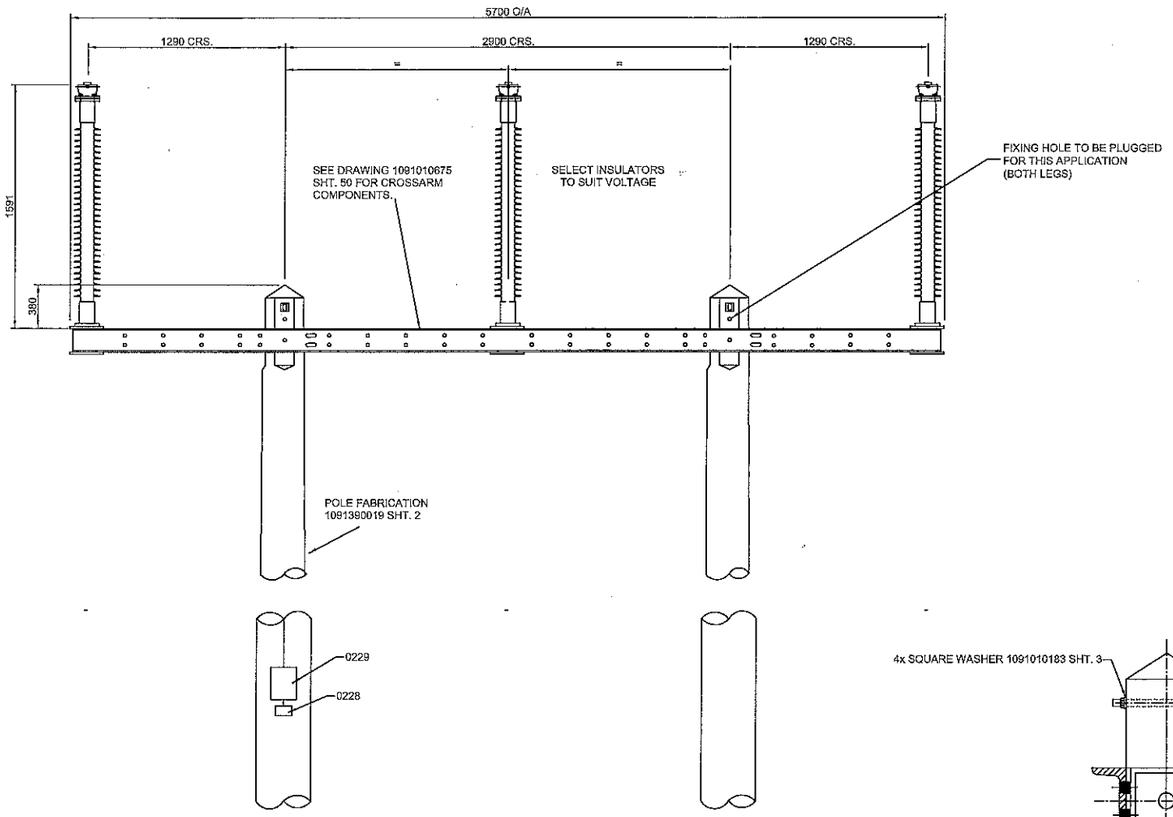


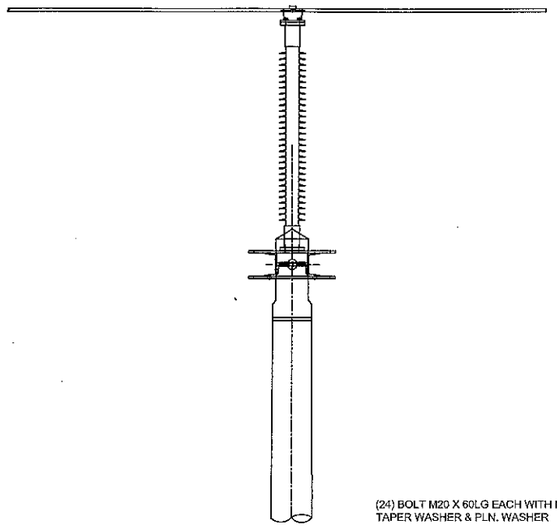


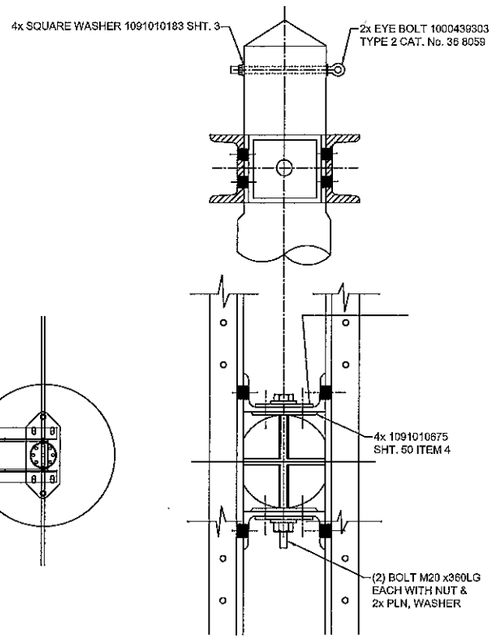



ENLARGED SCALE DETAIL
OF CROSSARM FIXING

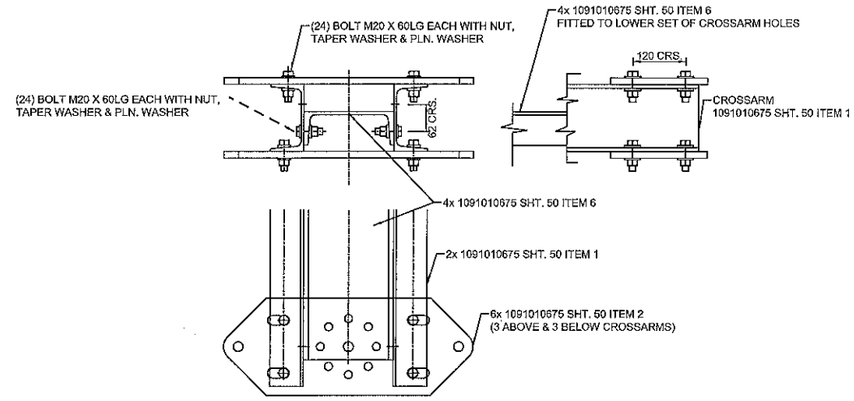

ENLARGED SCALE DETAIL
DETAIL 'A'

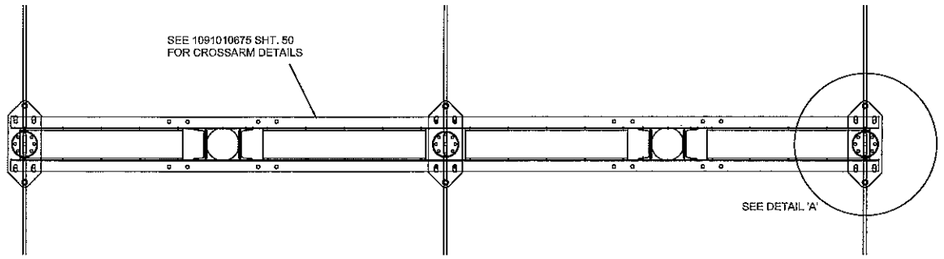

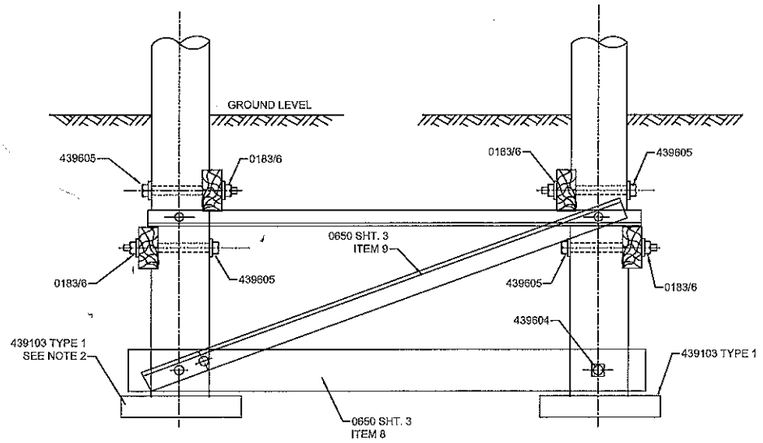

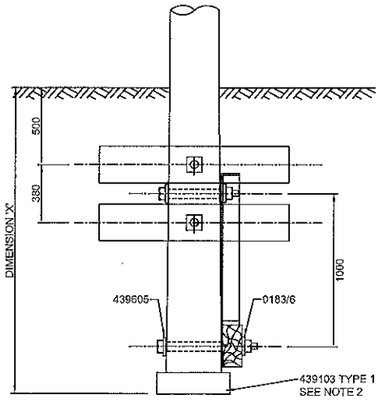

NOTES

1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED.
2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 No. WOOD BALKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASE DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES.
4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 1200min. CLEARANCE BETWEEN PHASES TO BE 1500min.
5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No. ROUND WASHER UNDER NUT AND 1 No. ROUND WASHER UNDER BOLT HEAD UNLESS STATED.
6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS.
7. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m. LENGTH.

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m.	2.6m.
13.0m TO 15.0m. INCLUSIVE	2.6m.
16.0m TO 18.0m INCLUSIVE	2.6m.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

NORTHERN POWERGRID

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

66KV/132KV SINGLE CIRCUIT OVERHEAD LINES
STRAIGHT LINE STRUCTURE
2.9 CTRS. 'H POLE'

Manufacturer Details			
Sheet No. 1	Scale 1:20		
Prepared By Joan.Oakley		Type OVERHEAD	POLES
Revised 26/07/12	Grid Reference	Ref No. C1011573	Historic Drg.No. 1091390022
Date Issued 19/07/12	Checked By G HAMMEL	Revision	Notes