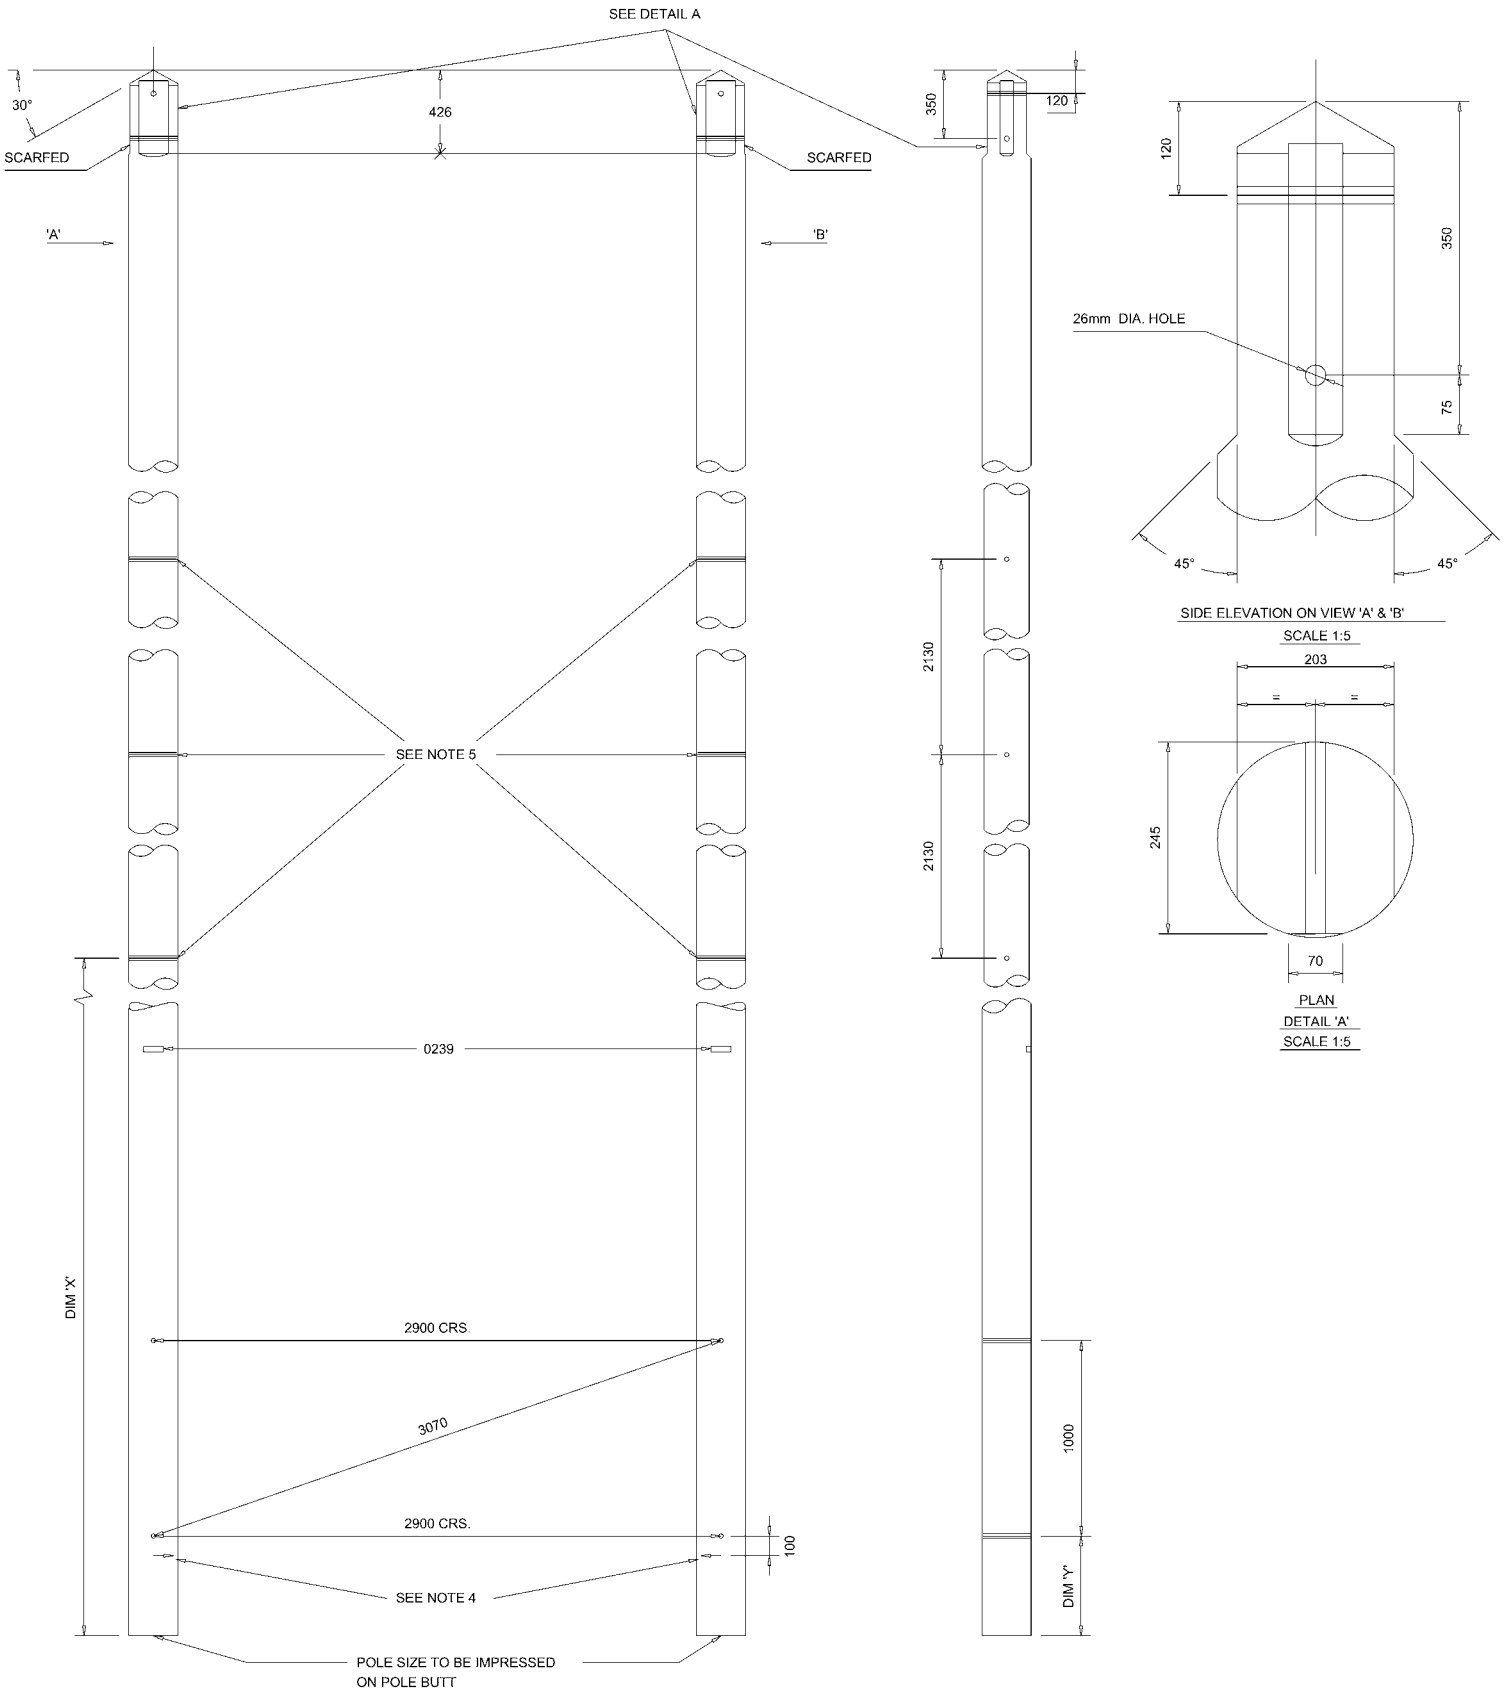


SIDE ELEVATION ON VIEW 'A' & 'B'
SCALE 1:5

PLAN
DETAIL 'A'
SCALE 1:5

POLE LENGTH	DIM "X"	DIM "Y"
UP TO AND INCLUDING 12.0m	—	310
13.0m–15.0m INCLUSIVE	—	510
16.0m AND 17.0m	—	710
18.0m	7955	710
20.0m	9255	1310
22.0m	10255	1310
24.0m	11255	1310

NOTES

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT – 250mm.
2. HOLES TO BE 22mm DIA. EXCEPT AS SHOWN IN DETAIL "A" (26mm) DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE-LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
3. POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. 50x6x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.
5. "H" POLES 18.0m AND OVER TO BE SUPPLIED COMPLETE WITH A DOUBLE PANEL OF CROSSBRACING TO DRG. No. 1.09.101.129.

All dimensions shown are in millimetres unless stated otherwise

CE Electric UK
Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

132KV SINGLE CIRCUIT OVERHEAD LINES DRILL
SCARFING AND MARKING FOR TERMINAL 'H' PO

Sheet No. 2	Scale 1:20
Prepared By Janis Webb	Type OVERHEAD POLES
Revised 04/08/06	Grid Reference
Date Issued 28/10/99	Checked By M MOODY
Ref No. C102518	Historic Drg.No. 1091380004
Revision B	Notes