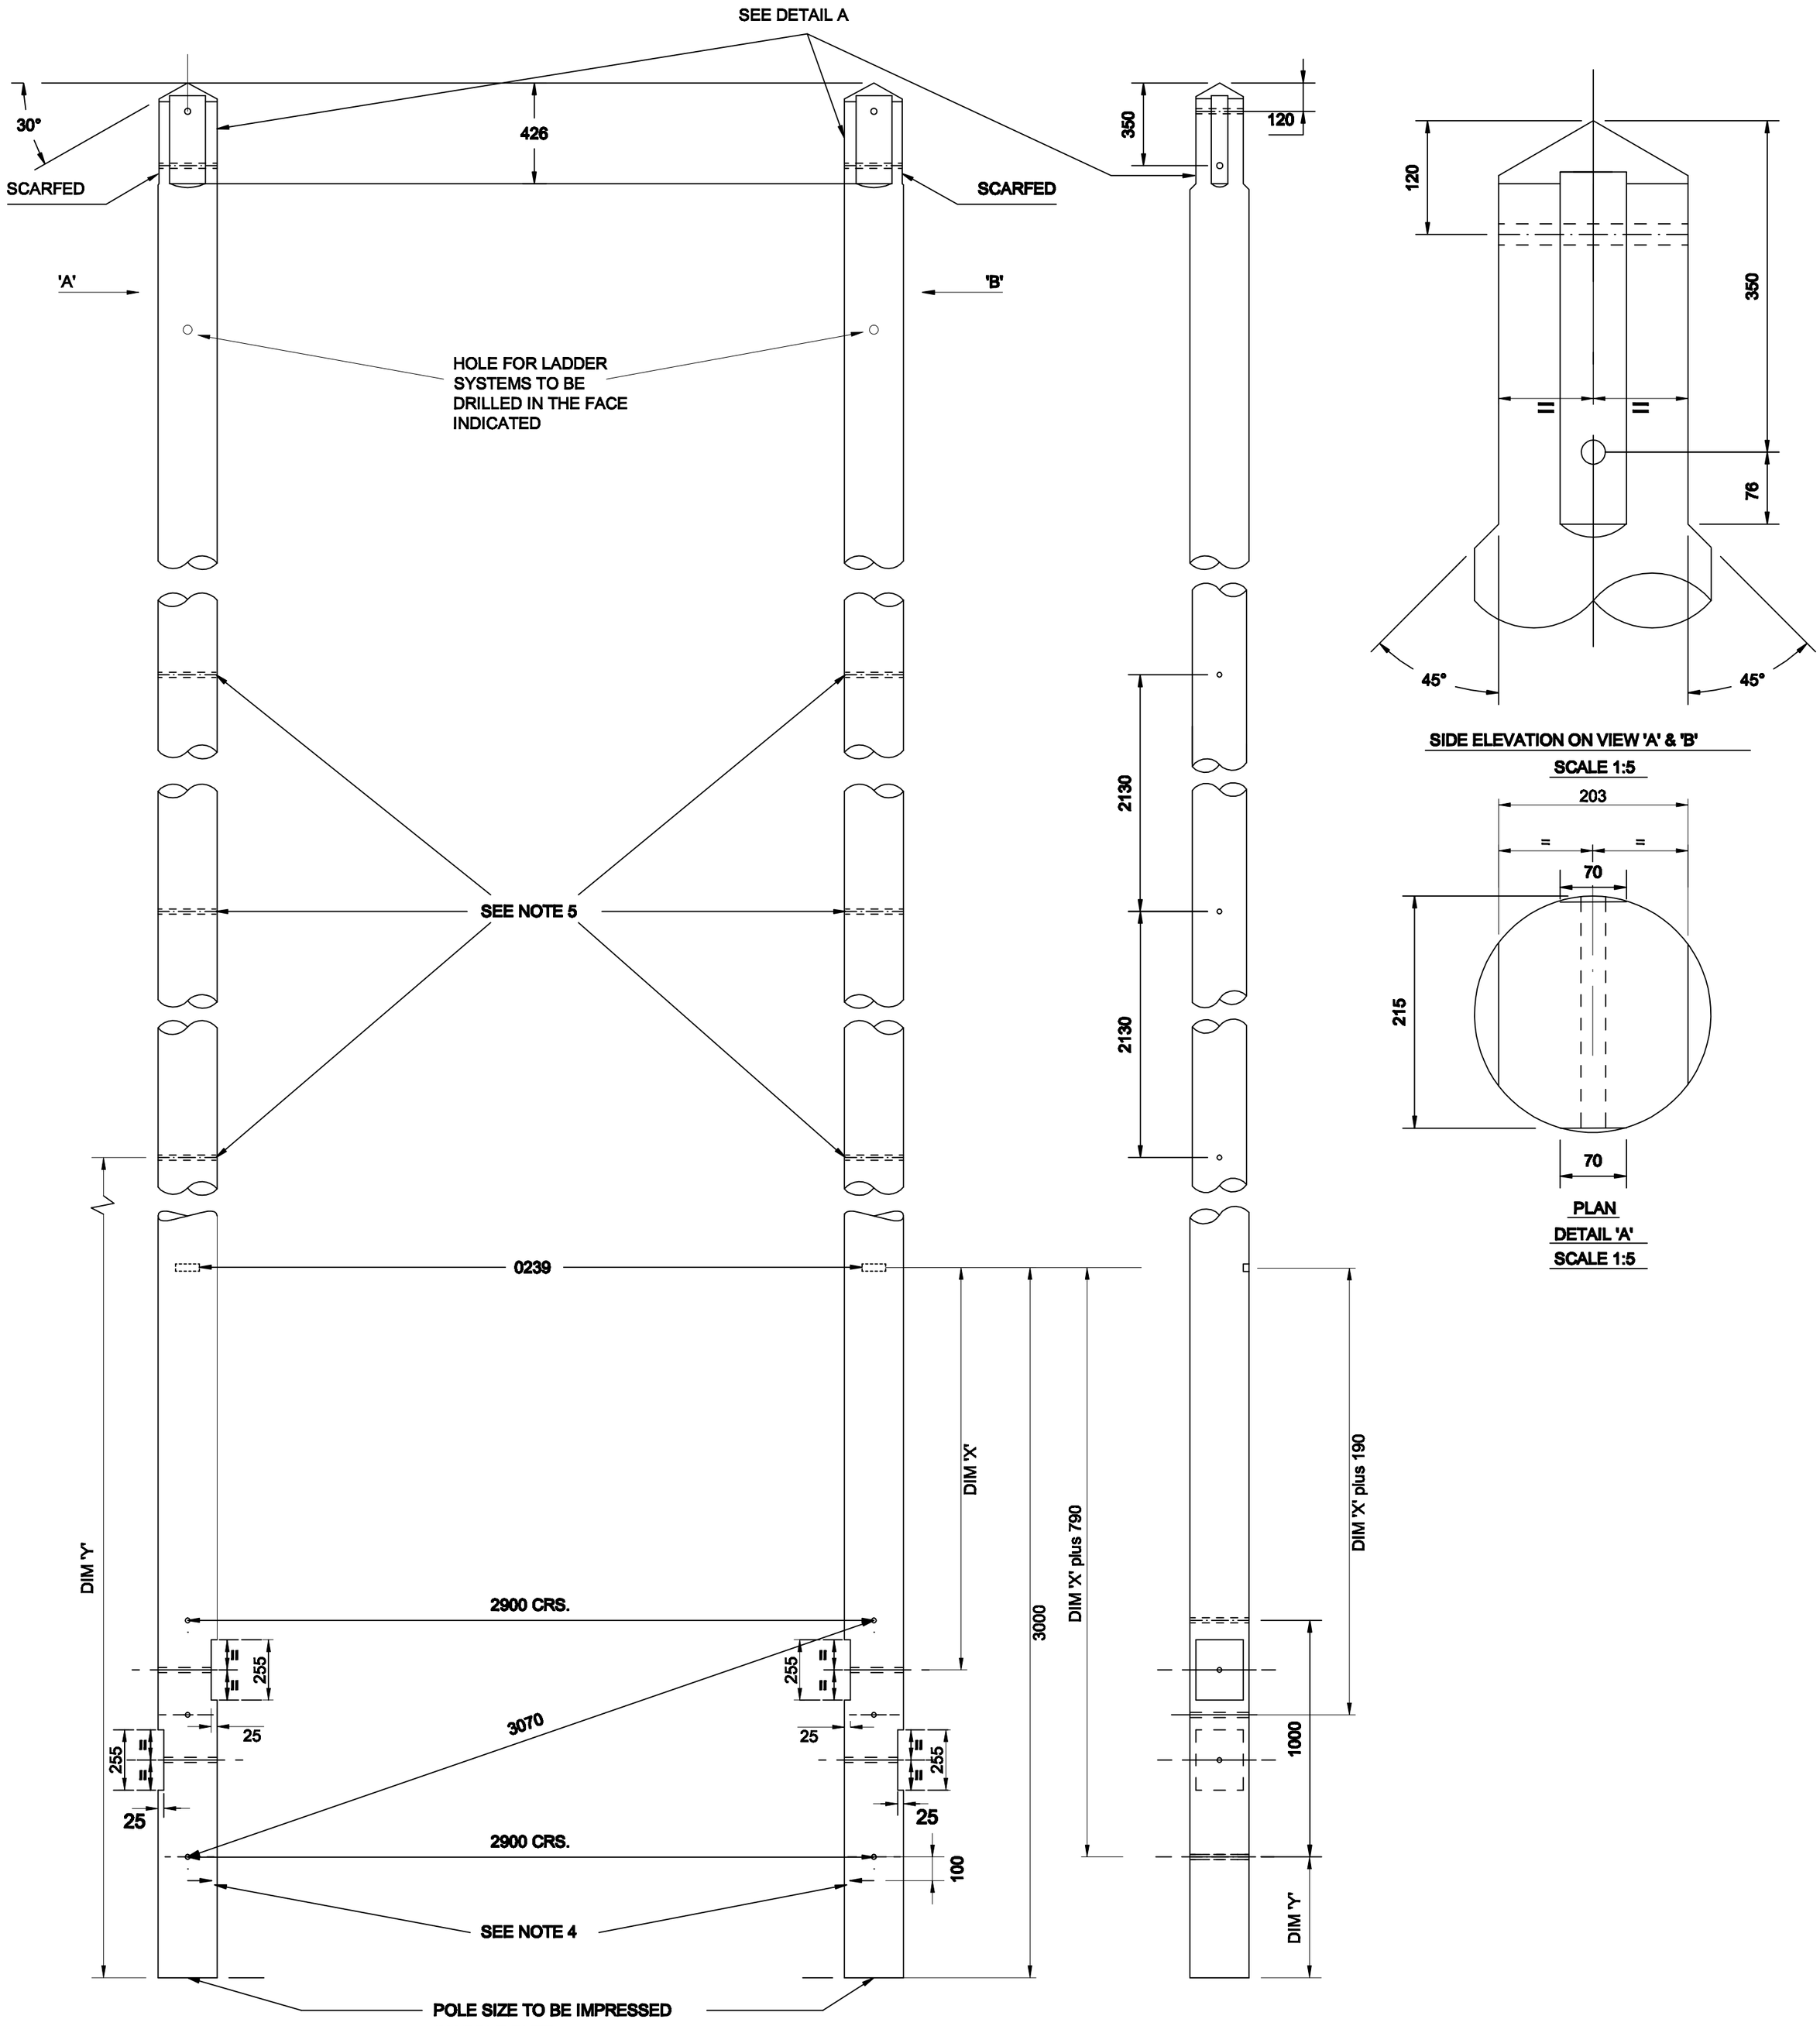


SIDE ELEVATION ON VIEW 'A' & 'B'
SCALE 1:5

PLAN
DETAIL 'A'
SCALE 1:5

POLE LENGTH. (m)	DIM. 'X' (mm)	DIM. 'Y' (mm)
9.0 - 11 INCLUSIVE.	1900	-
12.0	1700	-
13 - 15 INCLUSIVE.	1400	-
16 - 18 INCLUSIVE.	1100	7955
20	500	

NOTES

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION E/STOUT – 250mm.
2. HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE–LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
3. POLE BUTTS CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. 50x6x6 DEEP ARROW MARK POINTING TOWARDS OPPOSITE POLE LEG TO BE GOUGED ON BRACE BLOCK NOTCHING.
5. 'H' POLES 18.0m AND OVER TO BE SUPPLIED COMPLETE WITH A DOUBLE PANEL OF CROSSBRACING TO DRG.No. 1.09.101.0129.

All dimensions shown are in millimetres unless stated otherwise

CE Electric UK

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

Sheet No.	Scale
2	1:20

Prepared By: Barbara.Gordon

Revised	Grid Reference
09/10/07	
Date Issued	**Checked By**
03/07/07	G HAMMEL

132KV SINGLE CIRCUIT OVERHEAD LINES DRILLING, SCARFING AND MARKING FOR LARGE ANGLE 'H' POLE STRUCTURE

Type: OVERHEAD STANDARDS

Ref No. C949778 Historic Drg.No. 1091390018

Revision D Notes