

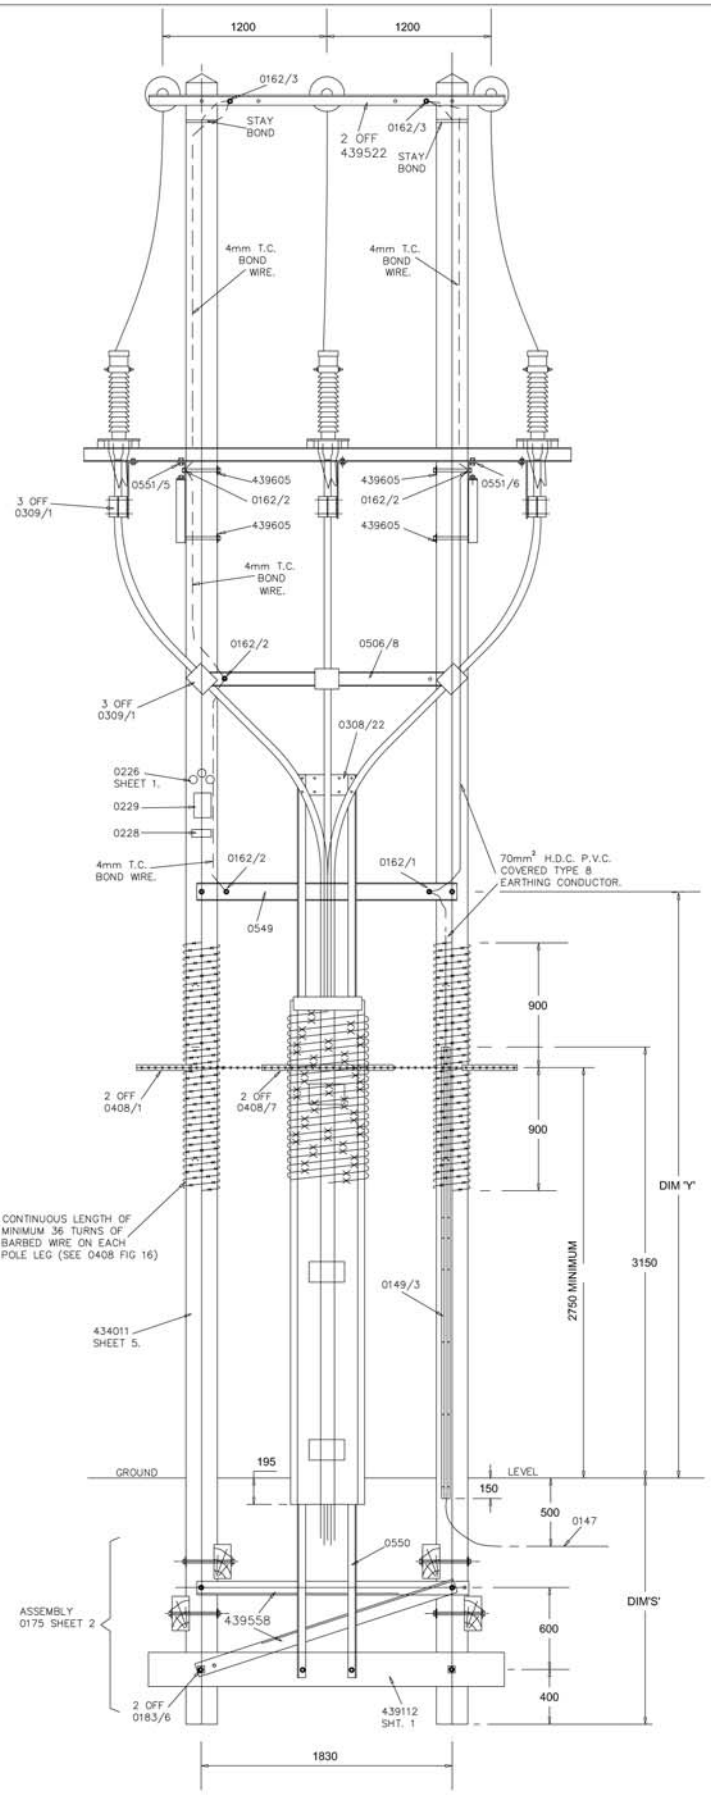


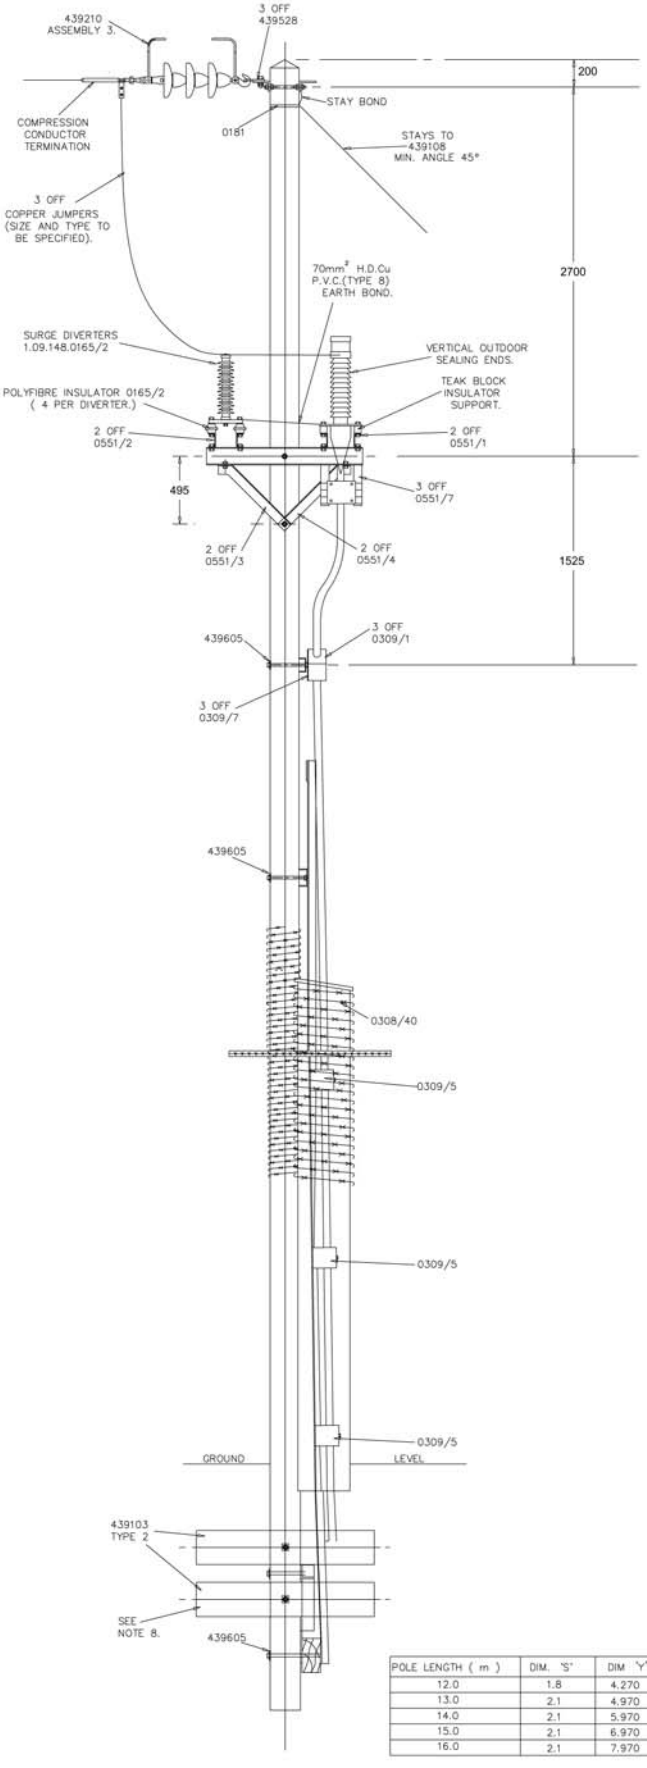

POLE LENGTH (m)	DIM. 'S'	DIM 'Y'
12.0	1.8	4.270
13.0	2.1	4.970
14.0	2.1	5.970
15.0	2.1	6.970
16.0	2.1	7.970

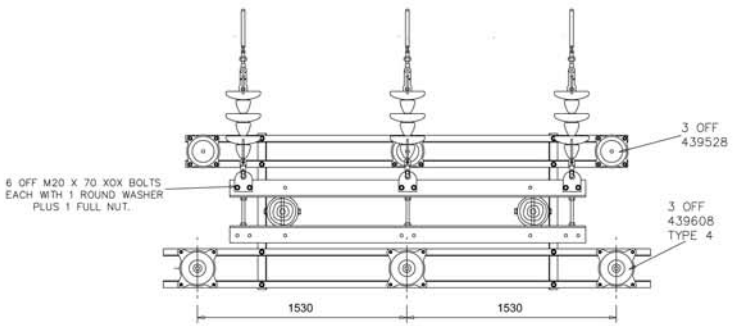

PLAN OF STEELWORK AND ASSEMBLY.
H.V. JUMPERS OMITTED FOR CLARITY AND TO INDICATE EARTHING BETWEEN SEALING ENDS AND SURGE DIVERTERS, SEE NOTE 3.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

NOTES:

1. MINIMUM POLE LENGTH 12.0m.
2. ALL POLE BOLTS TO BE M20 DIA.
3. DIRECT INSULATED EARTH BOND BETWEEN BASE OF SURGE DIVERTER AND BASE OF SEALING END, (SITUATED OPPOSITE DRAIN NOZZEL) THAT IT IS INTENDED TO PROTECT.
4. WHERE 3 CORE CABLE USED, EARTH BOND TO BE EXTENDED WITHIN CABLE TRUNKING TO TRIFRUCATING JOINT.
5. DETAIL DRAWINGS PREFIXED 43.... REFER TO E.S.I. BASED DRAWINGS AND OTHER DRAWINGS REFER TO 1.09.101. SERIES.
6. EARTHING TO BE IN ACCORDANCE WITH E.I.500.
7. THE LOWER BLOCK MAY BE OMITTED IN GOOD GROUND CONDITIONS.

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. NO. 04/139.

Lloyds Court, 78, Grey Street, Newcastle Upon Tyne, NE1 6AF

H.V. OVERHEAD LINES
33kV TERMINAL 'H' SUPPORT (1830 CENTRES) WITH CABLE TERMINATION

Prepared by	J.L.W.	Drg.No.	1 00 043 4011
Checked	G.H.	Date Issued	DEC. 94
Mods.	A		
Sheet No.	8		
Revised	9.3.05		
Scale	1:20@A1		