


PLAN VIEW

SCALE 1:50

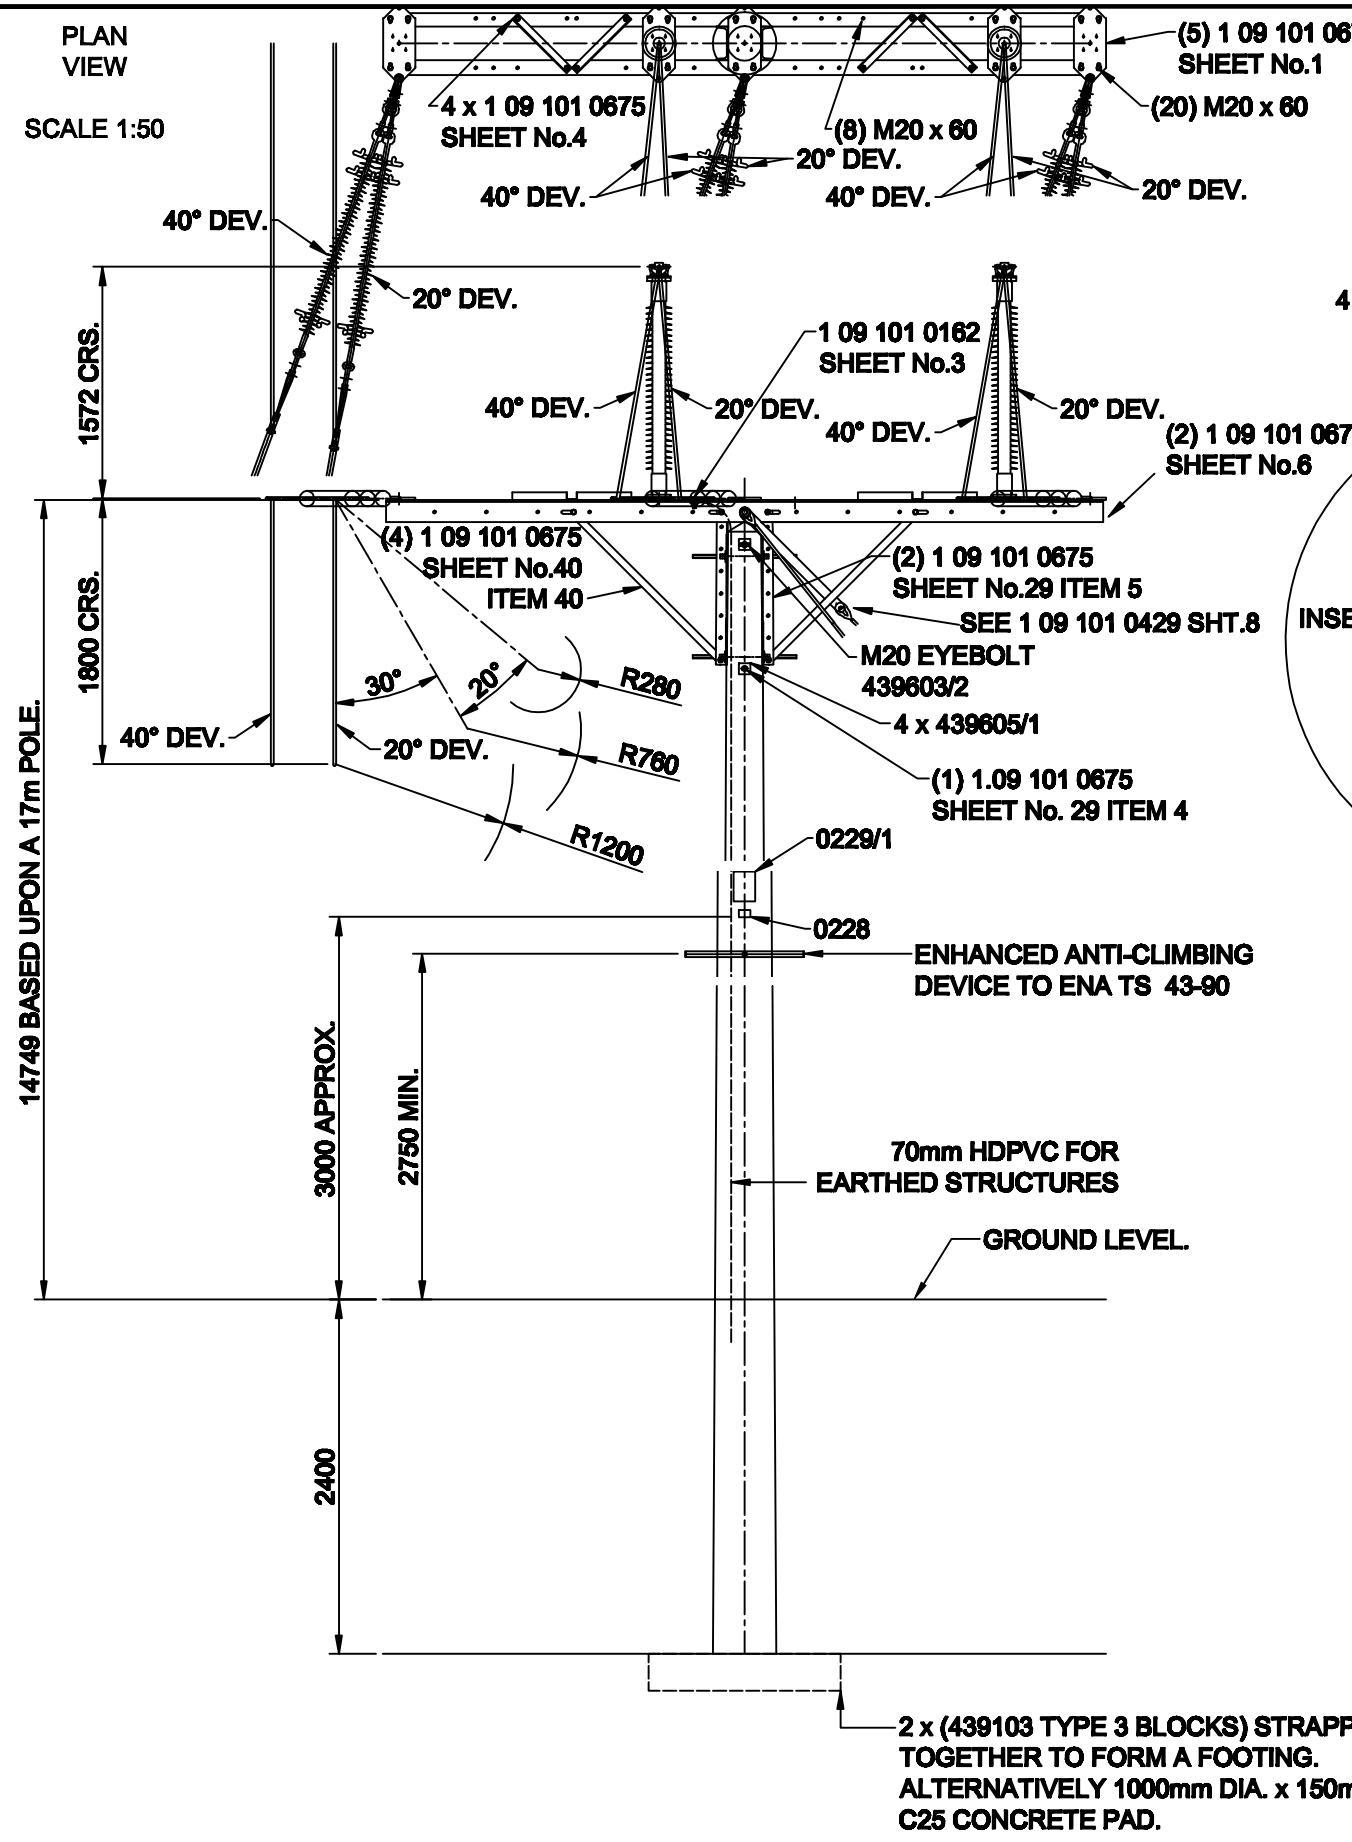

6 x TENSION INSULATOR ASSEMBLY 1 09 101 0487 SHEET 30 or 31
2 x POST INSULATOR 1 09 101 0487 SHEET No.18

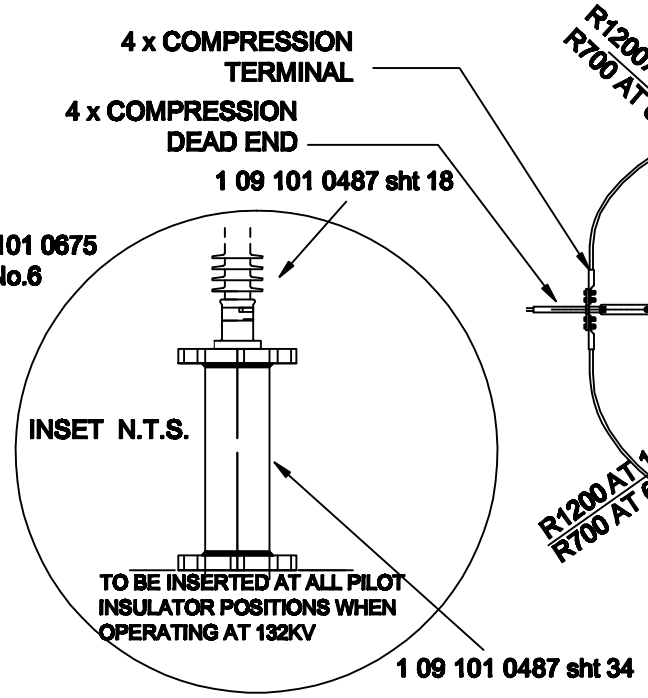

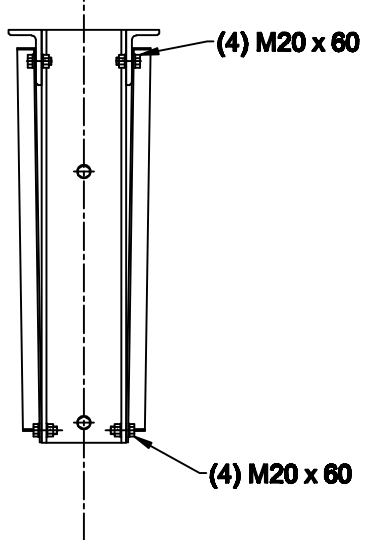



VIEW ON CROSSARM STRUT

SCALE 1:20

TENSION INSULATORS SHOWN AS PROJECTED VIEW AT 0° DEVIATION. TRUE VIEW OF TENSION INSULATORS WILL DEPEND UPON ANGLE OF DEVIATION i.e. 20° TO 40°.

SCALE 1:50

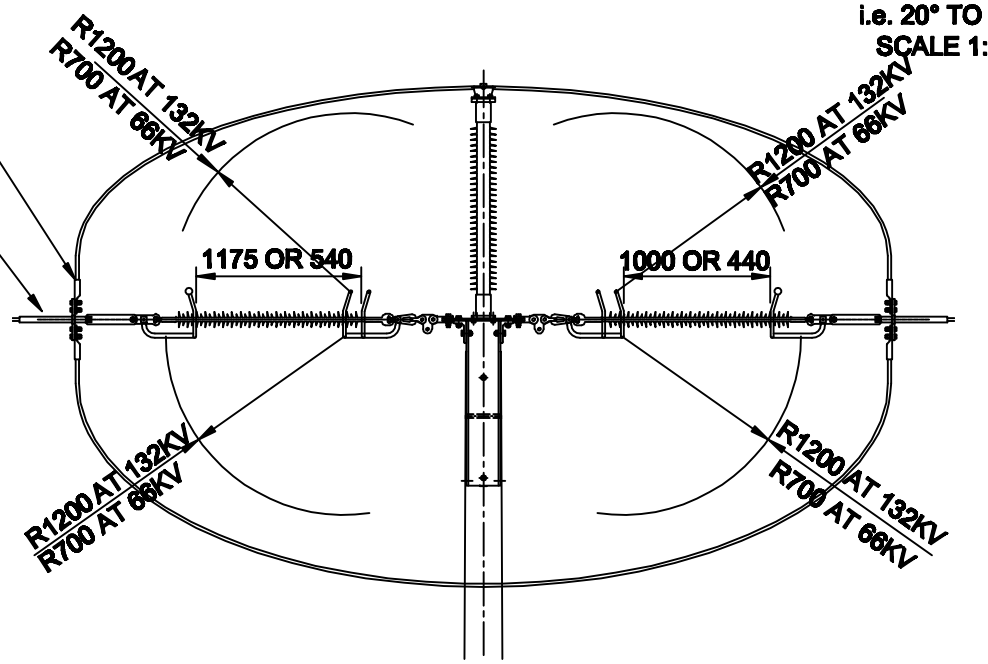

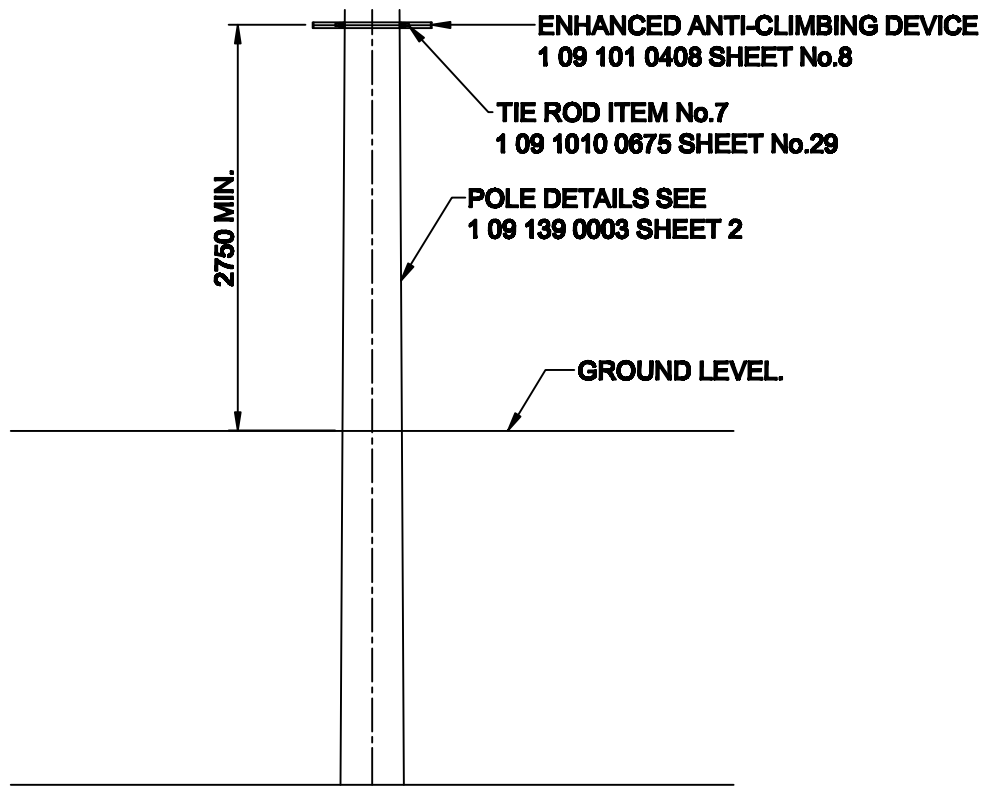

NOTES:

1. ALL STEELWORK FIXINGS BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER BOLT HEAD & 1 ROUND WASHER UNDER NUT, UNLESS STATED OTHERWISE. WHERE A CHANNEL IS USED A 5° TAPER WASHER SHOULD BE FITTED TO LEGS ONLY.
2. FOR DETAIL DRAWINGS PREFIXED 43 REFER TO E.S.I. DRAWINGS FOR OTHER DETAIL DRAWINGS REFER TO 1.09.101.0675 SERIES.
3. ARCING HORN GAPS TO BE SET 1000 FOR APPROACH & 1175 FOR NORMAL CONDITIONS ie 132kV. (THE ALTERNATIVE VALUES ARE SHOWN FOR 66KV OPERATION.)

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF
Manufacturer Details		66/132KV OVERHEAD LINES ASSEMBLY OF SINGLE POLE DEVIATION 20 DEGREES - 40 DEGREES
Sheet No. 1	Scale 1:50	
Prepared By Pauline.Moore		Type OVERHEAD — DOCUMENT_SUB_CLASS
Revised 06/05/10	Grid Reference	Ref No. C949724 — Historic Drg.No. 1091390014
Date Issued 02/07/07	Checked By G HAMMEL	Revision G — Notes