

PARTIAL PLAN VIEW

SCALE 1:50

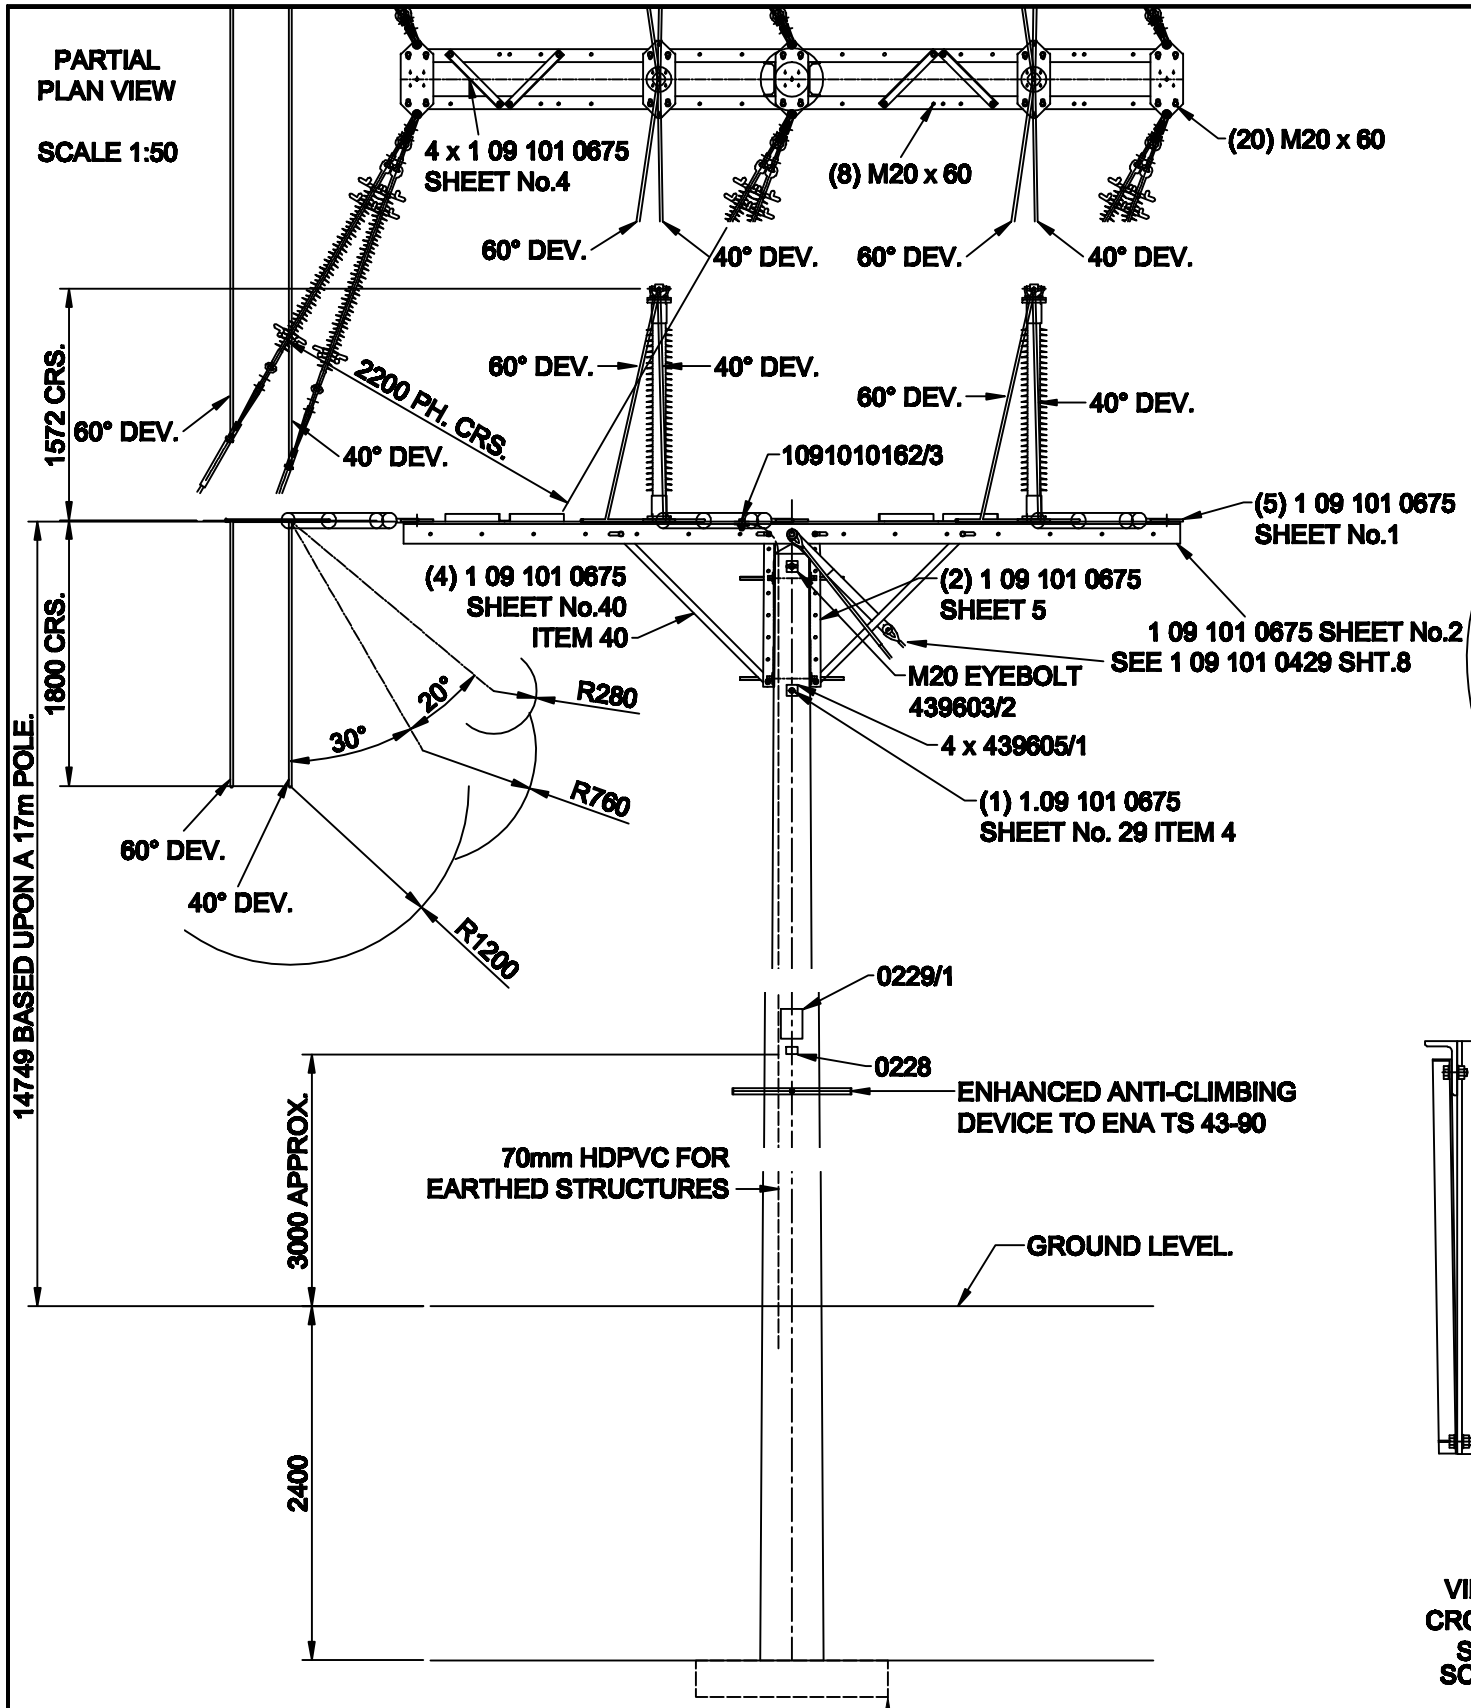



6 x TENSION INSULATOR ASSEMBLIES TO SUIT VOLTAGE
2 x POST INSULATOR 1 09 101 0487 SHEET No.18

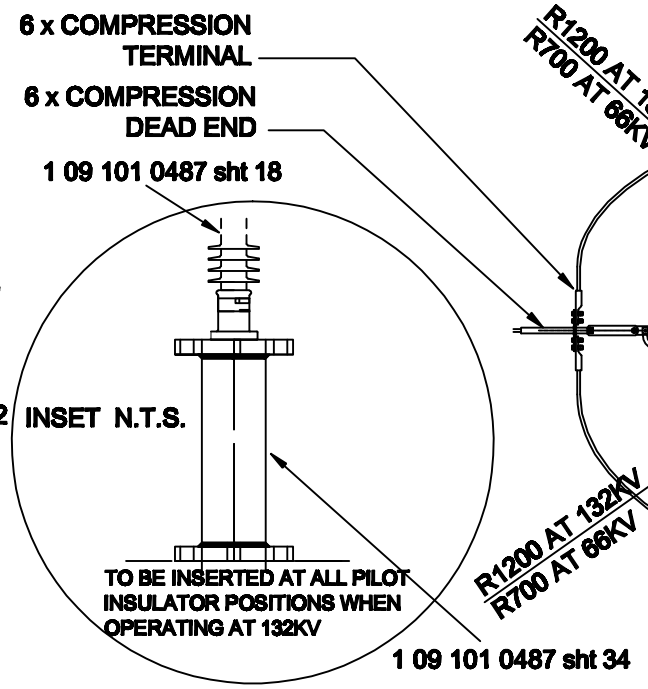


TENSION INSULATORS SHOWN AS PROJECTED VIEW AT 0° DEVIATION. TRUE VIEW OF TENSION INSULATORS WILL DEPEND UPON ANGLE OF DEVIATION i.e. 40° TO 60°.

SCALE 1:50

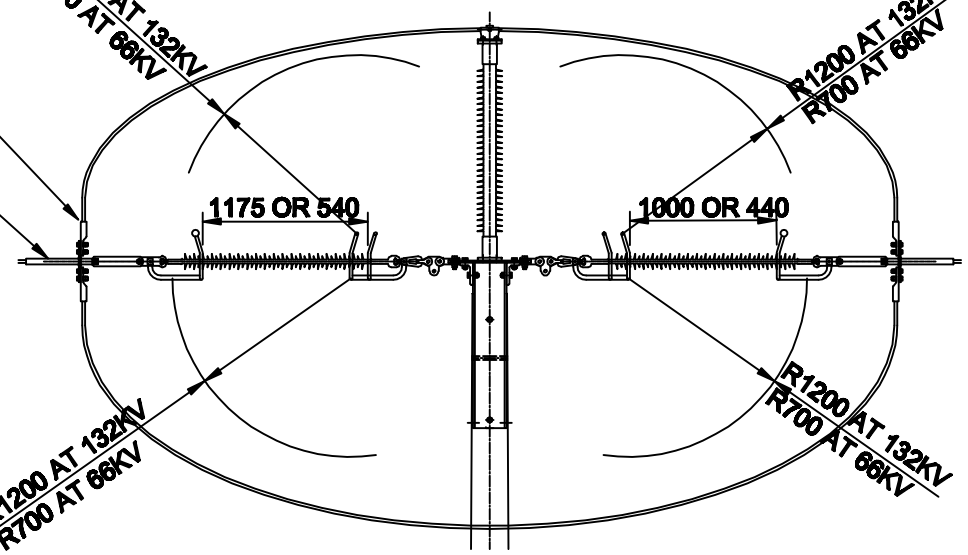

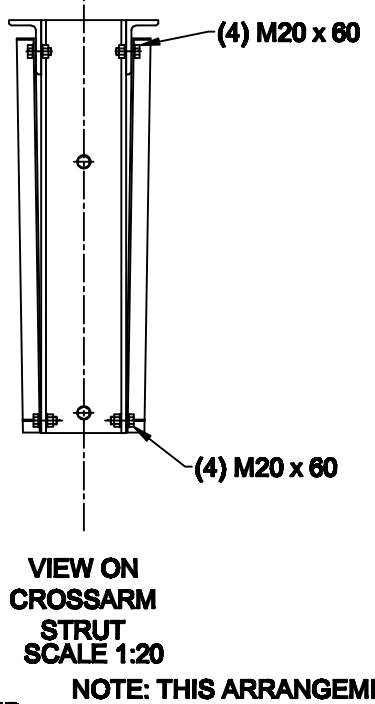

VIEW ON CROSSARM STRUT
SCALE 1:20

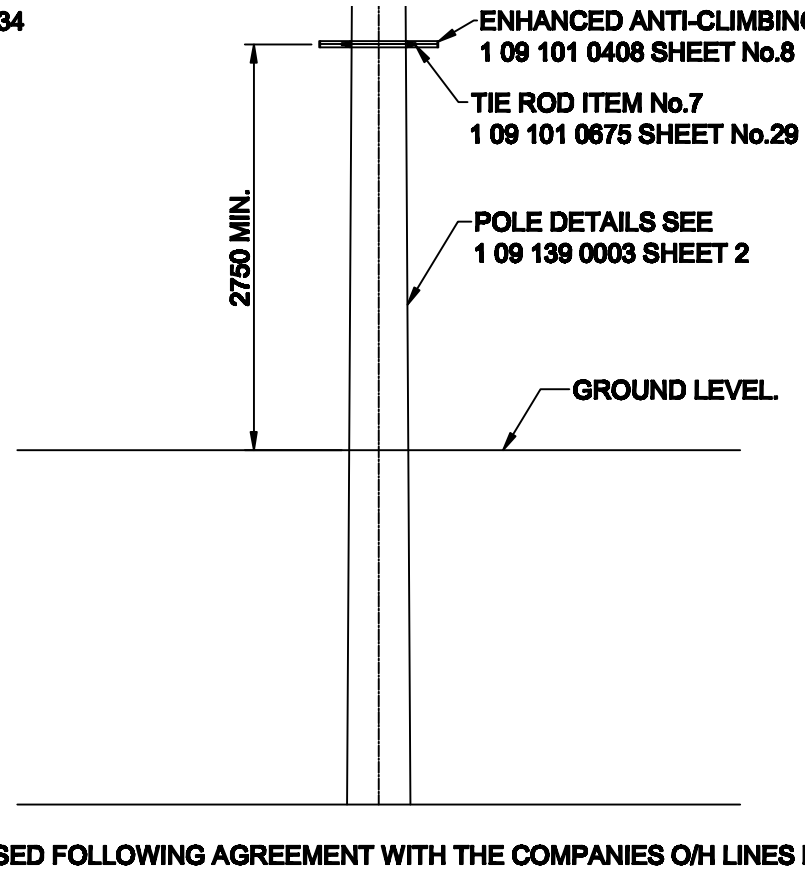

NOTE: THIS ARRANGEMENT IS ONLY TO BE USED FOLLOWING AGREEMENT WITH THE COMPANIES O/H LINES MANAGER

NOTES:
1. ALL STEELWORK FIXINGS BOLTS TO BE COMPLETE WITH 1 ROUND WASHER UNDER BOLT HEAD & 1 ROUND WASHER UNDER NUT, UNLESS STATED OTHERWISE. WHERE A CHANNEL IS USED A 5° TAPER WASHER SHOULD BE FITTED TO LEGS ONLY.
2. FOR DETAIL DRAWINGS PREFIXED 43 REFER TO E.S.I. DRAWINGS FOR OTHER DETAIL DRAWINGS REFER TO 1.09.101.0675 SERIES.
3. ARCING HORN GAPS TO BE SET 1000 FOR APPROACH & 1175 FOR NORMAL CONDITIONS ie 132kV. (THE ALTERNATIVE VALUES ARE SHOWN FOR 66KV OPERATION)

CE Electric UK

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details	
Sheet No. 1	Scale 1:50
Prepared By Pauline.Moore	
Revised 06/05/10	Grid Reference
Date Issued 02/07/07	Checked By G HAMMEL

132KV OVERHEAD LINES
DEVIATION 40 DEGREES - 60 DEGREES
USING COMPRESSION TERMINALS

Type OVERHEAD — DOCUMENT_SUB_CLASS

Ref No. C949731 — Historic Drg.No. 1091390015

Revision F — Notes