

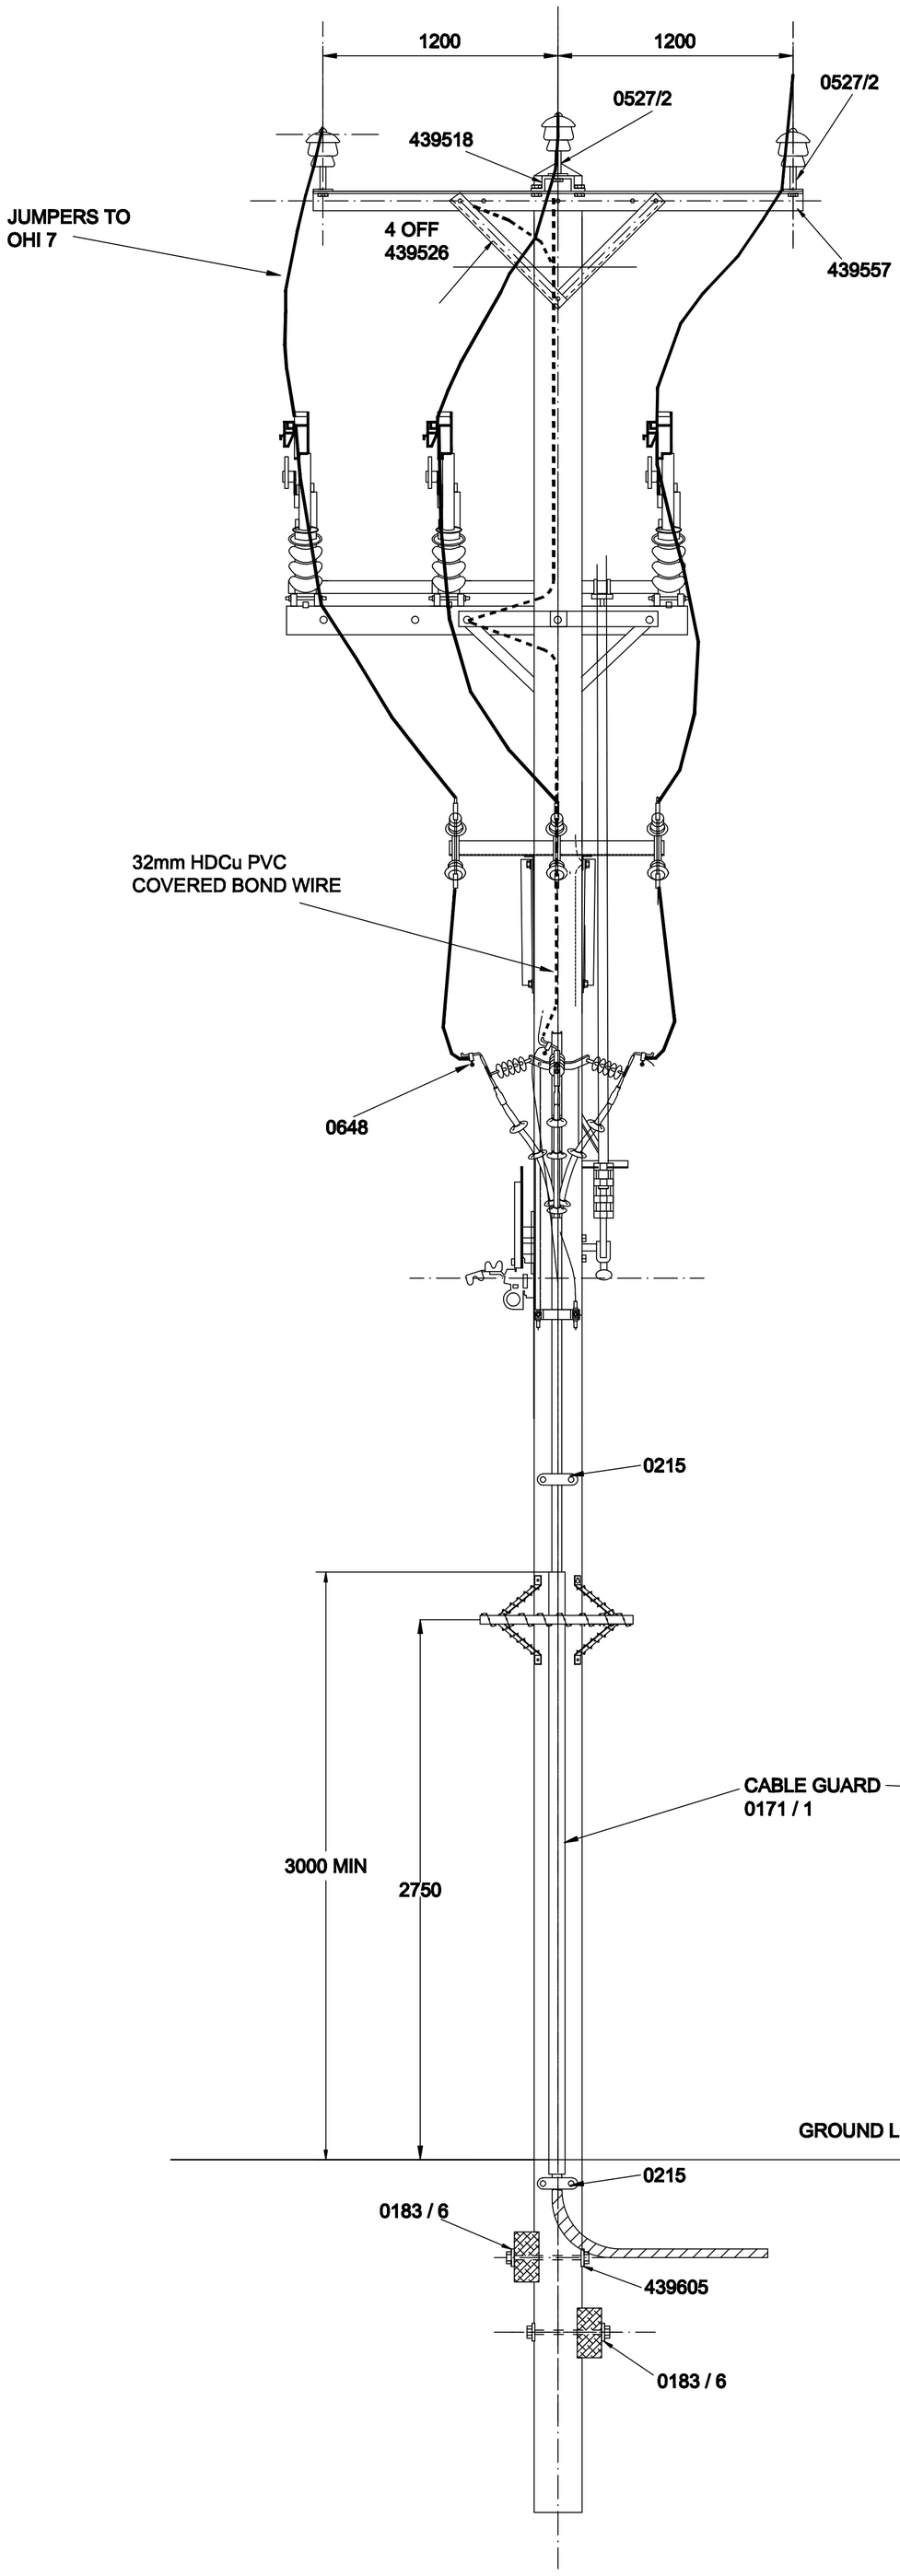


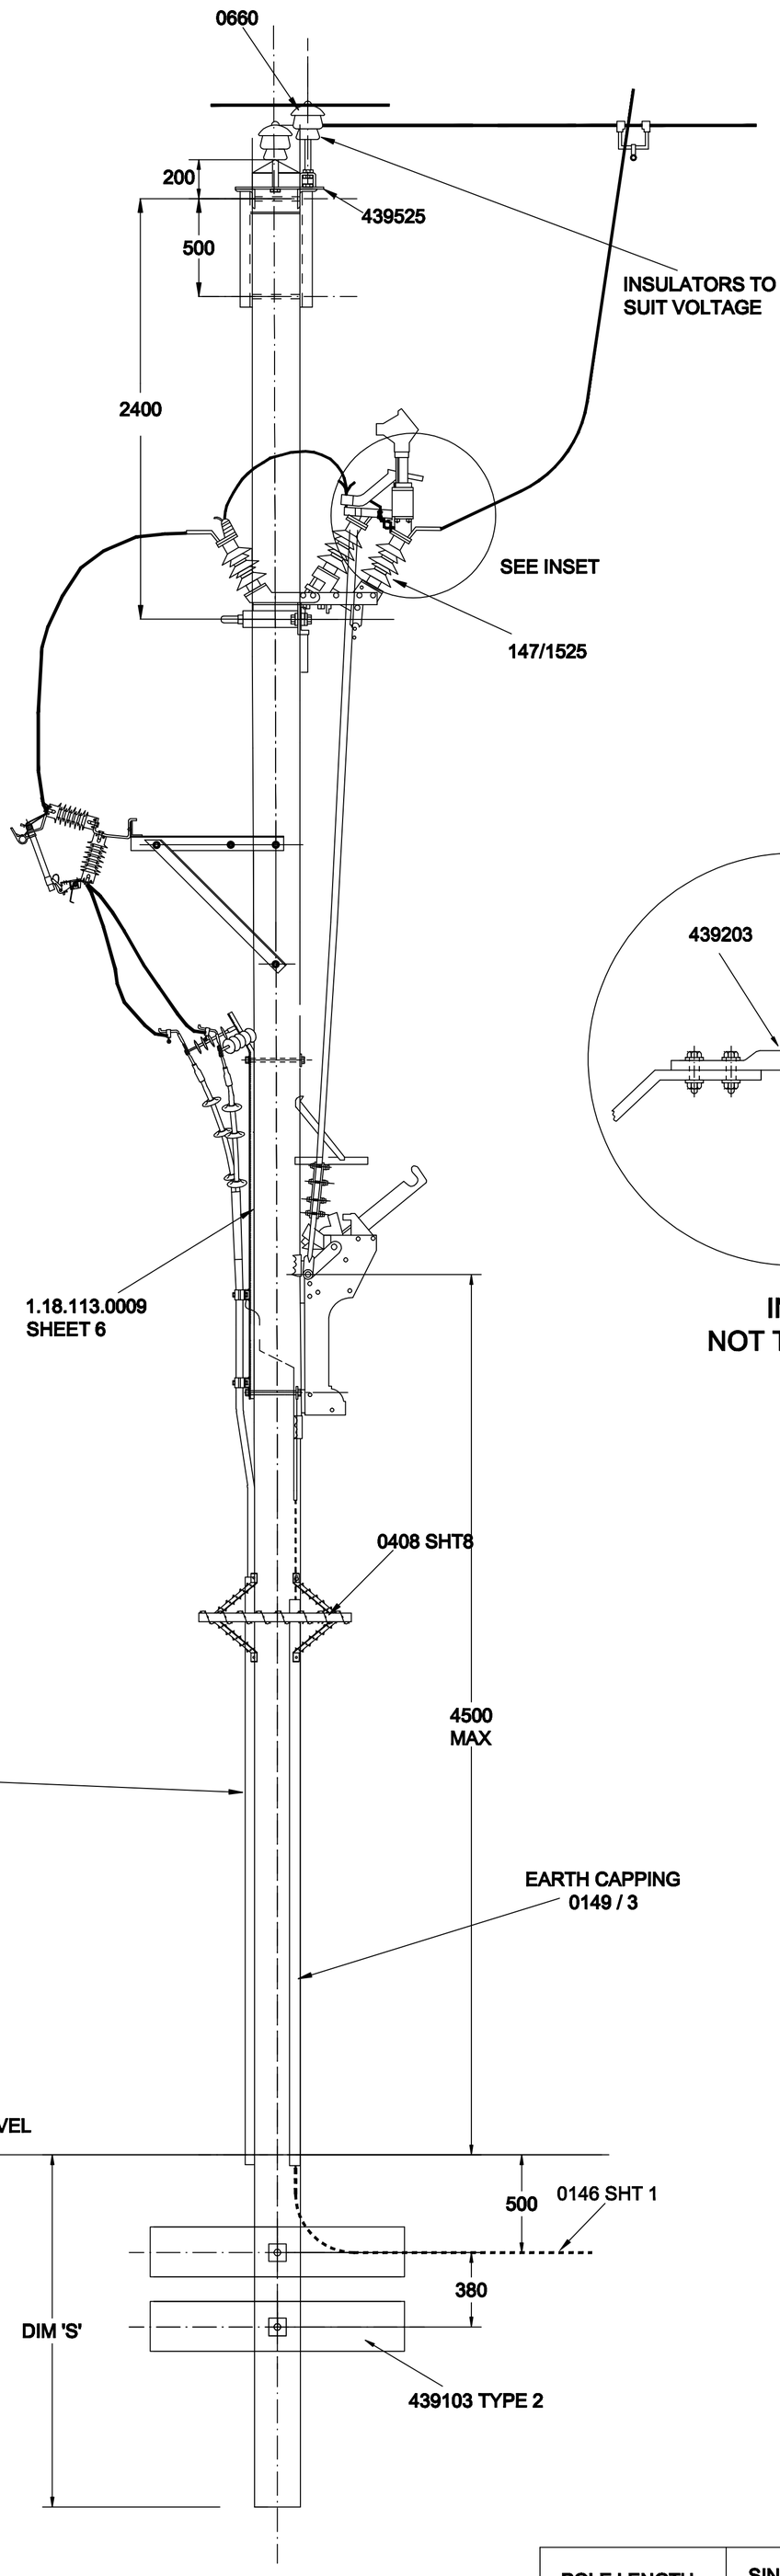

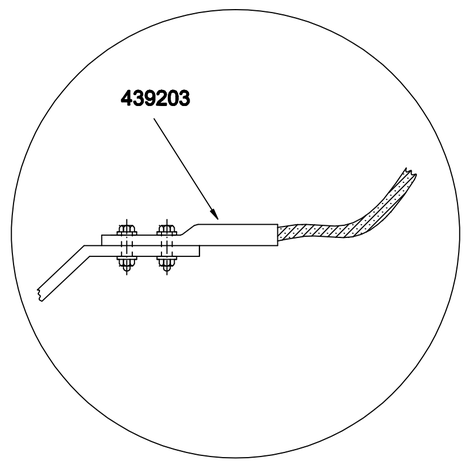

INSET
NOT TO SCALE

POLE LENGTH (m)	SINKING DEPTH DIM 'S' (m)
11.5 TO 12.0	1.9
13.0 TO 14.0	2.1
15.0	2.4

NOTES

1. ALL POLE BOLTS TO BE M20
2. FOR GENERAL EARTHING ARRANGEMENT SE E.I.E.500
3. MINIMUM HEIGHT OF POLE 11.0m OVERALL
4. AT ROAD CROSSING SUPPORTS MINIMUM LINE CONDUCTOR REGULATION CLEARANCE MUST BE PROVIDED TO THE LOWEST JUMPER CONDUCTOR
5. DETAIL DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS. OTHER DETAIL DRAWINGS REFER TO 1.09.101..... SERIES

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

CE Electric UK
Manufacturer Details

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

11KV, 20KV ARRANGEMENT FOR INTERMEDIATE POLE WITH ABSD, FUSE ISOLATORS AND CABLE TERMINATIONS

Sheet No. 5	Scale 1:20
Prepared By Janis.Webb	
Revised 31/01/07	Grid Reference
Date Issued 05/01/06	Checked By S.SALKELD

Type OVERHEAD POLES

Ref No. C406538 Historic Drg.No. 1091100932

Revision D Notes