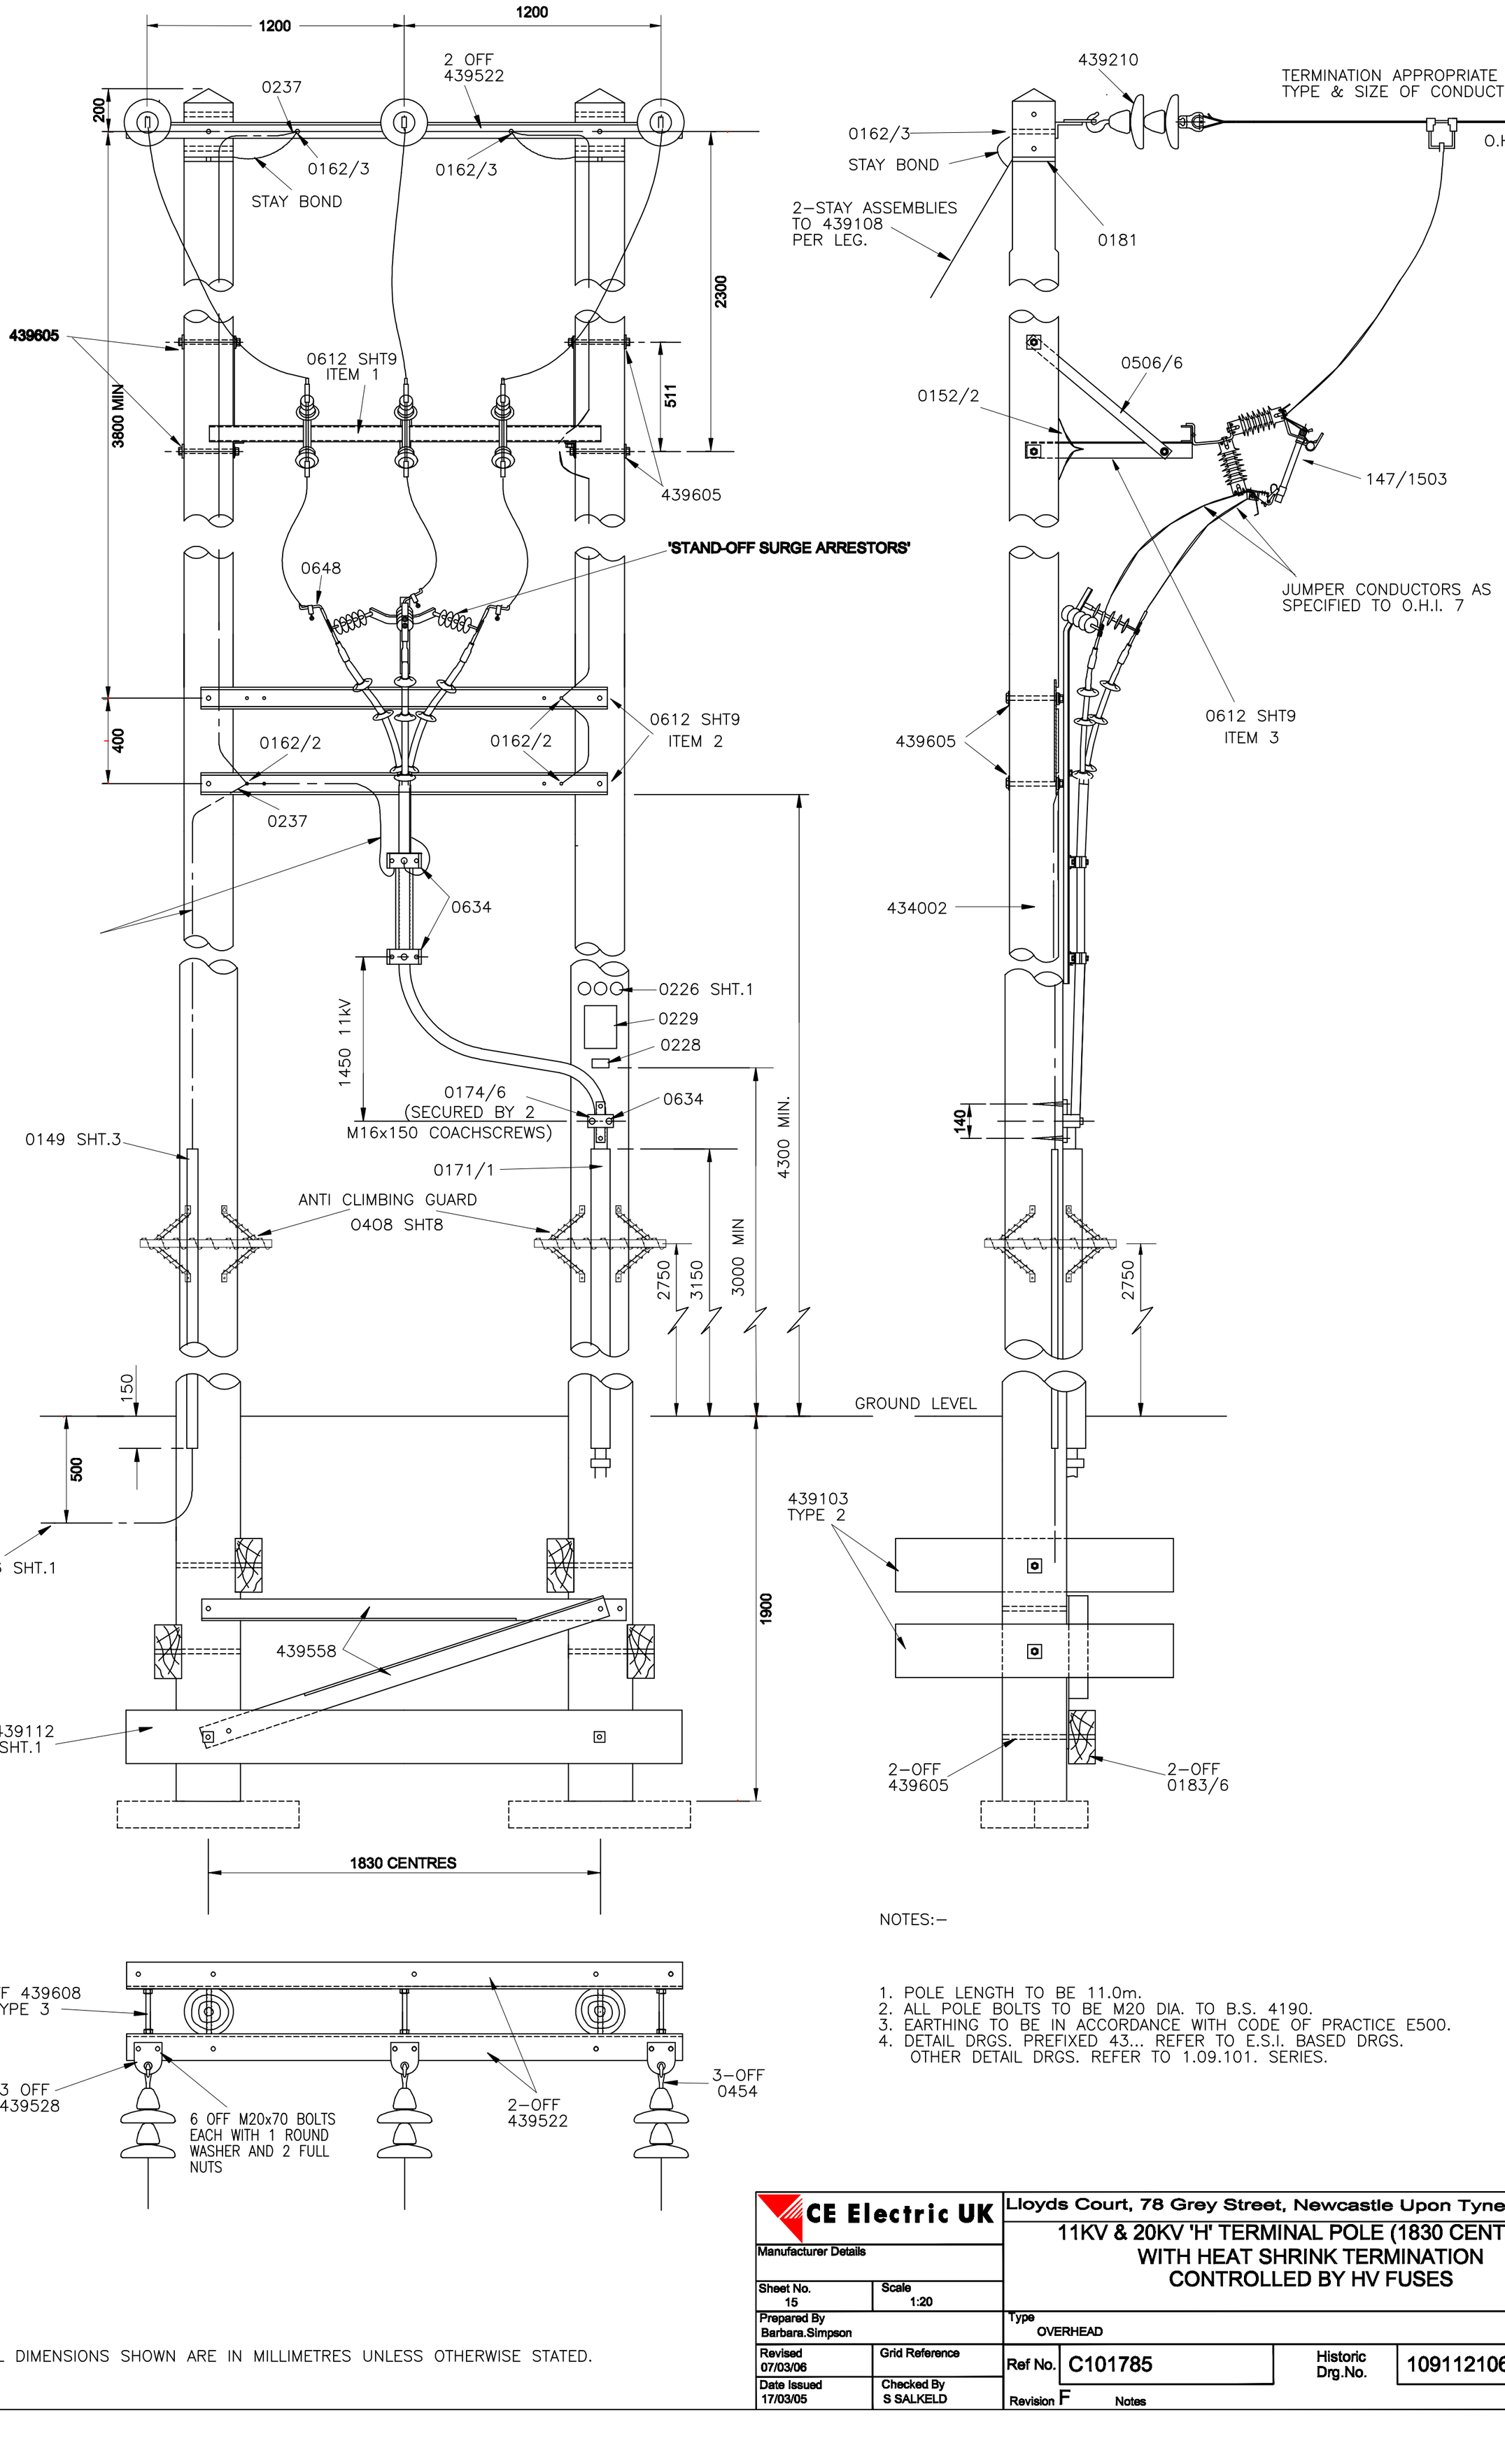


NOTES:-

1. POLE LENGTH TO BE 11.0m.
2. ALL POLE BOLTS TO BE M20 DIA. TO B.S. 4190.
3. EARTHING TO BE IN ACCORDANCE WITH CODE OF PRACTICE E500.
4. DETAIL DRGS. PREFIXED 43... REFER TO E.S.I. BASED DRGS.
 OTHER DETAIL DRGS. REFER TO 1.09.101. SERIES.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF
Manufacturer Details		11KV & 20KV 'H' TERMINAL POLE (1830 CENTRES) WITH HEAT SHRINK TERMINATION CONTROLLED BY HV FUSES
Sheet No. 15	Scale 1:20	
Prepared By Barbara.Simpson		Type OVERHEAD
Revised 07/03/06	Grid Reference	Ref No. C101785 — Historic Drg.No. 1091121069
Date Issued 17/03/05	Checked By S SALKELD	Revision F Notes