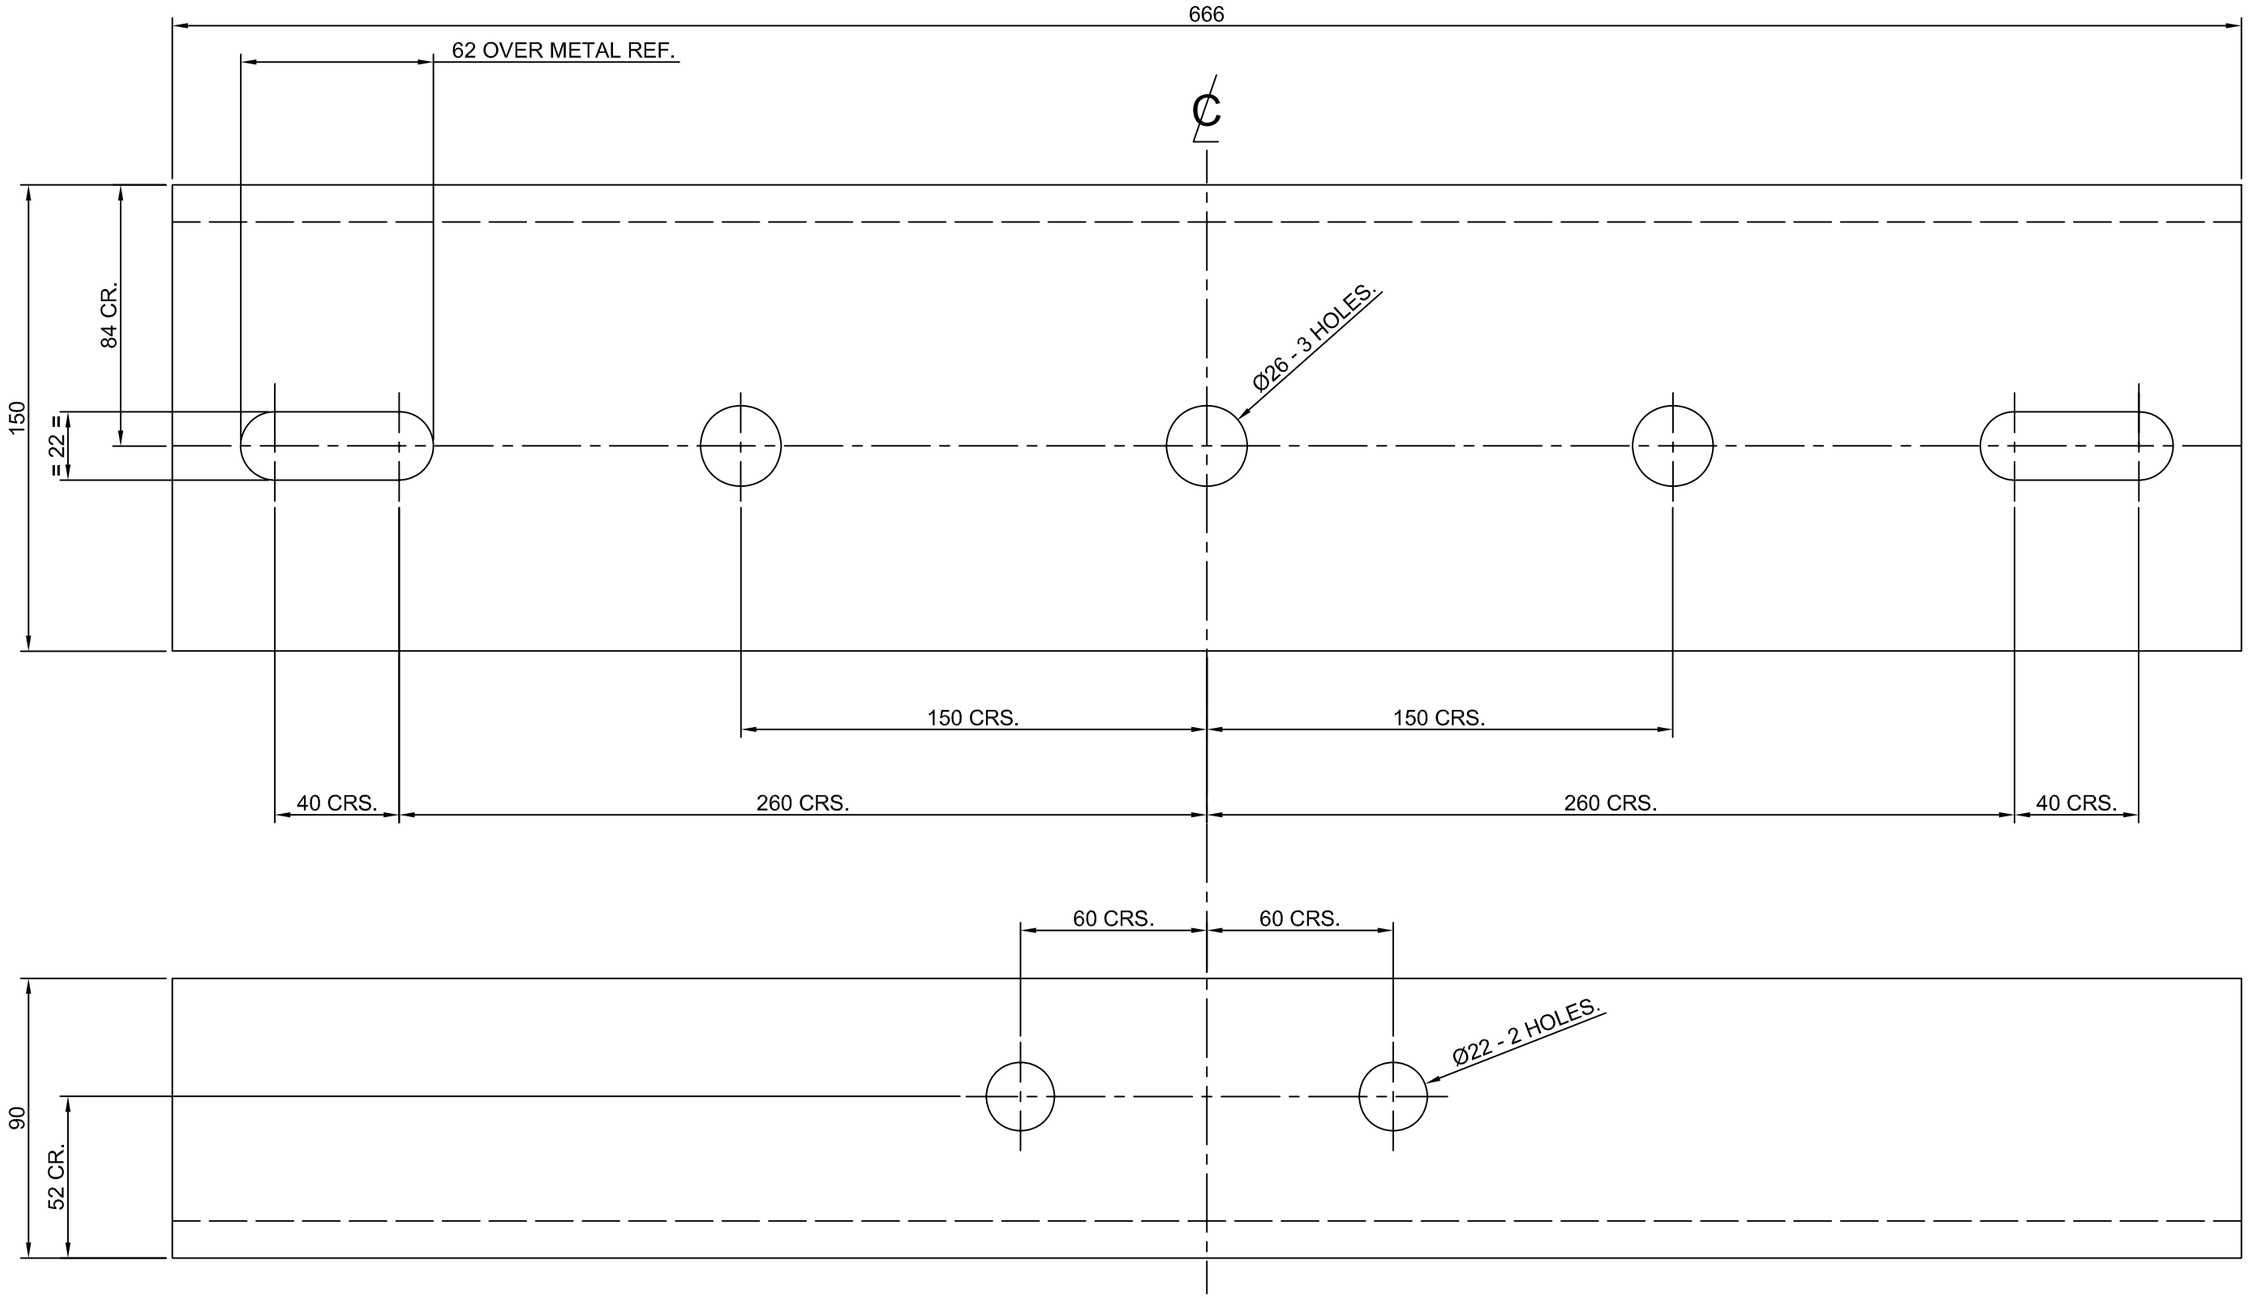


ITEM 7. 666 LONG x 150 x 90 x 12 THICK M.S. UNEQUAL ANGLE.

NOTES:-
1. STEELWORK TO B.S. 4360, GRADE 43A & B.S. 449
2. SECTIONS TO B.S. 4, PART 1, FLATS TO B.S. 6722
3. ALL BURRS TO BE REMOVED.
4. GALVANIZING TO ISO 1461 AFTER FABRICATION.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF
Manufacturer Details		132kV OVERHEAD LINES 125kN TENSION INSULATOR SET SHORT CROSSARM FOR IN-LINE STOUT POLES TEST RIG
Sheet No. 7	Scale 1:2	
Prepared By TREVOR R. WILKIN		Type OVERHEAD DOCUMENT_SUB_CLASS
Revised	Grid Reference	Ref No. 62470B Historic Drg.No. SKETCH No.33
Date Issued 17/3/2006	Checked By	Revision Notes