


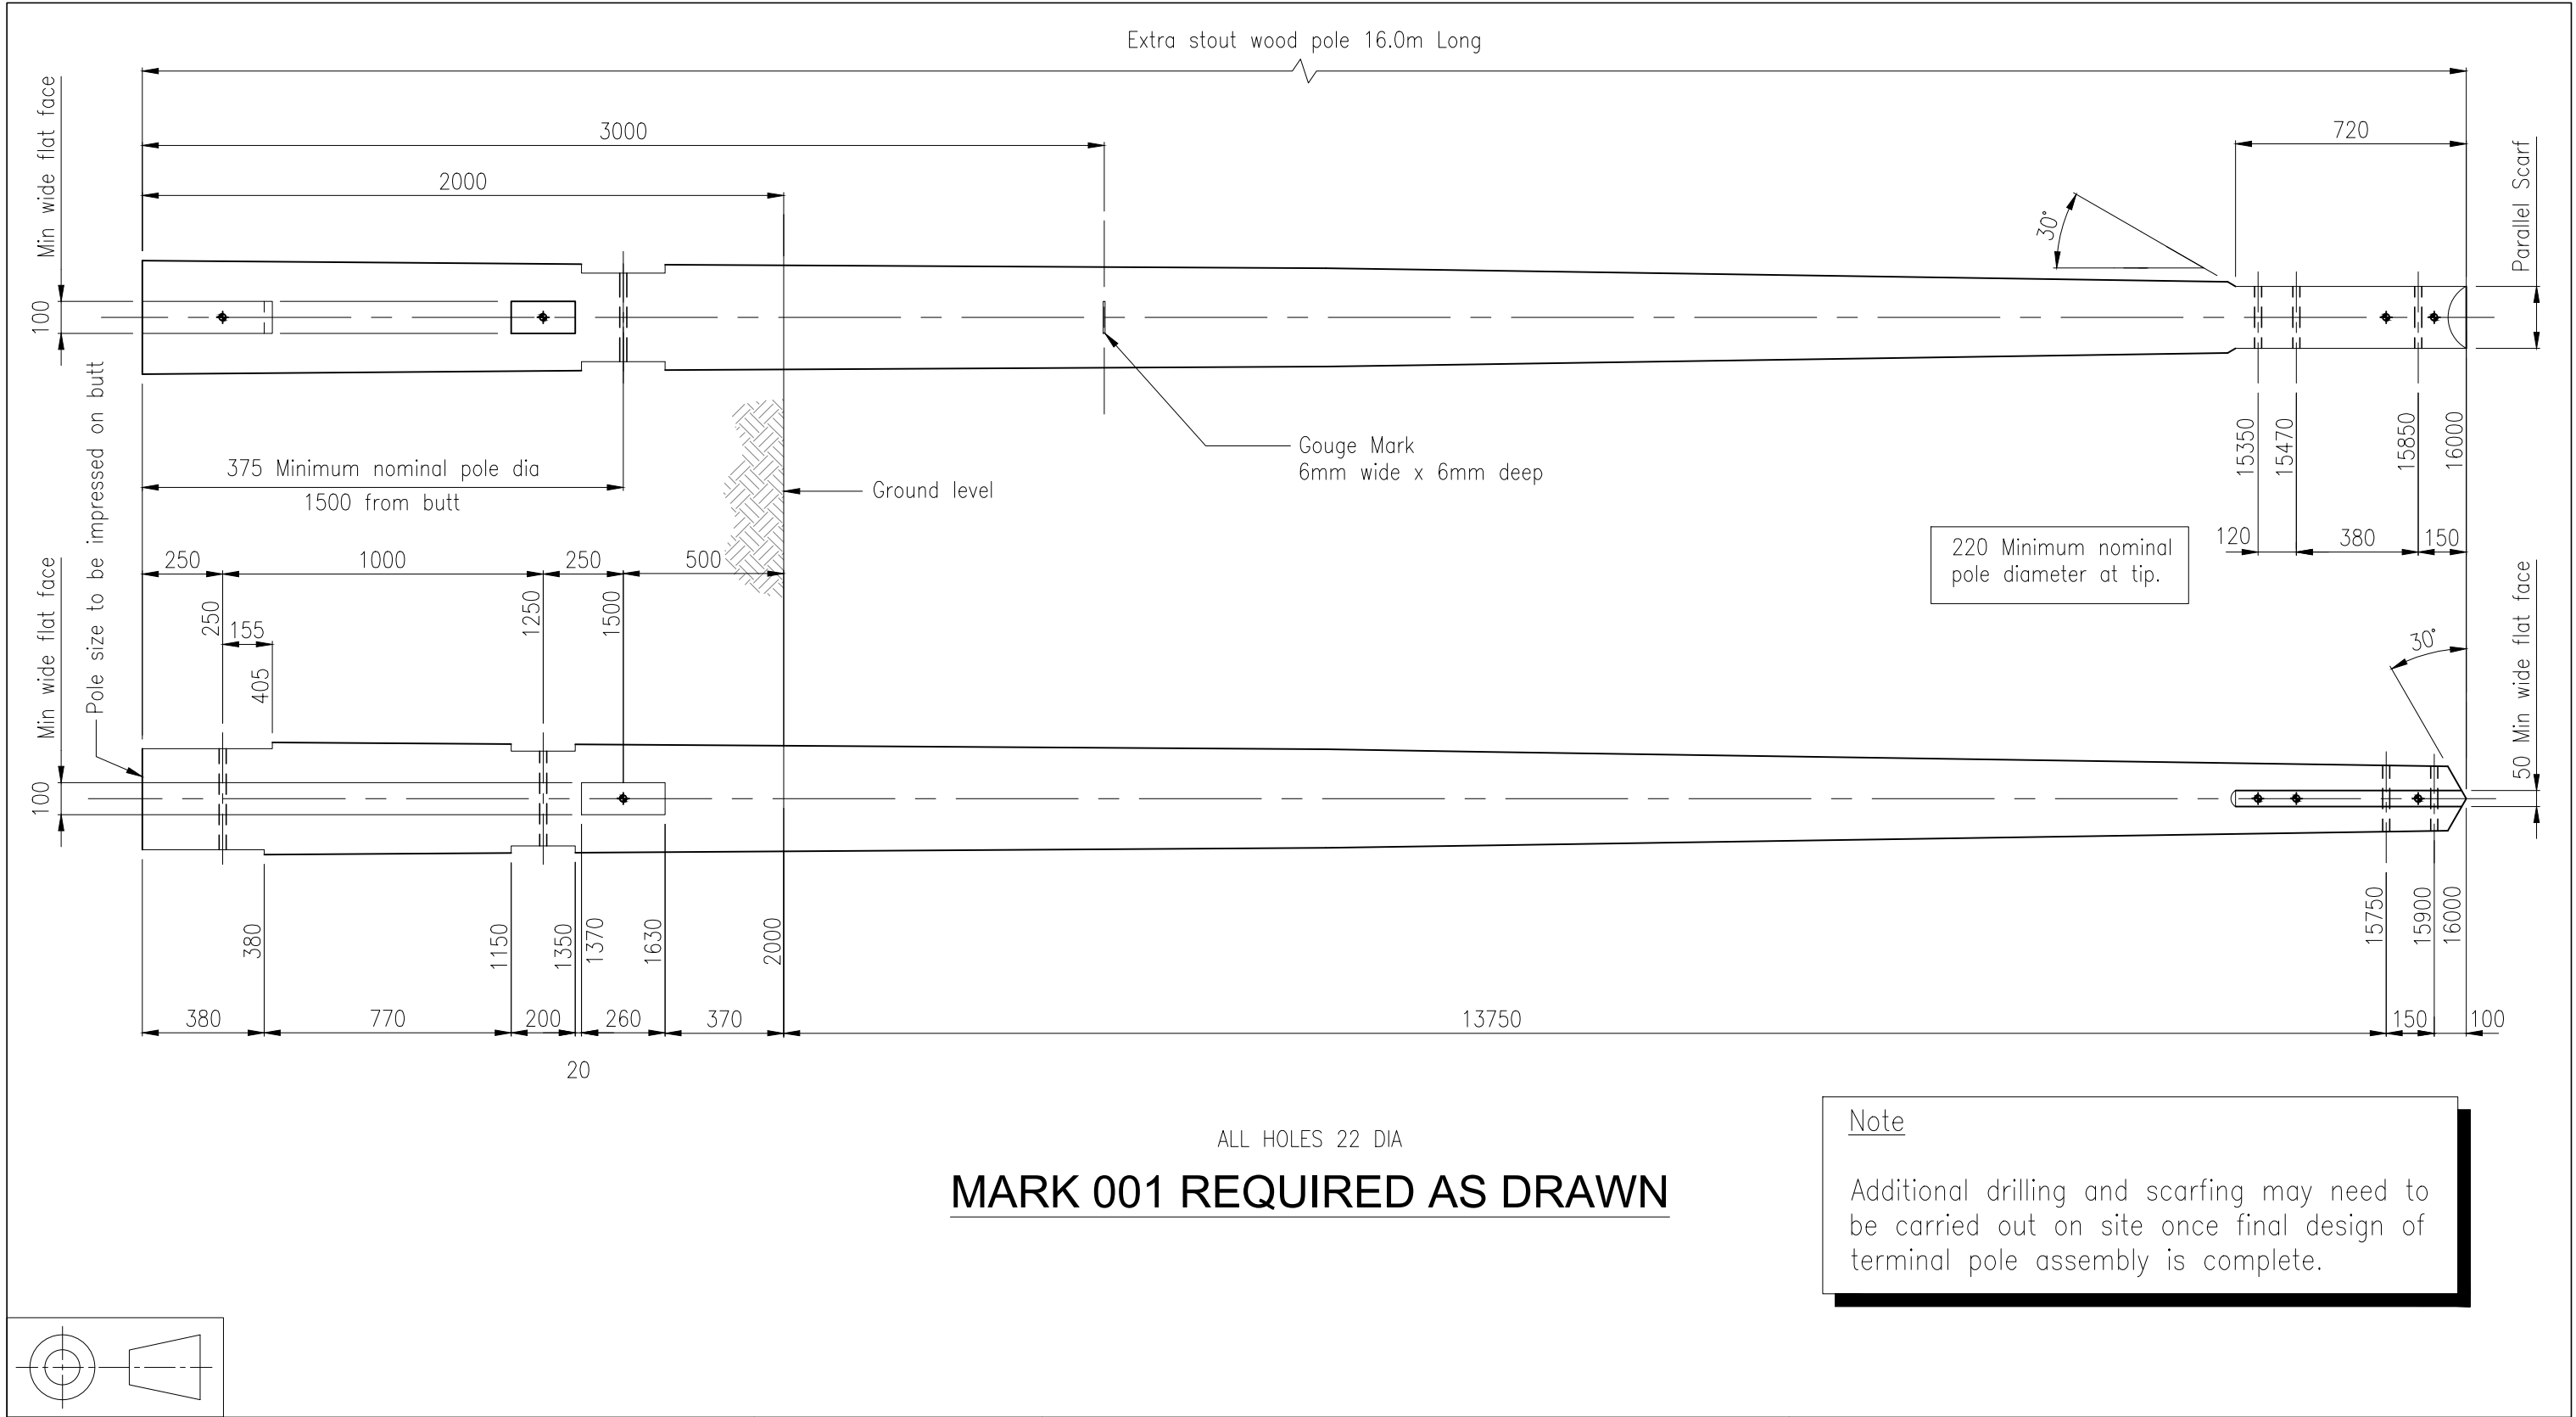


ALL HOLES 22 DIA

MARK 001 REQUIRED AS DRAWN

Note

Additional drilling and scarfing may need to be carried out on site once final design of terminal pole assembly is complete.



Notes 1. All dimensions in millimetres, unless otherwise noted. 2. All fabrication shall be in accordance with the requirements of ENA TS 43-125 Issue 2. 3. Wood poles shall be supplied and fabricated in accordance with BS EN 14229 and ENATS 43-88 Parts 1 & 2.			BOLT HOLES (Other holes as noted) ● 17.5 Dia Holes For M16 Bolts ⊕ 20.5 Dia Holes For 3/4" Bolts ● 21.5 Dia Holes For M20 Bolts ● 23.5 Dia Holes For M22 Bolts			TITLE Pole Piece Small Detail (PPS) For: 001 Pole Type: Terminal Pole Assembly. Description: Extra Stout Wood Pole.			Drawing status; ISSUED FOR CONSTRUCTION		
						ROUTE / CIRCUIT KETTERING - NORTHAMPTON 33 kV			ENERGYLINE PROJECT DRG No. 900M1024-35-001		
						CLIENT OMEXOM			SHT No. 1		
						CLIENTS DRG No.			No. of SHTS 1		
						CLIENTS PROJECT REF.			SCALE 1:20		
						CLIENTS DRG No.			ELEC FORM DWG		
						1			SHT SIZE A3		