



11500 (STOUT)

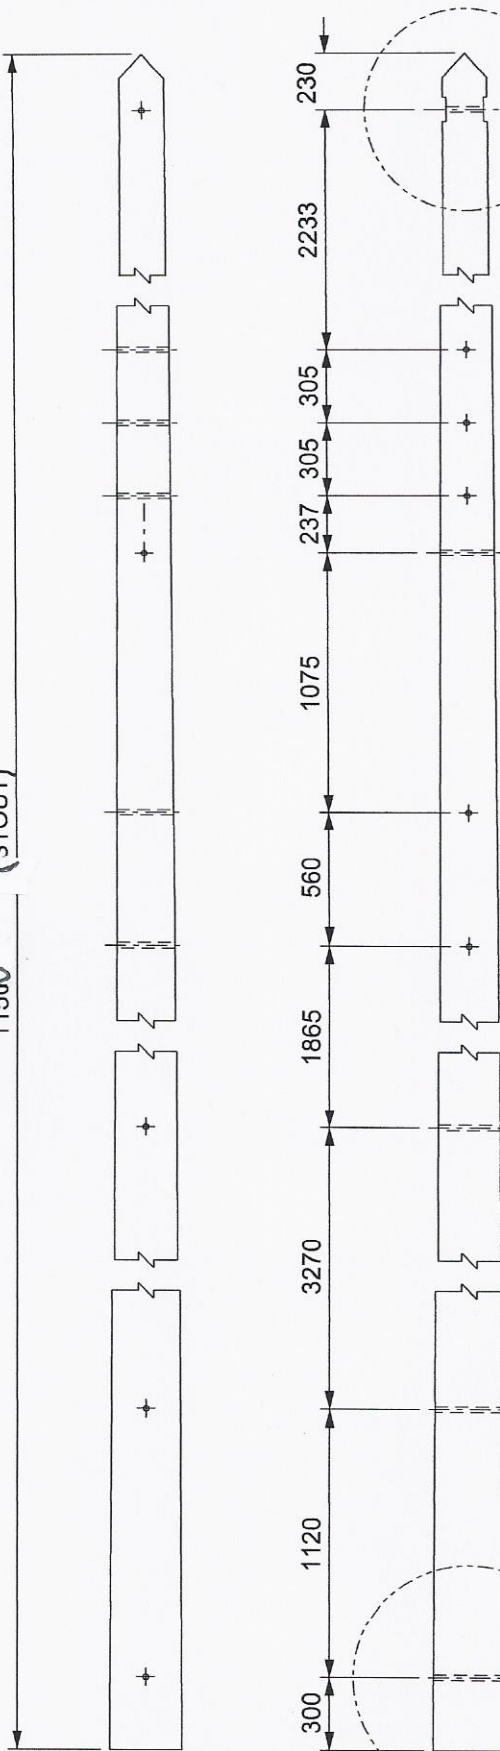

POLE SLOT ON BOTH SIDES
TO GIVE A 50mm WIDE FLAT FACE
AND THE ENDS CHAMFERED OFF
BEYOND THE LENGTH SHOWN
SCALE x 1.5

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
2. ALL HOLES ARE 22mm DIAMETER UNLESS NOTED OTHERWISE.
3. BOTH POLES FOR H-POLE SECTION STRUCTURE AS SHOWN IN LSTC DRAWING No. 15_14383_03 ARE IDENTICAL.
4. POLE SIZE AND INSPECTOR'S STAMP TO BE IMPRESSED ON POLE BUTT.

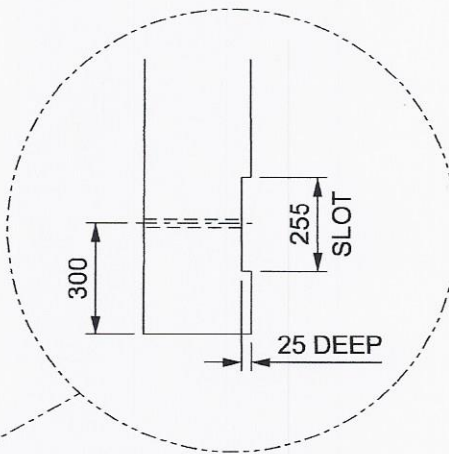

BRACE BLOCK SLOT
SCALE x 1.5

Drawing Revised By
S. Burns 18/9/15
11.5m Stout Required

WARNING: DRAWING MAY BE REDUCED. DO NOT SCALE.

REV A	Date 24/09 2014	Drwn DEC	Chkd -	Appd -	REV	Date	Drwn	Chkd	Appd	DATE	24/09/14	 Scottish and Southern Energy Power Distribution	LSTC Drawing Number 18_14383_04	SHT NO 1	REV NO A
REV	Date	Drwn	Chkd	Appd	REV	Date	Drwn	Chkd	Appd	DRAWN	DEC				
										CHECKED	RF				
										APPROVED	SP				
												Title: POLE DRILLING AND SCARFING DETAIL FOR 33kV H TERM POLE WITH ABSD AND CABLE TERM (11.5m POLE) Location: BERRY COURT SCALE: 1:30 @ A4 Drawing Status: FOR APPROVAL			

Project Number --