

DO NOT SCALE THIS DRAWING. IF IN DOUBT ASK

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING




DOCUMENT REFERENCE:

NOTES:-

- ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0037,0038 & 0039.
- PRELIMINARY SUBJECT TO LOAD AND STRENGTH STUDIES, FINAL ROUTE ALIGNMENT, MICROSITING AND GROUND CONDITIONS.
- ALL BOLTED CONNECTIONS ABOVE GROUND LEVEL SHALL BE FITTED WITH A LOCK NUT.
- ALL UNUSED POLE DRILLINGS SHALL BE SEALED WITH A HARDWOOD PLUG. (ENA TS 43-88 ANNEX C)

ITEM	ENATS STD DRG No. or BS. Ref.	DESCRIPTION	SECTION SIZE	LENGTH	QUANTITY	UNIT WEIGHT (kg)	WEIGHT (kg)	REMARKS
1	200 1109 0040	INTERMEDIATE CROSSARM	150x90x12 RSA	5300	2	114.061	228.122	REFER TO DRAWING 90SS906-PPS-001
2		POST INSULATOR AND CONDUCTOR CLAMP	-	-	3			PERFORMANCE COMPLIANT WITH SSE-NET-TGN 506
3	200 1109 0052	WOOD POLE	EXTRA STOUT	VARIES	1			
4	200 1109 0053	WOOD POLE	EXTRA STOUT	VARIES	1			
5	200 1109 0041	INSULATOR MOUNTING PLATE	235x12 THICK PLATE	400	3	8.855	26.565	
6	200 1109 0042	CROSSARM SUPPORT CHANNEL	200x75x23 PFC	1180	2	27.612	55.224	
7	439701	DANGER PLATE	-	-	2	0.001	0.001	TO BE APPLIED ON FACE OF POLE LIKELY TO BE ACCESSED
8		NOT USED						
9	200 1109 0054	TYPE 3, or 4 TOP BAULK (26 DIA HOLE)	250min x 125min	1500/2500	VARIES			
10	439112	TYPE 2, BRACE BAULK	300 x 150	3000	1			
11	439545	'H' POLE FOUNDATION BRACE	125x75x8 RSA	3000	2	36.246	72.492	
12	439604	SQUARE FLAT WASHER (22 DIA HOLE)	65x6 THICK PLATE	65	3	0.181	0.543	
13	439605	SQUARE CURVED WASHER (22 DIA HOLE)	65x6 THICK BENT PLATE	65	12	0.178	2.136	
14	ESI. 43-96	M20 GRADE 8.8 BOLT	M20 (46mm THREAD LENGTH)	60	21	0.287	6.027	
15	ESI. 43-96	M20 GRADE 8.8 BOLT	M20 (46mm THREAD LENGTH)	80	18	0.337	6.066	INSULATORS TO MOUNTING PLATES
16	ESI. 43-96	M20 GRADE 8.8 BOLT	M20	375	4	1.064	4.256	CROSSARM SUPPORTS TO POLE
17	ESI. 43-96	M20 GRADE 8.8 BOLT	M20	590	2	1.594	3.188	
18	ESI. 43-96	M20 GRADE 8.8 BOLT	M20	350	4	1.002	4.008	
19	ESI. 43-96	M20 GRADE 8.8 BOLT	M20	300	8	0.879	7.032	
20	439554	EARTHING ATTACHMENT NUT	34 DIA HEAVY DUTY TUBE	150	1	0.600	0.600	
21	439103	TYPE 1, STAY BLOCK	250min x 125min	850	2			
22	200 1109 0079	ADSS CLAMP (TYPICAL ASSEMBLY)	WELDED ASSEMBLY		1	2.642	2.642	SUSPENSION POINT SHALL BE A MINIMUM OF A HORIZONTAL DISTANCE OF 175mm FROM POLE
23	200 1109 0048	BRACE ANGLE	80x80x8 RSA	3237	2	30.962	61.924	
24	200 1109 0055	RECTANGULAR WASHER PLATE	70X6	830	2	2.737	5.474	
25	200 1109 0049	FABRICATED TEE	180x12.5x100 TEE	450	4	10.892	43.568	
26	200 1109 0051	SQUARE CURVED WASHER (26 DIA HOLE)	90X12 THICK FLAT	90	VARIES	0.763		
27	ESI. 43-96	M24 GRADE 8.8 BOLT	M24	590	VARIES	2.329		
28	200 1109 0050	SQUARE FLAT WASHER (26 DIA HOLE)	90x12 THICK FLAT	90	VARIES	0.763		
29	ESI. 43-96	M24 GRADE 8.8 BOLT	M20	450	2	1.249	2.498	
30		ROUND WASHER			36			FOR FIXING OF POST INSULATOR
						TOTAL	532.366	



* NO ALLOWANCE IN THE QUANTITIES HAS BEEN MADE FOR SPARE BOLTS. ALL BOLTS TO BE SUPPLIED WITH PALNUTS UNLESS NOTED OTHERWISE. ITEM 15 TO SUIT INSULATOR SPECIFICATION, BOLT SIZE AND LENGTH TO BE CONFIRMED.

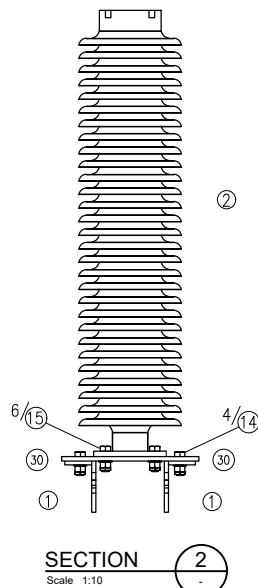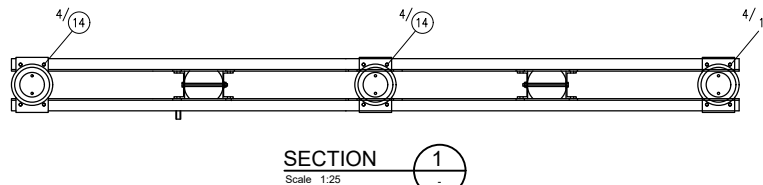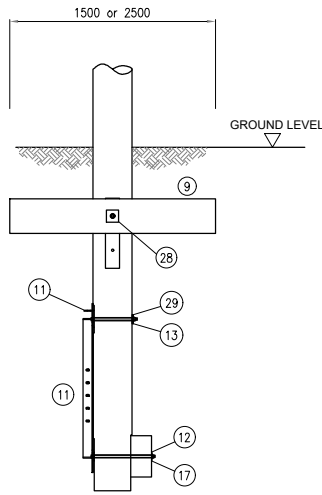

SECTION 3
Scale 1:25

SECTION 1
Scale 1:25

SECTION 2
Scale 1:10

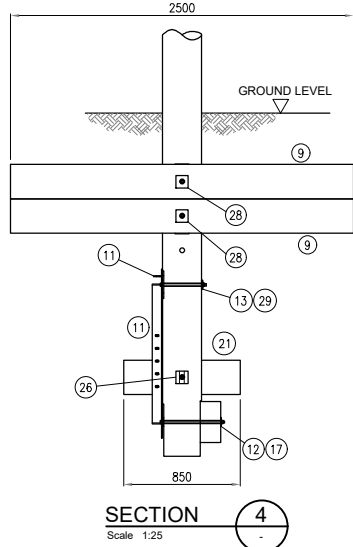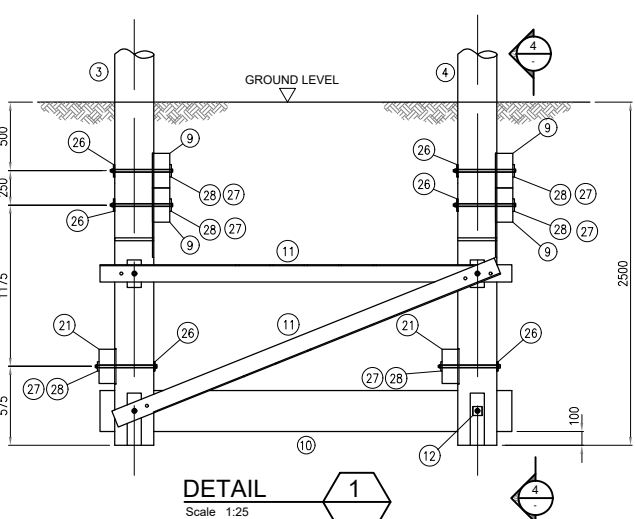

DETAIL 1
Scale 1:25

SECTION 4
Scale 1:25

ELEVATION

FOUNDATION BAULKS FOR GRADE 3 & 4 SOIL CONDITIONS ONLY
REFER TO DETAIL 1 FOR GRADE 2 SOIL CONDITIONS

FOUNDATION BAULKS REQUIRED FOR GRADE 2 SOIL CONDITIONS ONLY

Date Plotted: 18.09.2020

File Name: David Borrie small piece 2020 07 21.dwg

Rev:	Drawn: PF	Approved: SA	Description:
01	Checked: DB	Date: 18-09-20	ISSUED FOR INFORMATION
 Scottish & Southern Electricity Networks			
SSE Inverlmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: INTERMEDIATE 'H' POLE ASSEMBLY 132kV WOOD POLE OHL			
Drawing Status: For Information			Drawn: PF
Scale: NTS			Checked: DB
Date: 12.01.20			Approved: SA
Drawing Number: 200_1109_0033			Sheet No: 00
			Revision No: 01