

DO NOT SCALE THIS DRAWING. IF IN DOUBT ASK

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:


NOTES:-

- ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0037,0038 & 0039
- PRELIMINARY SUBJECT TO LOAD AND STRENGTH STUDIES, FINAL ROUTE ALIGNMENT, MICROSITING AND GROUND CONDITIONS.
- ALL BOLTED CONNECTIONS ABOVE GROUND LEVEL SHALL BE FITTED WITH A LOCK NUT.
- ALL UNUSED POLE DRILLINGS SHALL BE SEALED WITH A HARDWOOD PLUG (ENA TS 43-88 ANNEX C)

ELEVATION ON OPTIONAL TRUSSING TACKLE SET

Required on 'H' poles 12.0m long and above and all poles with an angle of deviation of 20° or greater.
(Trussing tackle set supplied by BB Price Ltd. Part Reference Number H351/006.)


SECTION 3
Scale 1:10




DETAIL 1
Scale 1:25

Alternative arrangement for grade 2 soil refer to drawings 90SS906-PGA-006 & 007


SECTION 1
Scale 1:25

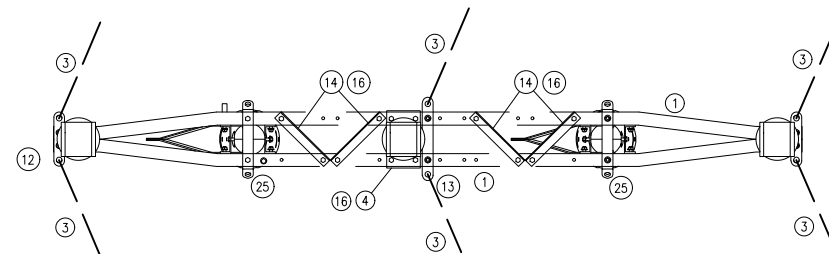

SECTION 4
Scale 1:25

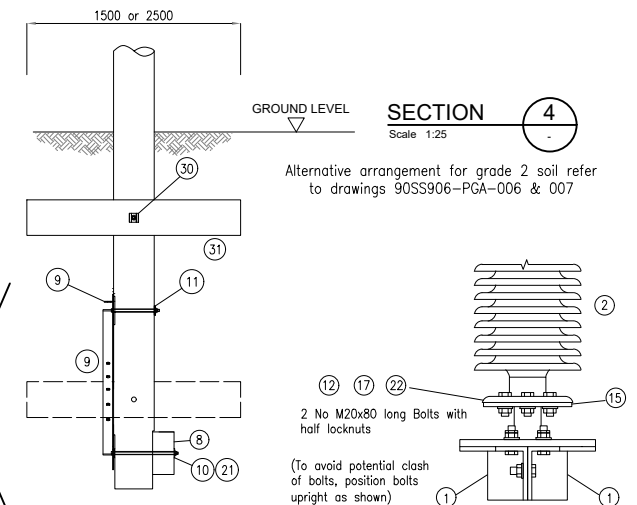

SECTION 2
Scale 1:10

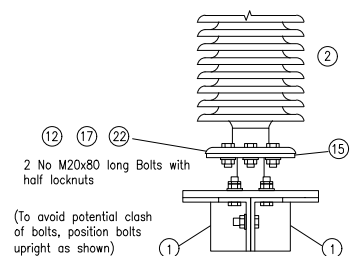

ITEM	ESI, STD, DRG No. or BS. Ref	DESCRIPTION	SECTION SIZE	LENGTH	QUANTITY	UNIT WEIGHT (kg)	WEIGHT (kg)	REMARKS
1	200 1109 0043	ANGLE CROSSARM	150x90x12 RSA	5262	2	113.245	226.490	
2	ENATS 43-93	POST INSULATOR AND CONDUCTOR CLAMP	-	-	3	-	-	CLAMP NOT SHOWN
3	ENATS 43-93	TENSION INSULATORS AND FITTINGS	-	-	6 SETS	-	-	
4	200 1109 0042	INSULATOR MOUNTING PLATE	235x12 THICK PLATE	400	1	8.855	8.855	
5	200 1109 0042	CROSSARM SUPPORT CHANNEL	200x75x23 PFC	1180	4	27.612	110.448	
6	439701	DANGER PLATE	-	-	2	0.001	0.001	
7	200 1109 0047	WOOD POLE	EXTRA STOUT	VARIES	2	-	-	
8	439112	TYPE 2, BRACE BAULK	300 x 150	3000	1	-	-	
9	439545	'H' POLE FOUNDATION BRACE	125x75x8 RSA	3000	2	36.246	72.492	
10	439604	SQUARE FLAT WASHER (22 DIA HOLE)	65x6 THICK PLATE	65	3	0.181	0.543	
11	439605	SQUARE CURVED WASHER (22 DIA HOLE)	65x6 THICK BENT PLATE	65	4	0.178	0.712	
12	200 1109 0044	SHORT TYPE STRAP	75x20 THICK PLATE	380	2	4.475	8.950	
13	200 1109 0045	LONG TYPE STRAP	75x20 THICK PLATE	580	1	6.830	6.830	
14								
15	200 1109 0076	INSULATOR SUPPORT BRACKET	WELDED ASSEMBLY		2	7.106	14.212	
16	ENATS 43-96	M20 GRADE 8.8 BOLT	M20 (46mm THREAD LENGTH)	60	36	0.287	10.332	
17	ENATS 43-96	M20 GRADE 8.8 BOLT	M20 (46mm THREAD LENGTH)	80	28	0.337	9.436	INSULATORS TO MOUNTING PLATES & AS SHOWN
18	ENATS 43-96	M20 GRADE 8.8 BOLT	M20	350	2	1.064	2.128	CROSSARM SUPPORTS TO POLE
19	ENATS 43-96	M20 GRADE 8.8 BOLT	M20	300	6	0.879	5.274	
20	ENATS 43-96	M24 GRADE 8.8 BOLT	M20	450	2	1.249	2.498	
21	ENATS 43-96	M24 GRADE 8.8 BOLT	M20	590	2	1.594	3.188	
22	ENATS 43-96	M20 GRADE 8.8 NUT	M20 HALF LOCKNUT		10	0.029	0.290	
23	ENATS 43-96	M24 GRADE 8.8 BOLT	M24 (36mm THREAD LENGTH)	60	4	0.447	1.788	STAY STRAP CONNECTION
24	ENATS 43-96	M24 GRADE 8.8 BOLT	M24	590	VARIES	2.329		
25	200 1109 0077	20mm THICK STAY STRAP	65x20 THICK BENT PLATE	580	2	5.919	11.838	
26	439113	STAY STRAP (HEAVY DUTY)	65x8 THICK BENT PLATE	1011	2	8.254	16.508	
27	439554	EARTHING ATTACHMENT NUT	34 DIA HEAVY DUTY TUBE	150	1	0.6	0.600	ASSEMBLY CONSISTS OF EYE NUT,EYE BOLT, LOCKING NUT & 2 x SQUARE ROUND WASHER. REFER TO DRAWING AFL F/3307
28		EYE BOLT & EYE NUT ASSEMBLY	M20	285	1	2.0	2.0	
29	PPS-012	SQUARE CURVED WASHER (26 DIA HOLE)	90x12 THICK FLAT	90	VARIES	0.763		
30	PPS-011	SQUARE FLAT WASHER (26 DIA HOLE)	90x12 THICK FLAT	90	VARIES	0.763		
31	PPS-015	TYPE 3, or 4 TOP BAULK (26 DIA HOLE)	250min x 125min	1500/2500	VARIES			
32		ROUND WASHER (16mm HOLE)			24			
						TOTAL	515.288	

Date Plotted: 18.09.2020

File Name: David Borrie small piece 2020 07 21.dwg

Rev: 01	Drawn: PF Checked: DB	Approved: SA Date: 18-09-20	Description: ISSUED FOR INFORMATION
SSE Inverlorn House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: ANGLE POLE ASSEMBLY 132KV WOOD POLE DESIGN			
Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked: DB	
Date: 12.01.20		Approved: SA	
Drawing Number: 200_1109_0034		Sheet No: 00	Revision No: 01