

A


B

C

D

E

F

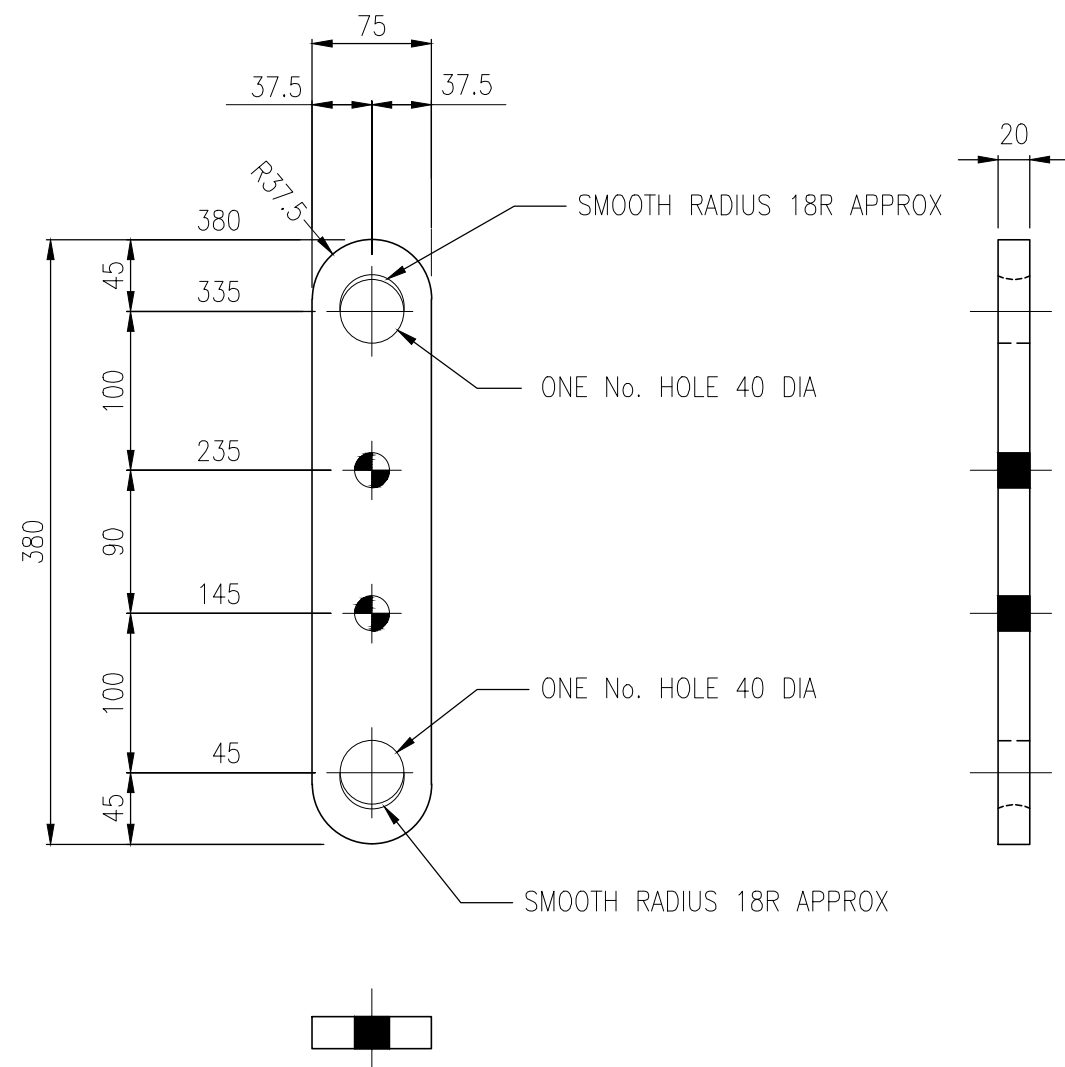

75x20 THICK PLATE x 380 LONG (GRADE S275JR)
ALL HOLES 22 DIA UNO

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY
RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. THIS DRAWING IS BASED ON ESI STANDARD 43-95 ISSUE 5 DECEMBER 1989, DRAWING 439543 AND HAS BEEN MODIFIED TO SUIT NEW METRIC PFC SECTION.
3. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 SECTION 11.
4. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025.
5. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
6. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2

Rev:	Drawn: PF	Approved: SA	Description:
01	Checked: DB	Date: 22-09-20	ISSUED FOR INFORMATION
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: 20mm THICK SHORT TYPE STRAP			
Drawing Status: For Information			Drawn: PF
Scale: NTS			Checked: DB
Date: 12.01.20			Approved: SA
Drawing Number: 200 1109 0044		Sheet No: 00	Revision No: 01

Date Plotted: 22.09.2020
File Name: David Borrie small piece 2020 07 21.dwg