


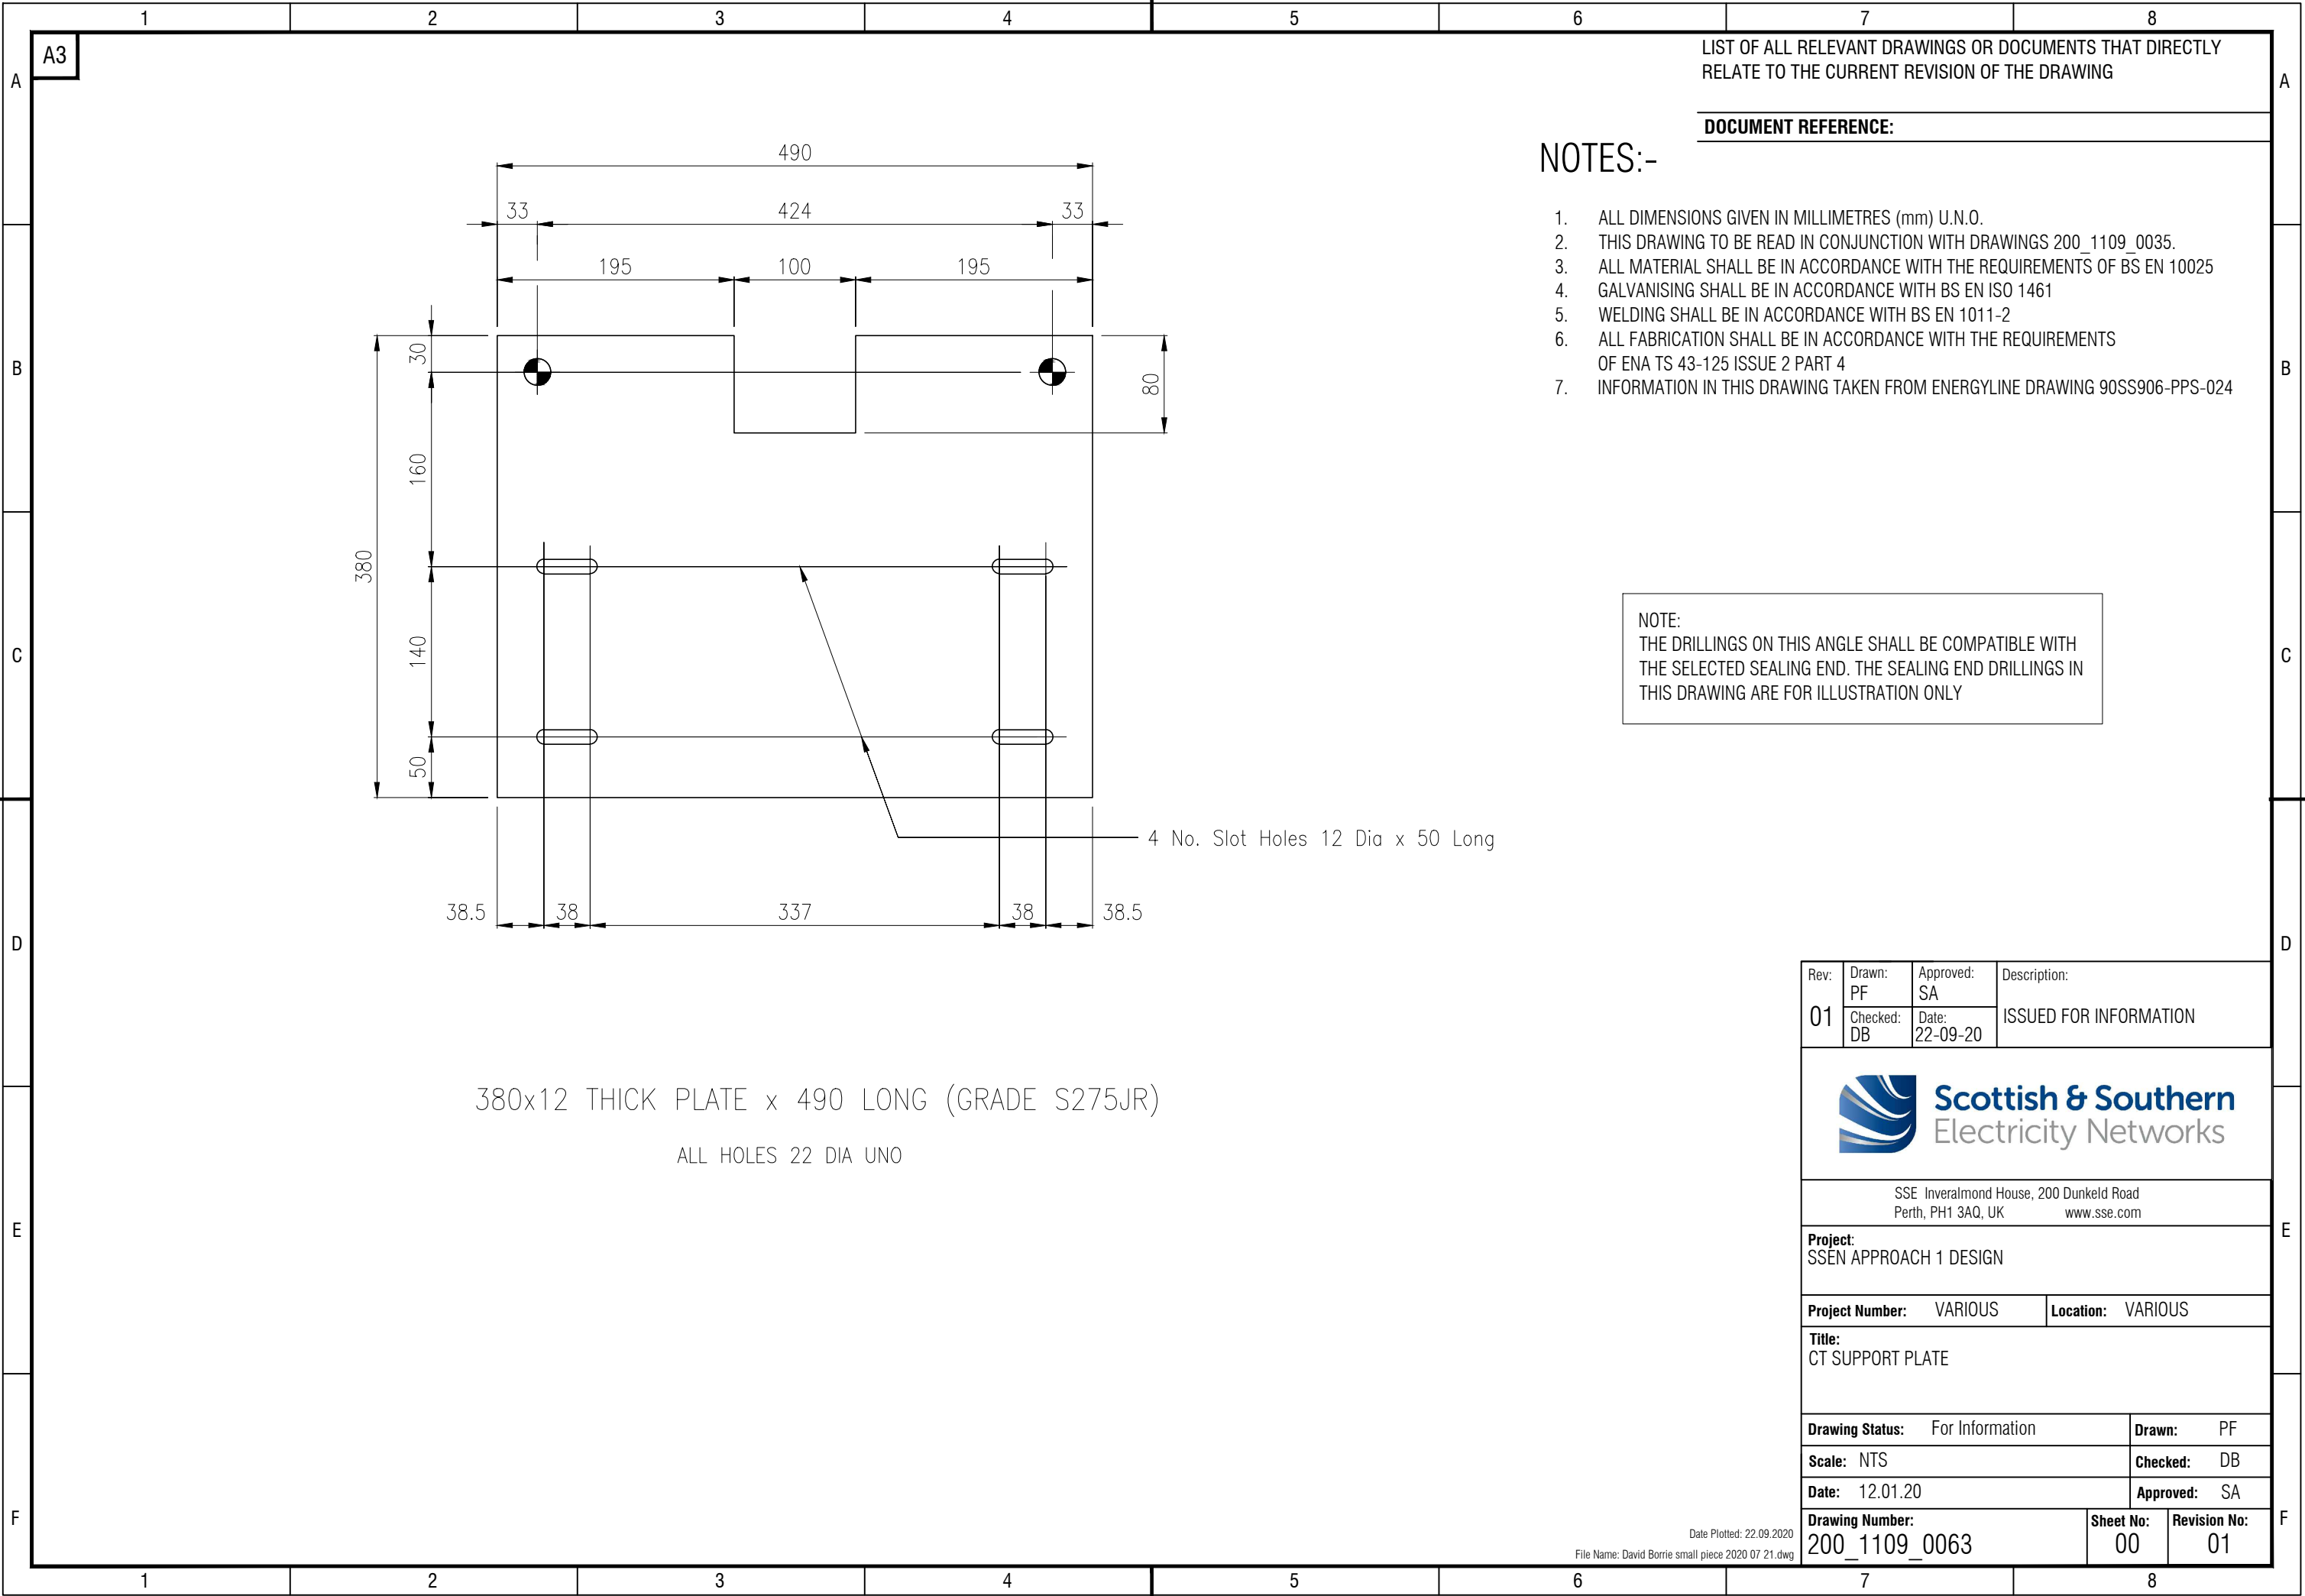

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0035.
- 3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
- 4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
- 6. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4
- 7. INFORMATION IN THIS DRAWING TAKEN FROM ENERGYLINE DRAWING 90SS906-PPS-024

NOTE:
THE DRILLINGS ON THIS ANGLE SHALL BE COMPATIBLE WITH THE SELECTED SEALING END. THE SEALING END DRILLINGS IN THIS DRAWING ARE FOR ILLUSTRATION ONLY

380x12 THICK PLATE x 490 LONG (GRADE S275JR)
ALL HOLES 22 DIA UNO

Rev:	Drawn:	Approved:	Description:
01	PF	SA	ISSUED FOR INFORMATION
	Checked: DB	Date: 22-09-20	



Scottish & Southern
Electricity Networks

SSE Inveralmond House, 200 Dunkeld Road
Perth, PH1 3AQ, UK www.sse.com

Project:
SSEN APPROACH 1 DESIGN

Project Number:	VARIOUS	Location:	VARIOUS
------------------------	---------	------------------	---------

Title:
CT SUPPORT PLATE

Drawing Status:	For Information	Drawn:	PF
Scale:	NTS	Checked:	DB
Date:	12.01.20	Approved:	SA
Drawing Number:	200_1109_0063	Sheet No:	00
		Revision No:	01