


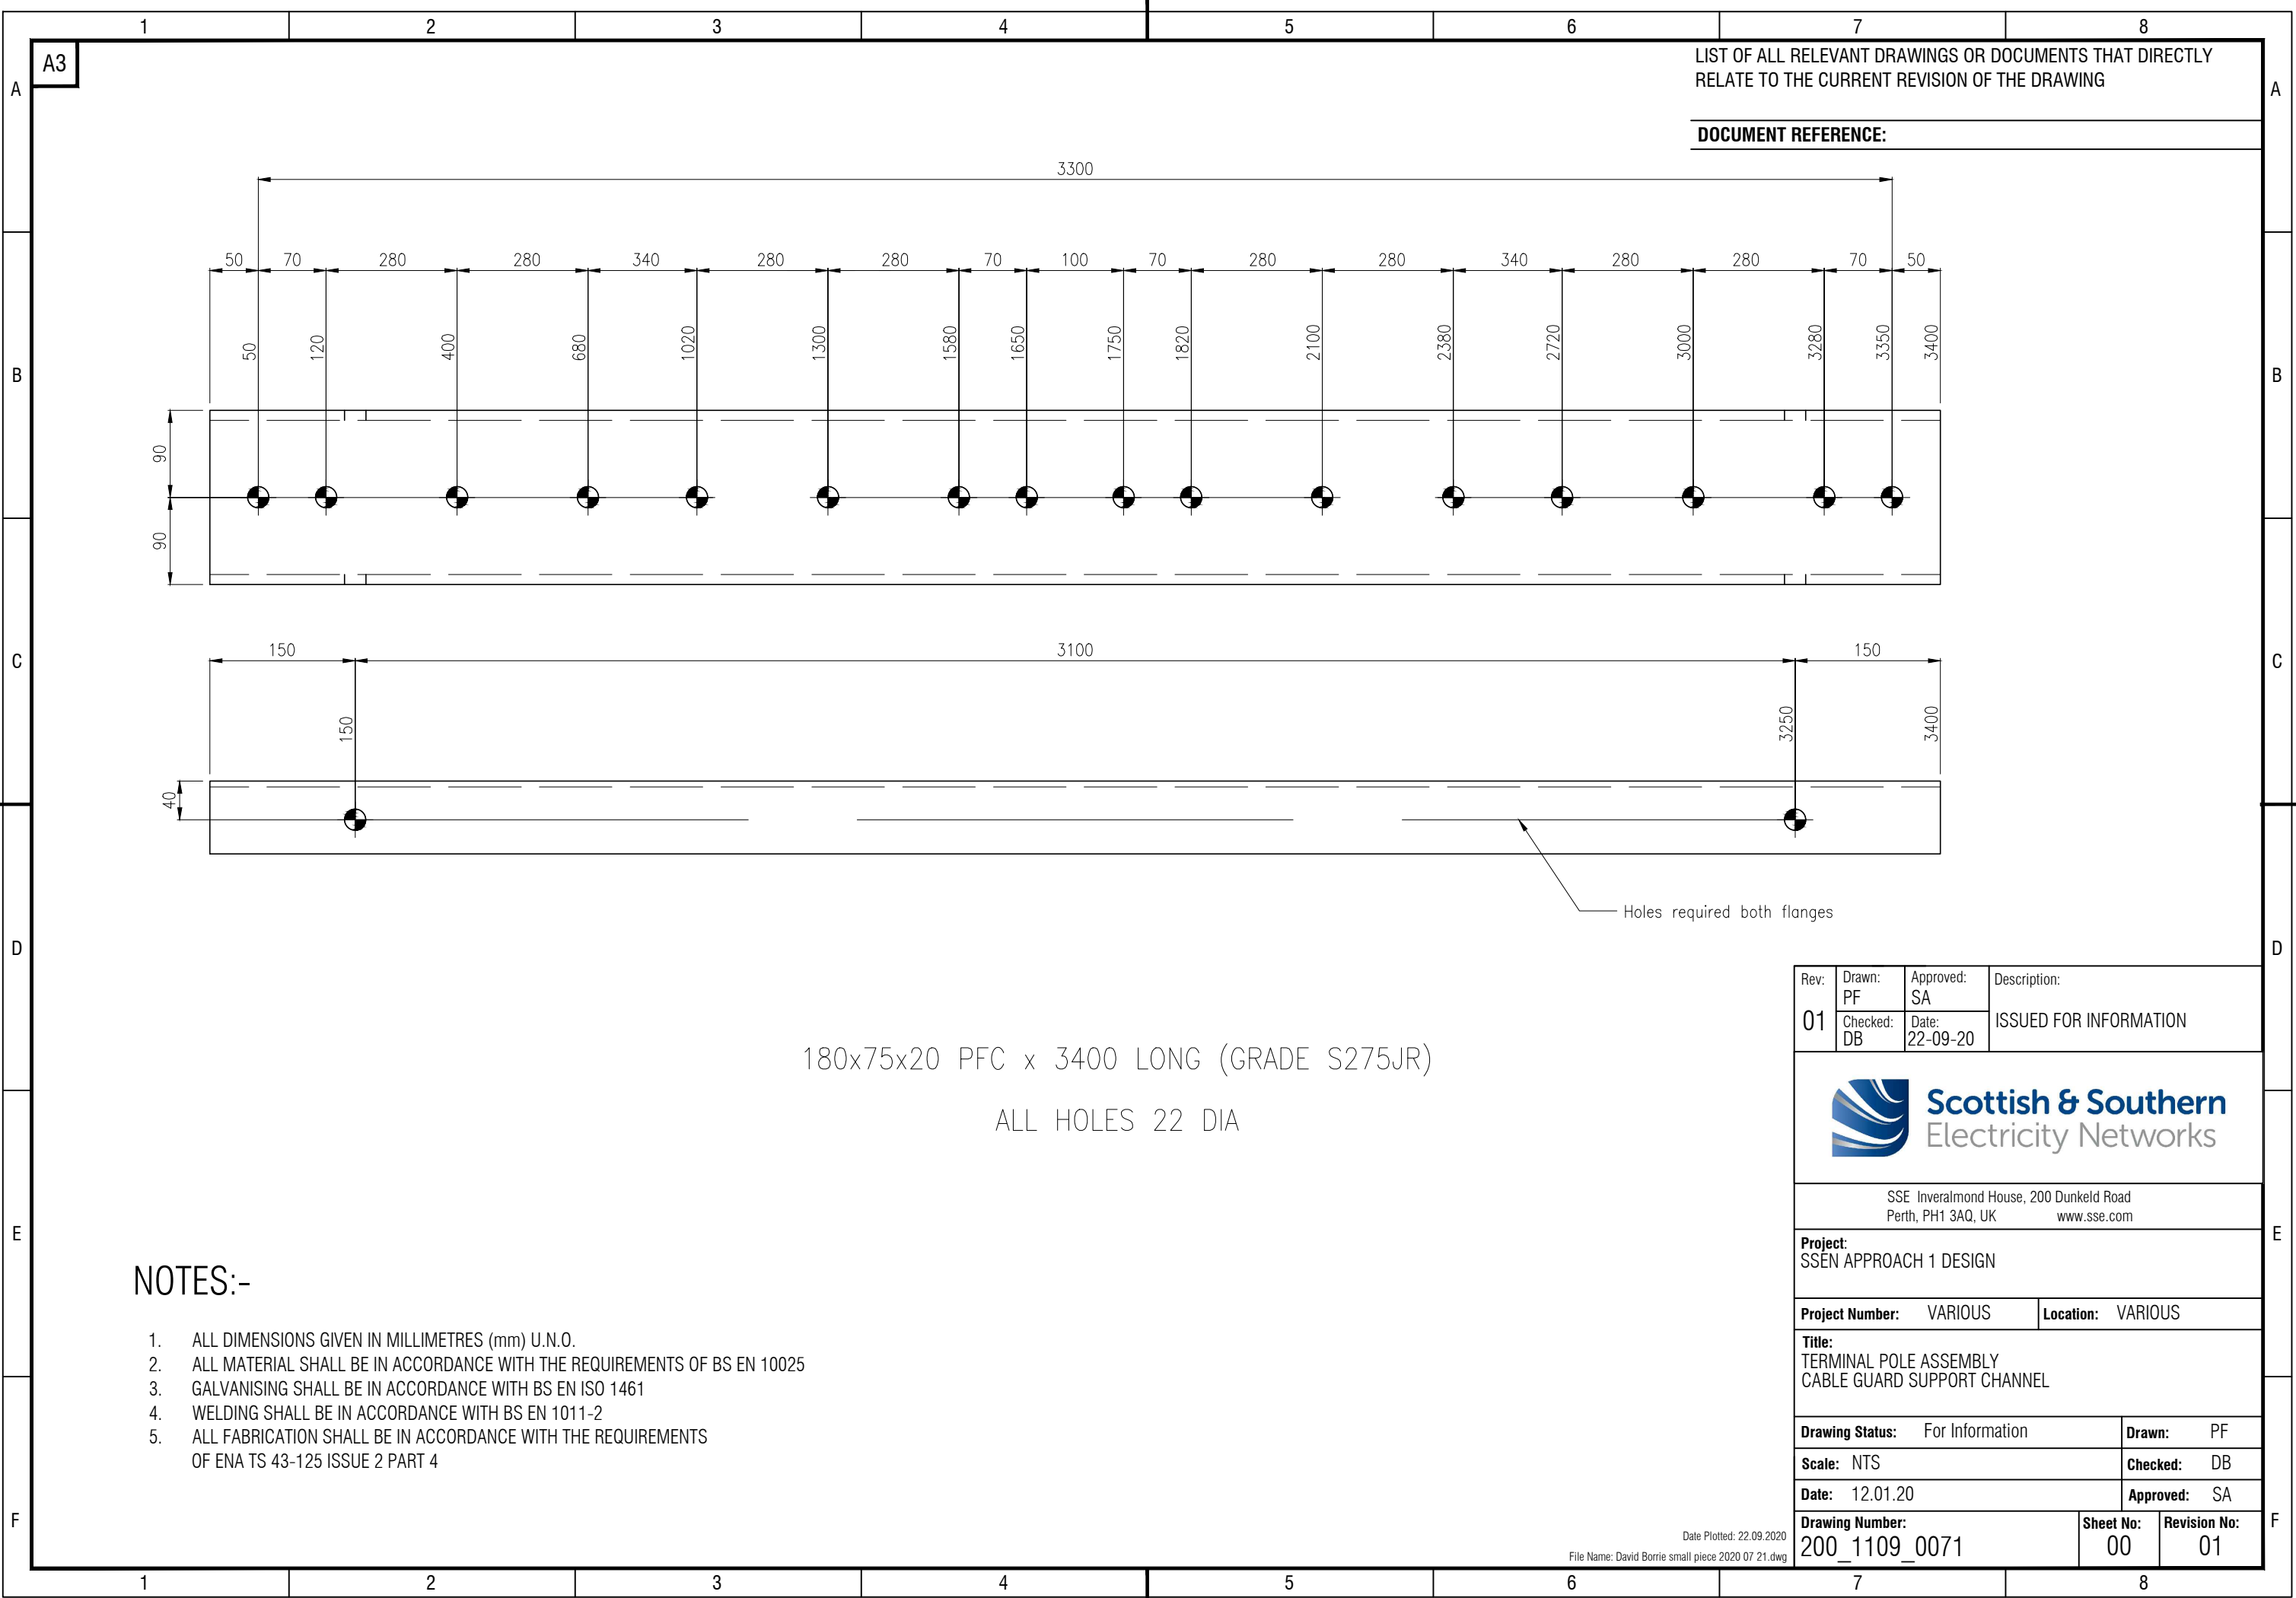

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

180x75x20 PFC x 3400 LONG (GRADE S275JR)
ALL HOLES 22 DIA

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
- 3. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 4. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
- 5. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4

Rev:	Drawn:	Approved:	Description:
	PF	SA	
01	Checked: DB	Date: 22-09-20	
			ISSUED FOR INFORMATION
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: TERMINAL POLE ASSEMBLY CABLE GUARD SUPPORT CHANNEL			
Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked: DB	
Date: 12.01.20		Approved: SA	
Drawing Number: 200_1109_0071		Sheet No: 00	Revision No: 01