


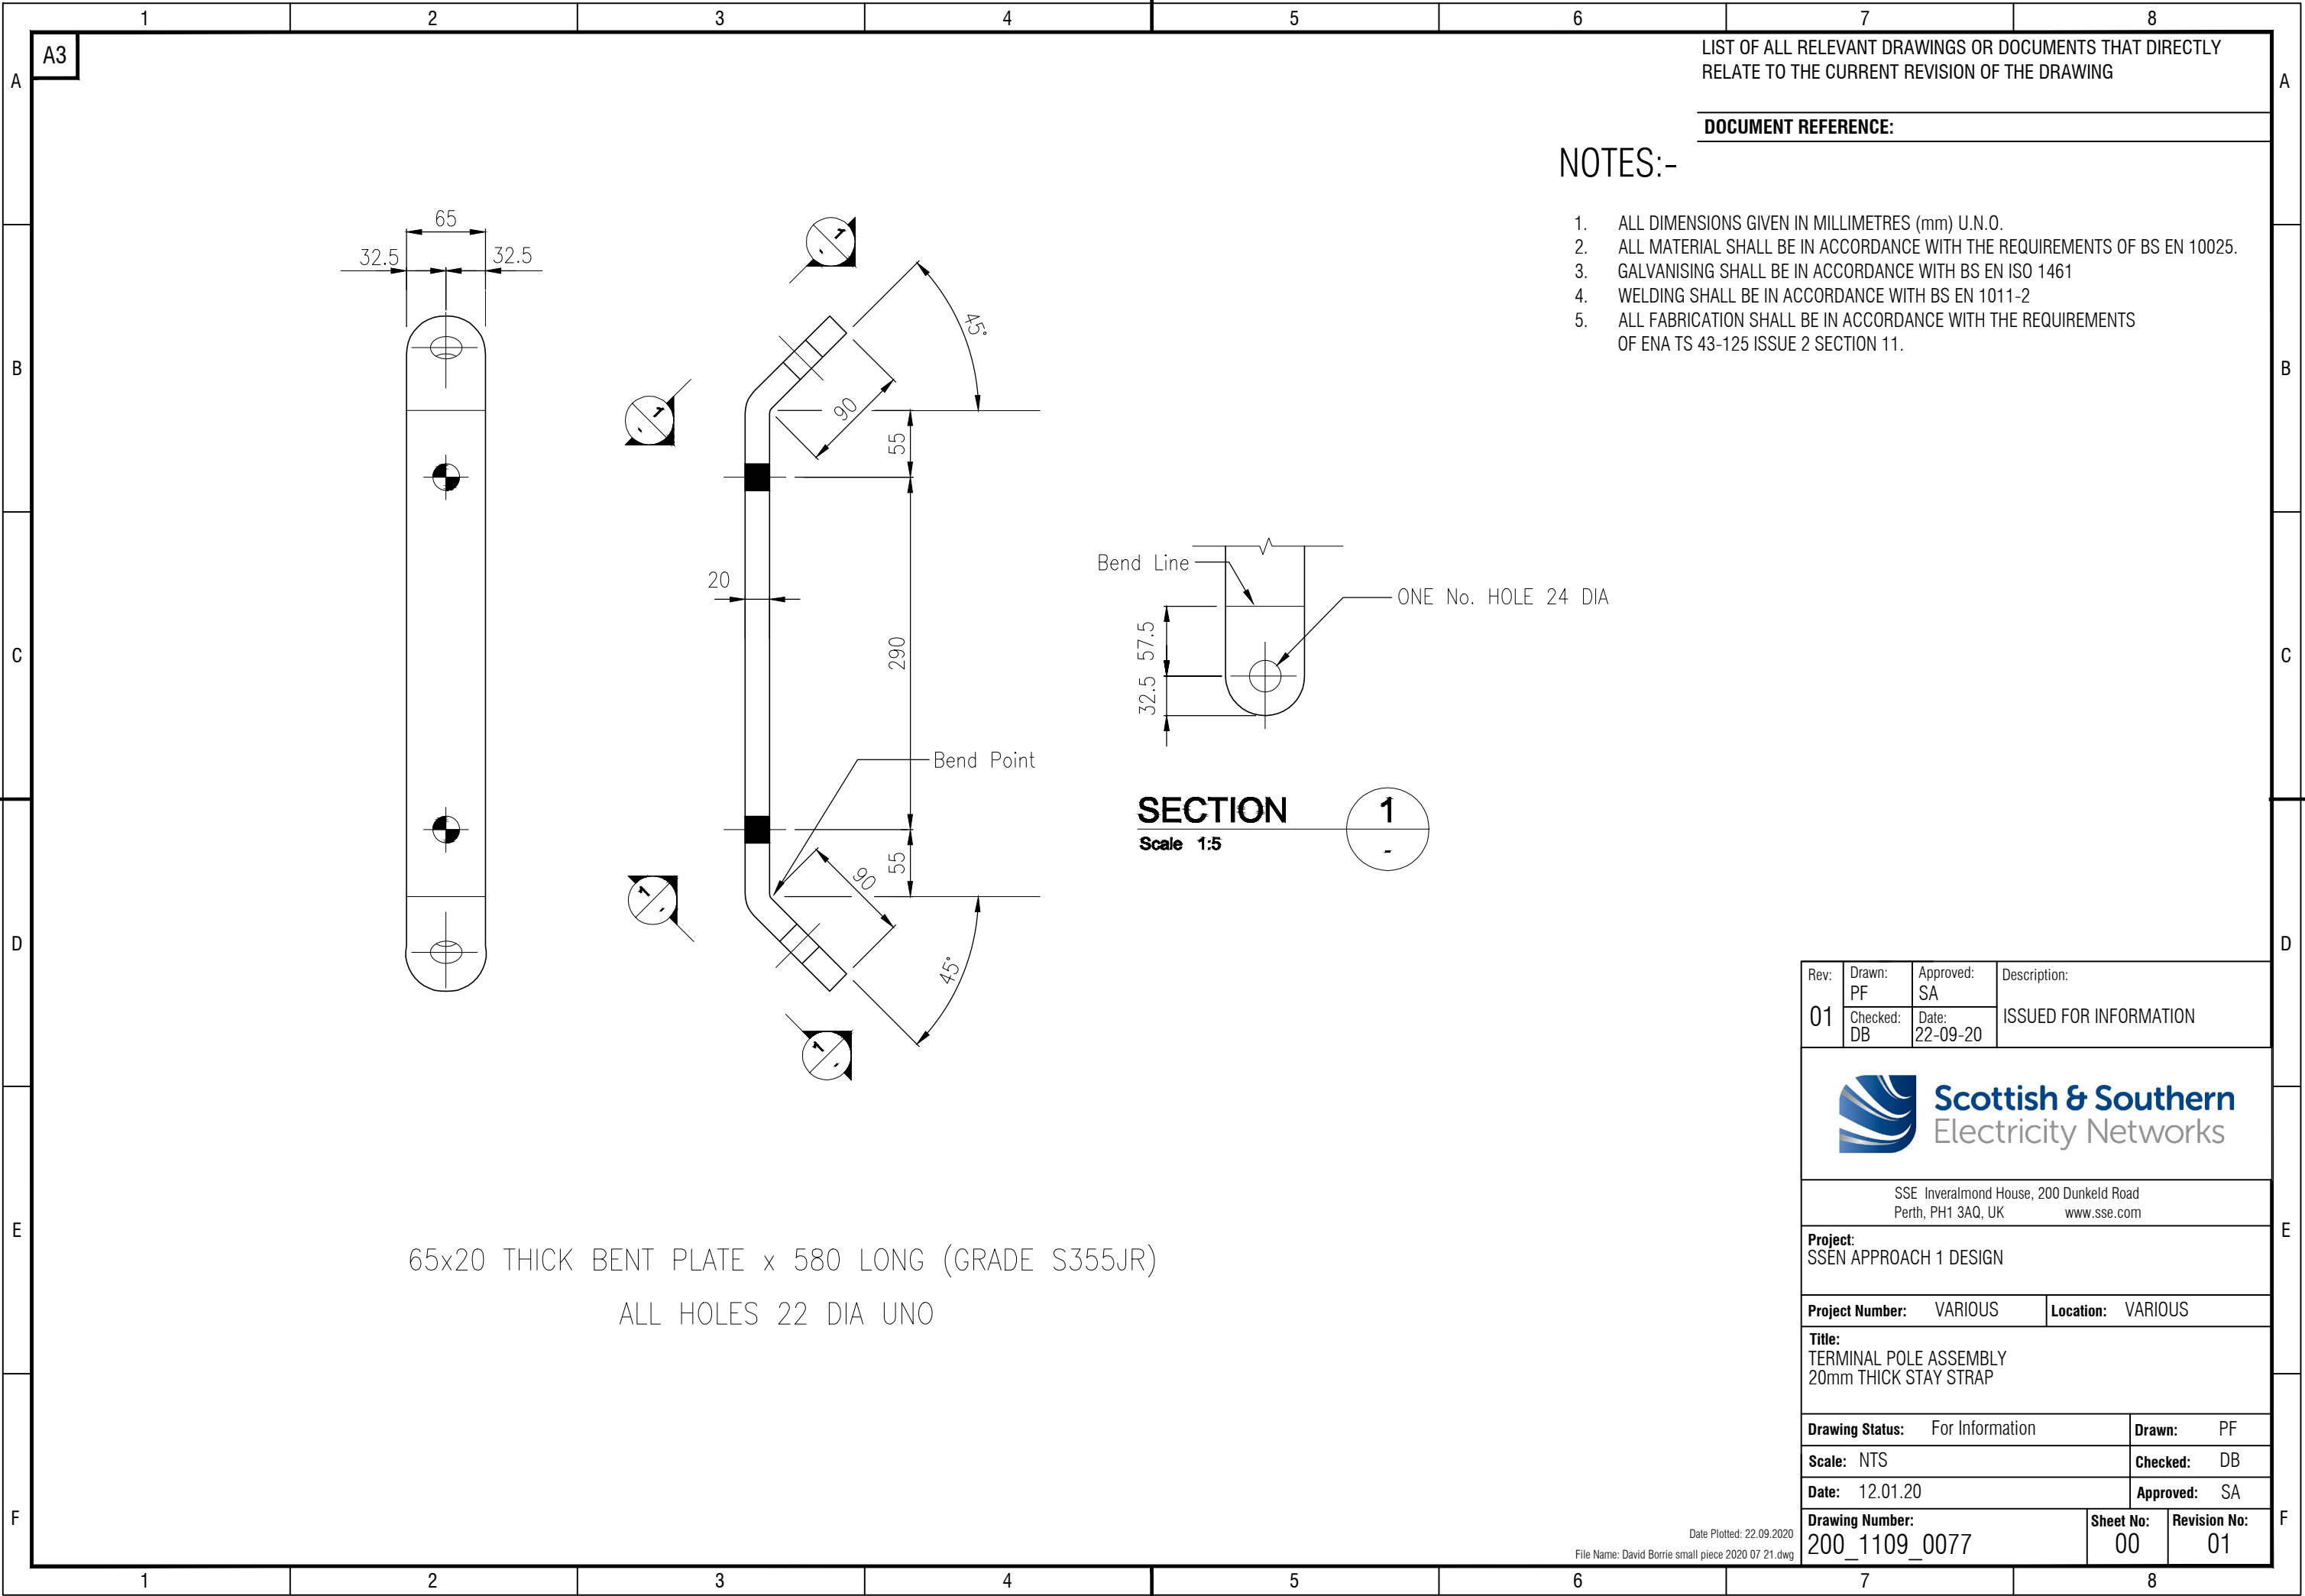

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025.
- 3. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 4. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
- 5. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 SECTION 11.

65x20 THICK BENT PLATE x 580 LONG (GRADE S355JR)  
ALL HOLES 22 DIA UNO

|      |                |                   |                        |
|------|----------------|-------------------|------------------------|
| Rev: | Drawn:         | Approved:         | Description:           |
| 01   | PF             | SA                | ISSUED FOR INFORMATION |
|      | Checked:<br>DB | Date:<br>22-09-20 |                        |

|                                                                                       |  |  |  |
|---------------------------------------------------------------------------------------|--|--|--|
|  |  |  |  |
| Scottish & Southern<br>Electricity Networks                                           |  |  |  |

|                                                                              |  |  |  |
|------------------------------------------------------------------------------|--|--|--|
| SSE Inveralmond House, 200 Dunkeld Road<br>Perth, PH1 3AQ, UK<br>www.sse.com |  |  |  |
|------------------------------------------------------------------------------|--|--|--|

|                                           |  |  |  |
|-------------------------------------------|--|--|--|
| <b>Project:</b><br>SSEN APPROACH 1 DESIGN |  |  |  |
|-------------------------------------------|--|--|--|

|                                |  |                          |  |
|--------------------------------|--|--------------------------|--|
| <b>Project Number:</b> VARIOUS |  | <b>Location:</b> VARIOUS |  |
|--------------------------------|--|--------------------------|--|

|                                                                  |  |  |  |
|------------------------------------------------------------------|--|--|--|
| <b>Title:</b><br>TERMINAL POLE ASSEMBLY<br>20mm THICK STAY STRAP |  |  |  |
|------------------------------------------------------------------|--|--|--|

|                                         |  |                        |                           |
|-----------------------------------------|--|------------------------|---------------------------|
| <b>Drawing Status:</b> For Information  |  | <b>Drawn:</b> PF       |                           |
| <b>Scale:</b> NTS                       |  | <b>Checked:</b> DB     |                           |
| <b>Date:</b> 12.01.20                   |  | <b>Approved:</b> SA    |                           |
| <b>Drawing Number:</b><br>200_1109_0077 |  | <b>Sheet No:</b><br>00 | <b>Revision No:</b><br>01 |