


DO NOT SCALE THIS DRAWING. IF IN DOUBT ASK

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0035 SHT02,0037,0038 & 0039
3. THIS DRAWING IS BASED ON THE FOLLOWING:
POLE MOUNTED TERMINAL ASSEMBLY ENATS 4350. DWG REF: 435011 & 435012.
4. ALL BOLTED CONNECTIONS ABOVE GROUND LEVEL SHALL BE FITTED WITH A LOCK NUT.
5. ALL UNUSED POLE DRILLINGS SHALL BE SEALED WITH A HARDWOOD PLUG (ENA TS 43-88 ANNEX C)

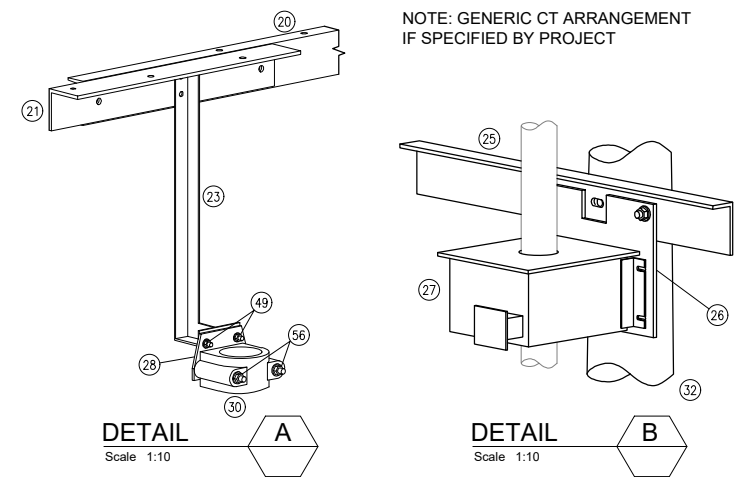

Rev:	Drawn:	Approved:	Description:
01	PF	SA	ISSUED FOR INFORMATION
	Checked:	Date:	
	DB	18-09-20	



SSE Inverlorn House, 200 Dunkeld Road
Perth, PH1 3AQ, UK
www.sse.com

Project:
SSEN APPROACH 1 DESIGN

Project Number: VARIOUS Location: VARIOUS

Title:
TERMINAL POLE ASSEMBLY : STRUCTURAL ARRANGEMENT
132kV WOOD POLE OHL

Drawing Status: For Information Drawn: PF

Scale: NTS Checked: DB


Date: 12.01.20 Approved: SA

Drawing Number: 200_1109_0035 Sheet No: 01 Revision No: 01


Date Plotted: 18.09.2020

File Name: David Borrie small piece 2020 07 21.dwg


A3

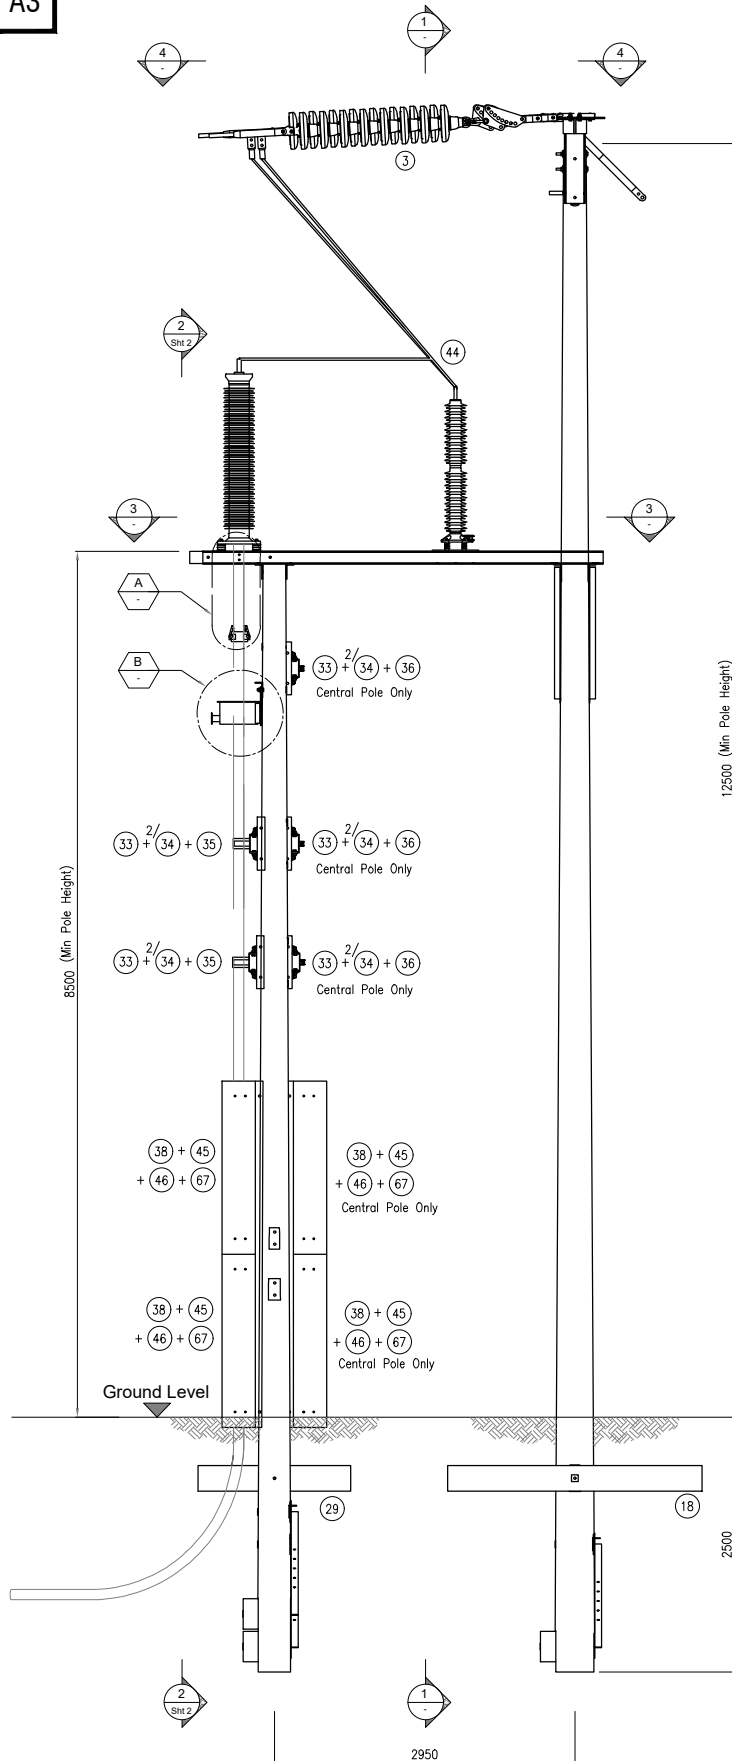


SIDE ELEVATION

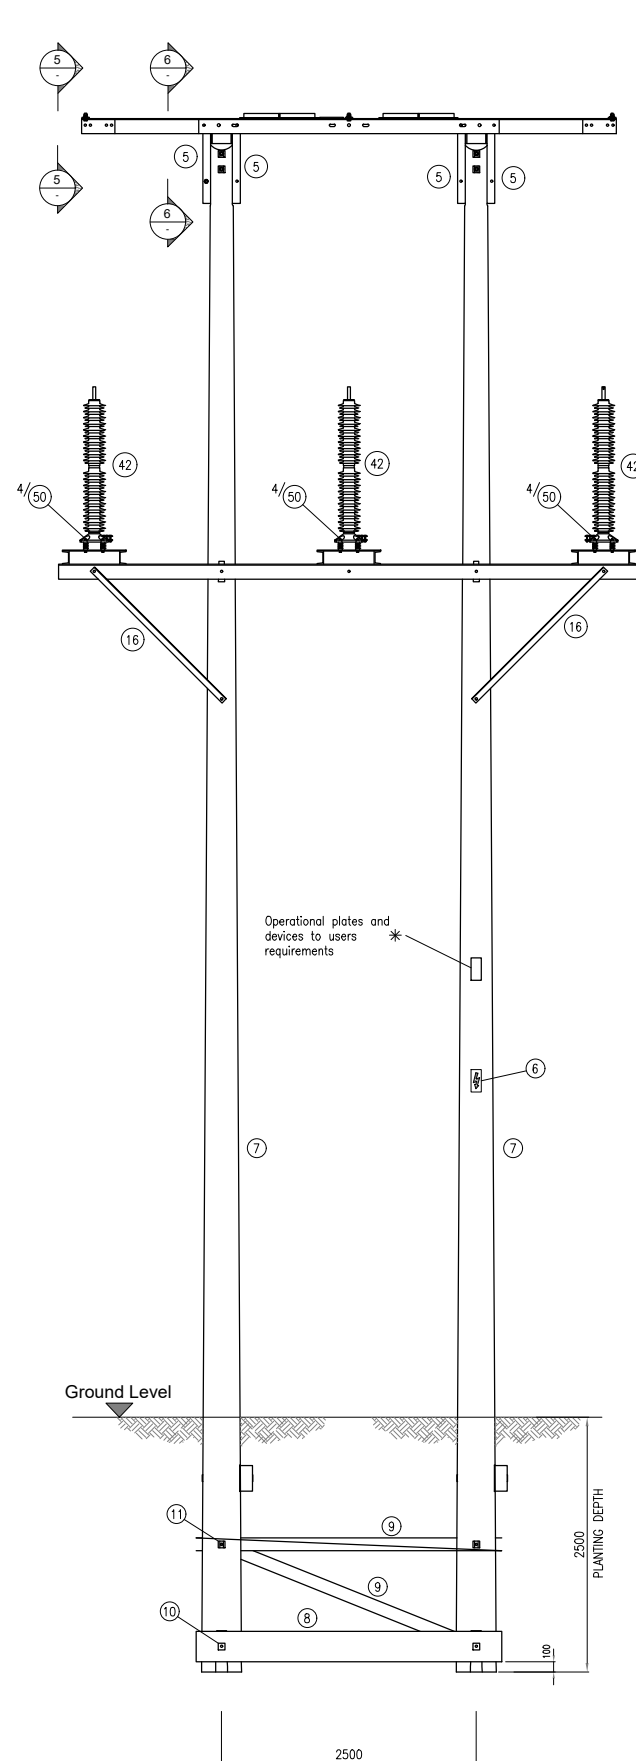


SECTION 1
Scale 1:35

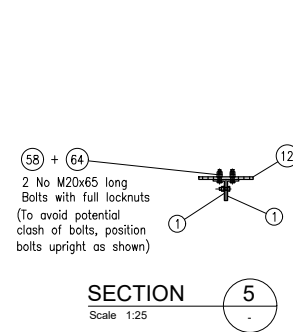


SECTION 5
Scale 1:25

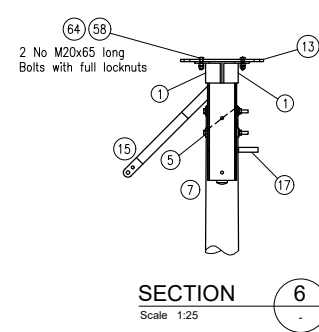

SECTION 6
Scale 1:25

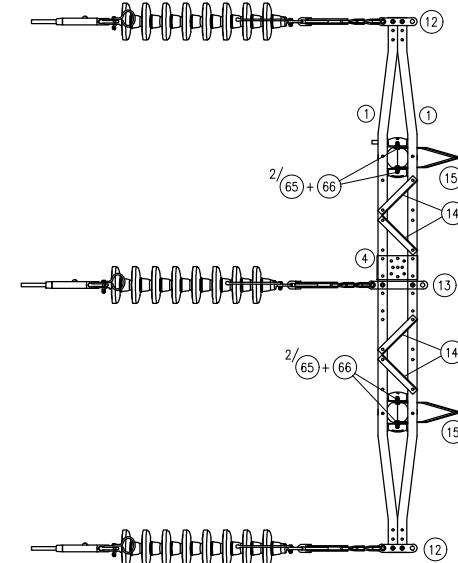

SECTION 4
Scale 1:35

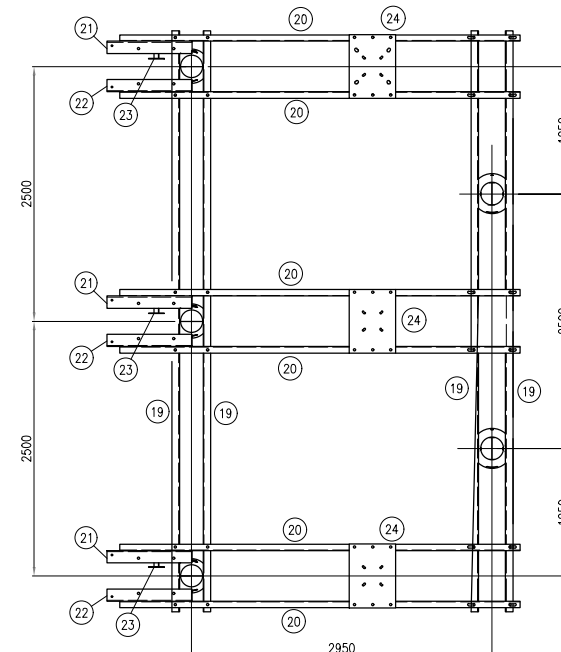

SECTION 3
Scale 1:35