
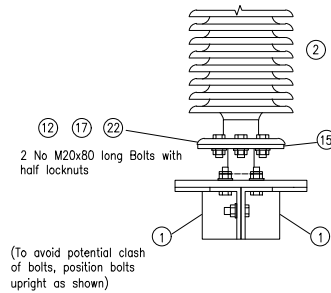
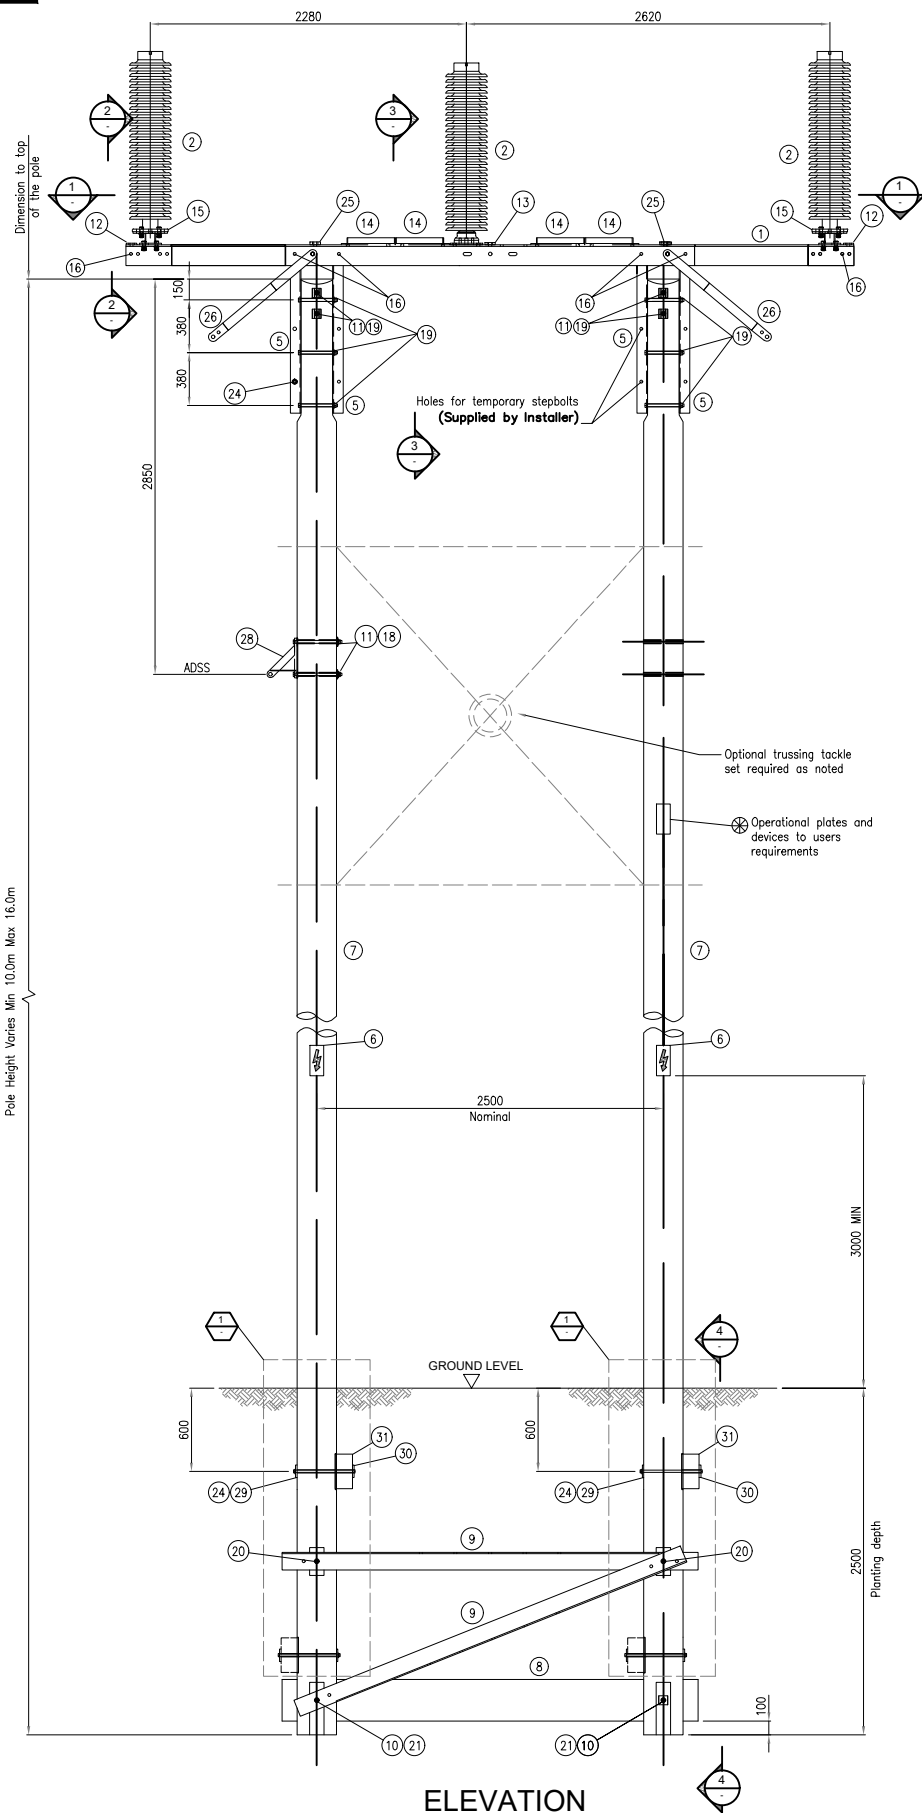
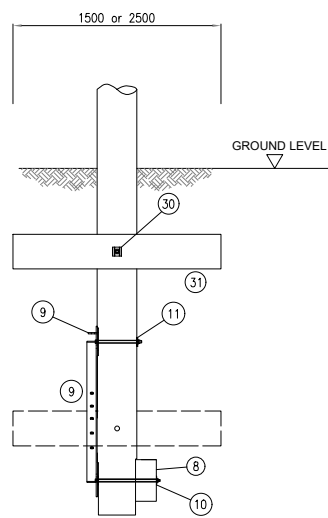




A3

SECTION 2
Scale 1:10SECTION 4
Scale 1:25

Alternative arrangement for grade 2 soil refer to drawings 90SS906-PGA-006 & 007

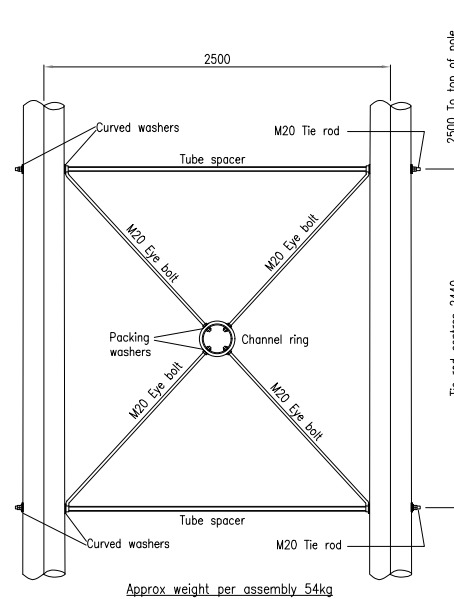

ELEVATION ON OPTIONAL TRUSSING TACKLE SET

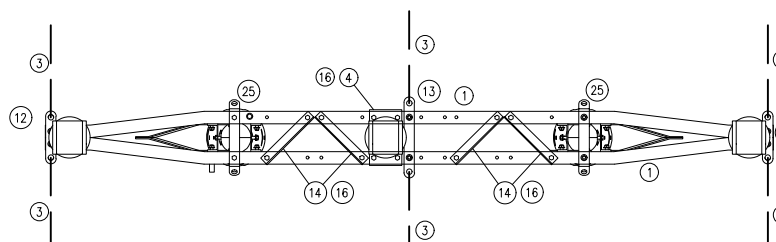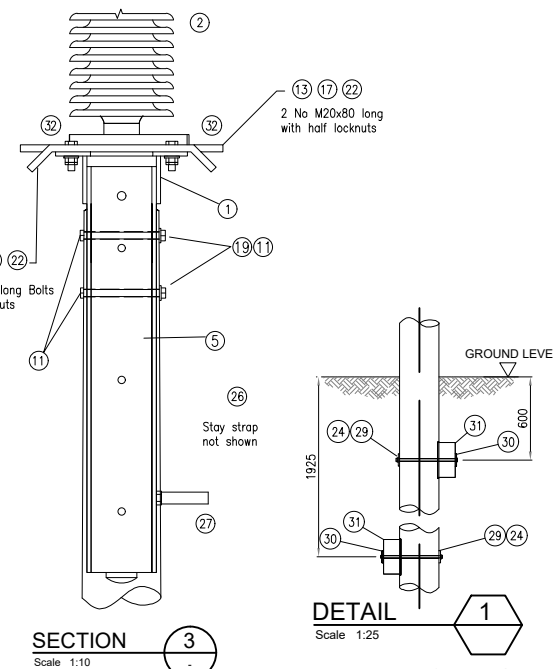Required on 'H' poles 12.0m long and above and all poles with an angle of deviation of 20° or greater.
(Trussing tackle set supplied by BB Price Ltd. Part Reference Number H351/006.)SECTION 1
Scale 1:25DETAIL 1
Scale 1:25

Alternative arrangement for grade 2 soil refer to drawings 90SS906-PGA-006 & 007

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

- ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0037,0038 & 0039
- PRELIMINARY SUBJECT TO LOAD AND STRENGTH STUDIES, FINAL ROUTE ALIGNMENT, MICROSITING AND GROUND CONDITIONS.
- ALL BOLTED CONNECTIONS ABOVE GROUND LEVEL SHALL BE FITTED WITH A LOCK NUT.
- ALL UNUSED POLE DRILLINGS SHALL BE SEALED WITH A HARDWOOD PLUG (ENA TS 43-88 ANNEX C)

ITEM	ESI STD DRG No. or BS. Ref	DESCRIPTION	SECTION SIZE	LENGTH	QUANTITY	UNIT WEIGHT (kg)	WEIGHT (kg)	REMARKS
1	200 1109 0043	ANGLE CROSSARM	150x90x12 RSA	5262	2	113.245	226.490	
2	ENATS 43-93	POST INSULATOR AND CONDUCTOR CLAMP	-	-	3			CLAMP NOT SHOWN
3	ENATS 43-93	TENSION INSULATORS AND FITTINGS	-	-	6 SETS			
4	200 1109 0080	INSULATOR MOUNTING PLATE	235x12 THICK PLATE	400	1	8.855	8.855	
5	200 1109 0042	CROSSARM SUPPORT CHANNEL	200x75x23 PFC	1180	4	27.612	110.448	
6	439701	DANGER PLATE	-	-	2	0.001	0.001	
7	200 1109 0078	WOOD POLE	EXTRA STOUT	VARIES	2			
8	439112	TYPE 2. BRACE BAULK	300 x 150	3000	1			
9	439545	'H' POLE FOUNDATION BRACE	125x75x8 RSA	3000	2	36.246	72.492	
10	439604	SQUARE FLAT WASHER (22 DIA HOLE)	65x6 THICK PLATE	65	3	0.181	0.543	
11	439605	SQUARE CURVED WASHER (22 DIA HOLE)	65x6 THICK BENT PLATE	65	12	0.178	2.136	
12	200 1109 0044	SHORT TYPE STRAP	75x20 THICK PLATE	380	2	4.475	8.950	
13	200 1109 0045	LONG TYPE STRAP	75x20 THICK PLATE	580	1	6.830	6.830	
14			-	482	4	3.245	12.980	
15	200 1109 0076	INSULATOR SUPPORT BRACKET	WELDED ASSEMBLY					
16	ENATS 43-96	M20 GRADE 8.8 BOLT	M20 (46mm THREAD LENGTH)	60	36	0.287	10.332	
17	ENATS 43-96	M20 GRADE 8.8 BOLT	M20 (46mm THREAD LENGTH)	80	28	0.337	9.436	INSULATORS TO MOUNTING PLATES & AS SHOWN
18	ENATS 43-96	M20 GRADE 8.8 BOLT	M20	350	2	1.064	2.128	CROSSARM SUPPORTS TO POLE
19	ENATS 43-96	M20 GRADE 8.8 BOLT	M20	300	10	0.879	8.790	
20	ENATS 43-96	M24 GRADE 8.8 BOLT	M20	450	2	1.249	2.498	
21	ENATS 43-96	M24 GRADE 8.8 BOLT	M20	590	2	1.594	3.188	
22	ENATS 43-96	M20 GRADE 8.8 NUT	M20 HALF LOCKNUT		10	0.029	0.290	
23	ENATS 43-96	M24 GRADE 8.8 BOLT	M24 (36mm THREAD LENGTH)	60	4	0.447	1.788	STAY STRAP CONNECTION
24	ENATS 43-96	M24 GRADE 8.8 BOLT	M24	590	VARIES	3.229		
25	200 1109 0077	STAY STRAP	65x20 THICK BENT PLATE	580	2	5.919	11.838	
26	439113	STAY STRAP (HEAVY DUTY)	65x8 THICK BENT PLATE	1011	2	8.254	16.508	
27	439554	EARTHING ATTACHMENT NUT	34 DIA HEAVY DUTY TUBE	150	1	0.6	0.600	
28	200 1109 0079	ADSS BRACKET	WELDED ASSEMBLY	285	1	2.642	2.642	SUSPENSION POINT SHALL BE A MINIMUM OF A HORIZONTAL DISTANCE OF 175mm FROM POLE
29	200 1109 0051	SQUARE CURVED WASHER (26 DIA HOLE)	90x12 THICK FLAT	90	VARIES	0.763		
30	200 1109 0050	SQUARE FLAT WASHER (26 DIA HOLE)	90x12 THICK FLAT	90	VARIES	0.763		
31	200 1109 0054	TYPE 3. or 4 TOP BAULK (26 DIA HOLE)	250min x 125min	1500/2500	VARIES			
32		ROUND WASHER (16mm HOLE)			24			FOR FIXING OF POST INSULATOR
						TOTAL	519.63	

Date Plotted: 18.09.2020

File Name: David Borrie small piece 2020 07 21.dwg

SSE Inverlorn House, 200 Dunkeld Road
Perth, PH1 3AQ, UK
www.sse.comProject:
SSEN APPROACH 1 DESIGN

Project Number: VARIOUS Location: VARIOUS

Title:
FAILURE CONTAINMENT ASSEMBLY 132KV WOOD POLE OHL

Drawing Status: For Information Drawn: PF

Scale: NTS Checked: DB

Date: 12.01.20 Approved: SA

Drawing Number: 200_1109_0036 Sheet No: 00 Revision No: 01