


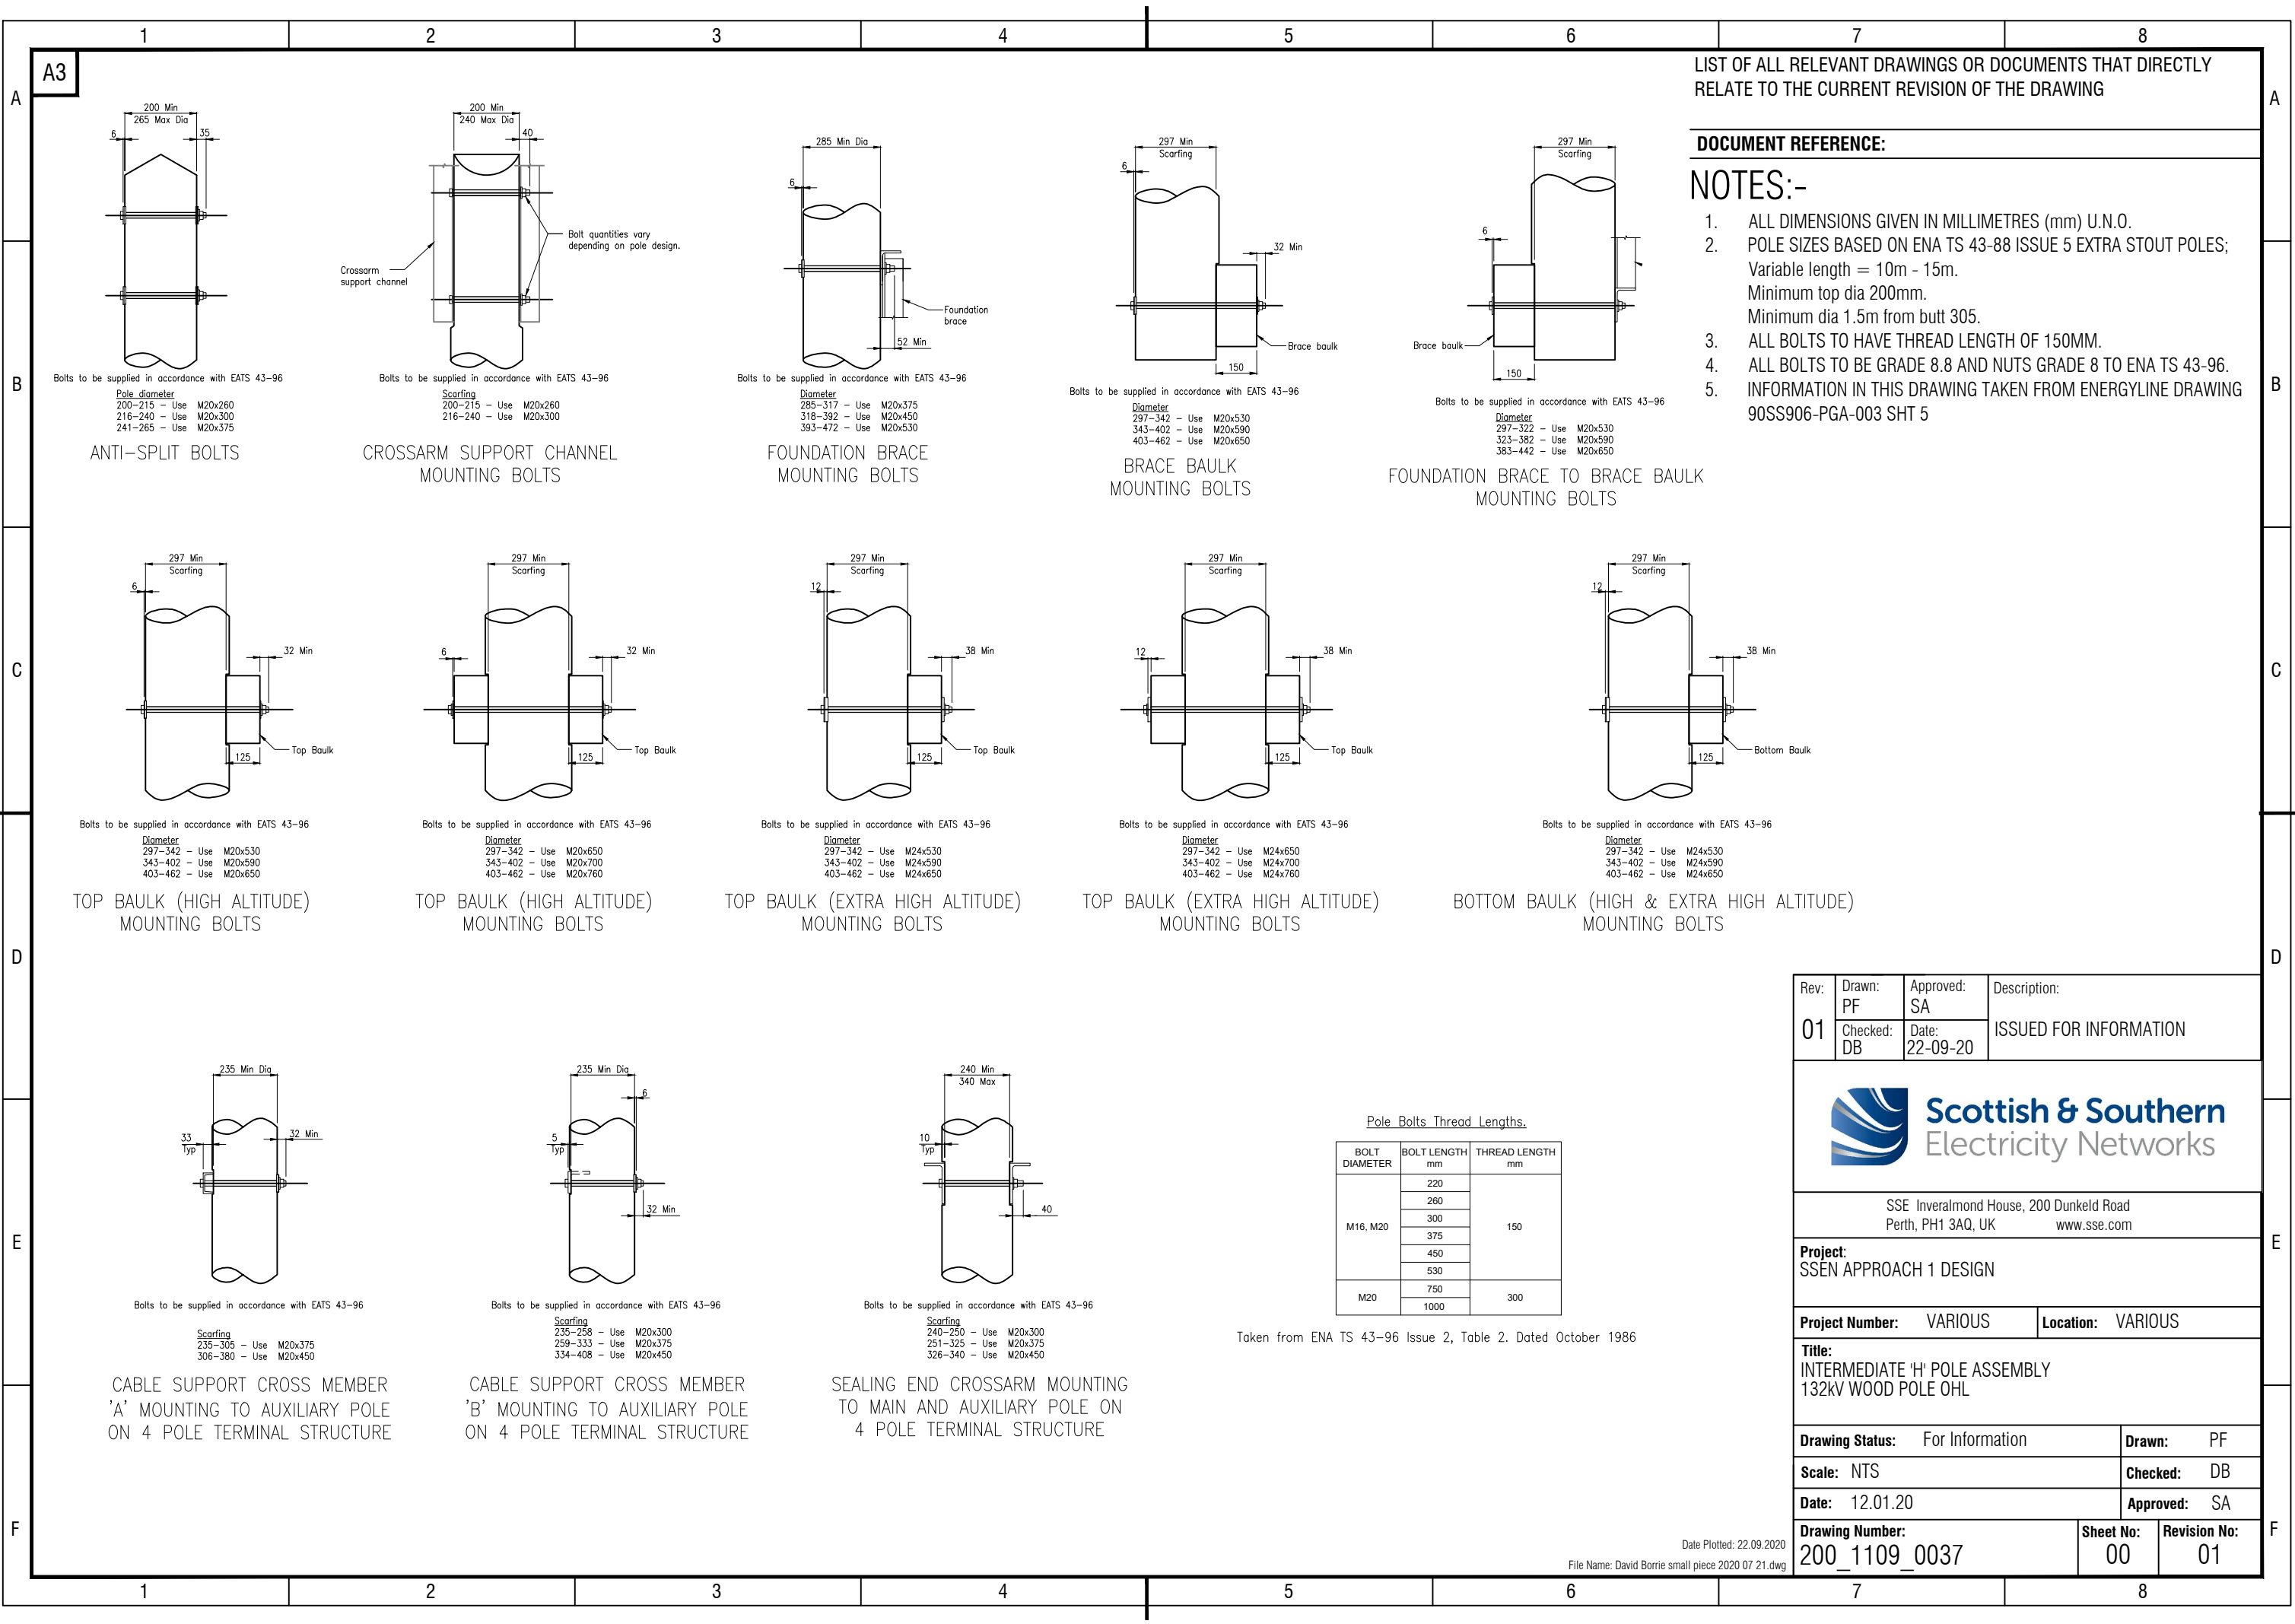

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. POLE SIZES BASED ON ENA TS 43-88 ISSUE 5 EXTRA STOUT POLES; Variable length = 10m - 15m. Minimum top dia 200mm. Minimum dia 1.5m from butt 305.
3. ALL BOLTS TO HAVE THREAD LENGTH OF 150MM.
4. ALL BOLTS TO BE GRADE 8.8 AND NUTS GRADE 8 TO ENA TS 43-96.
5. INFORMATION IN THIS DRAWING TAKEN FROM ENERGYLINE DRAWING 90SS906-PGA-003 SHT 5

Rev:	Drawn: PF	Approved: SA	Description:
01	Checked: DB	Date: 22-09-20	ISSUED FOR INFORMATION



SSE Inveralmond House, 200 Dunkeld Road
Perth, PH1 3AQ, UK
www.sse.com

Project:
SSEN APPROACH 1 DESIGN

Project Number: VARIOUS Location: VARIOUS

Title:
INTERMEDIATE 'H' POLE ASSEMBLY
132kV WOOD POLE OHL

Drawing Status: For Information Drawn: PF

Scale: NTS Checked: DB

Date: 12.01.20 Approved: SA

Drawing Number: 200_1109_0037 Sheet No: 00 Revision No: 01

Pole Bolts Thread Lengths.

BOLT DIAMETER	BOLT LENGTH mm	THREAD LENGTH mm
M16, M20	220	150
	260	
	300	
	375	
	450	
M20	530	300
	750	
	1000	

Taken from ENA TS 43-96 Issue 2, Table 2. Dated October 1986

Date Plotted: 22.09.2020

File Name: David Borrie small piece 2020 07 21.dwg