


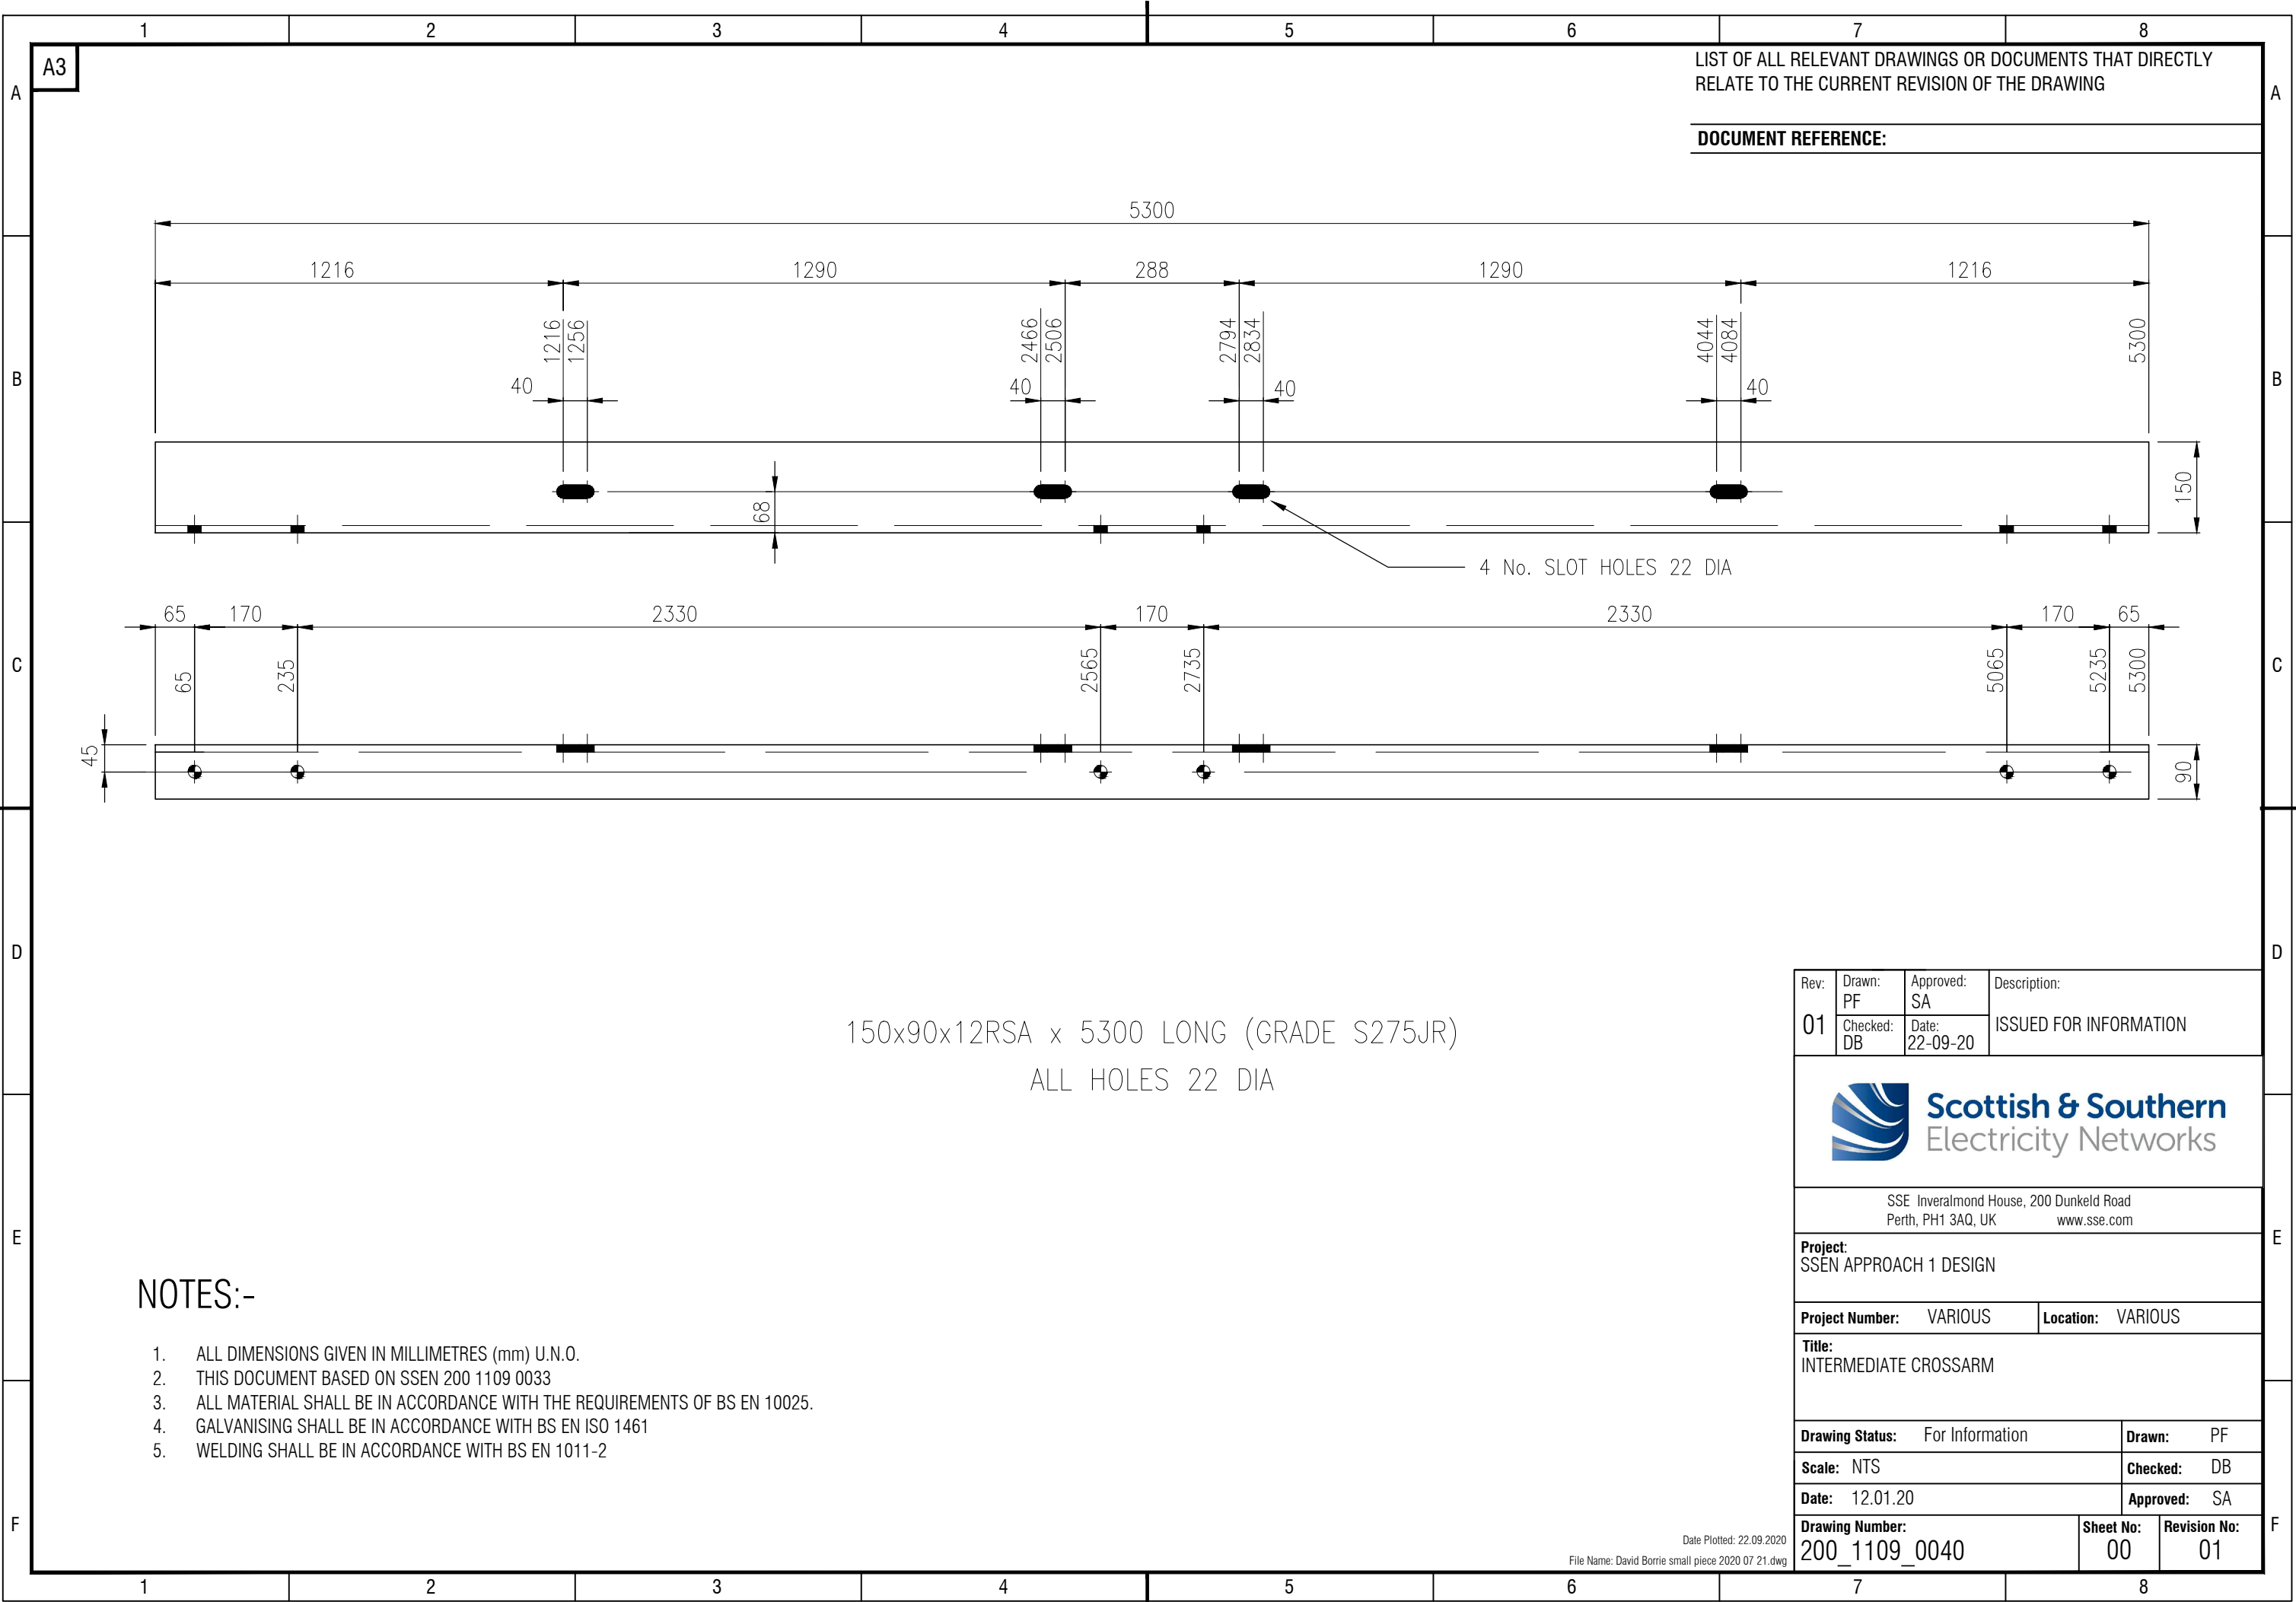

150x90x12RSA x 5300 LONG (GRADE S275JR)
ALL HOLES 22 DIA

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY
RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. THIS DOCUMENT BASED ON SSEN 200 1109 0033
- 3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025.
- 4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2

Rev:	Drawn: PF	Approved: SA	Description: ISSUED FOR INFORMATION
01	Checked: DB	Date: 22-09-20	



Scottish & Southern
Electricity Networks

SSE Inverlmond House, 200 Dunkeld Road
Perth, PH1 3AQ, UK
www.sse.com

Project:
SSEN APPROACH 1 DESIGN

Project Number:	VARIOUS	Location:	VARIOUS
------------------------	---------	------------------	---------

Title:
INTERMEDIATE CROSSARM

Drawing Status:	For Information	Drawn:	PF
Scale:	NTS	Checked:	DB
Date:	12.01.20	Approved:	SA
Drawing Number:	200_1109_0040	Sheet No:	00
		Revision No:	01