


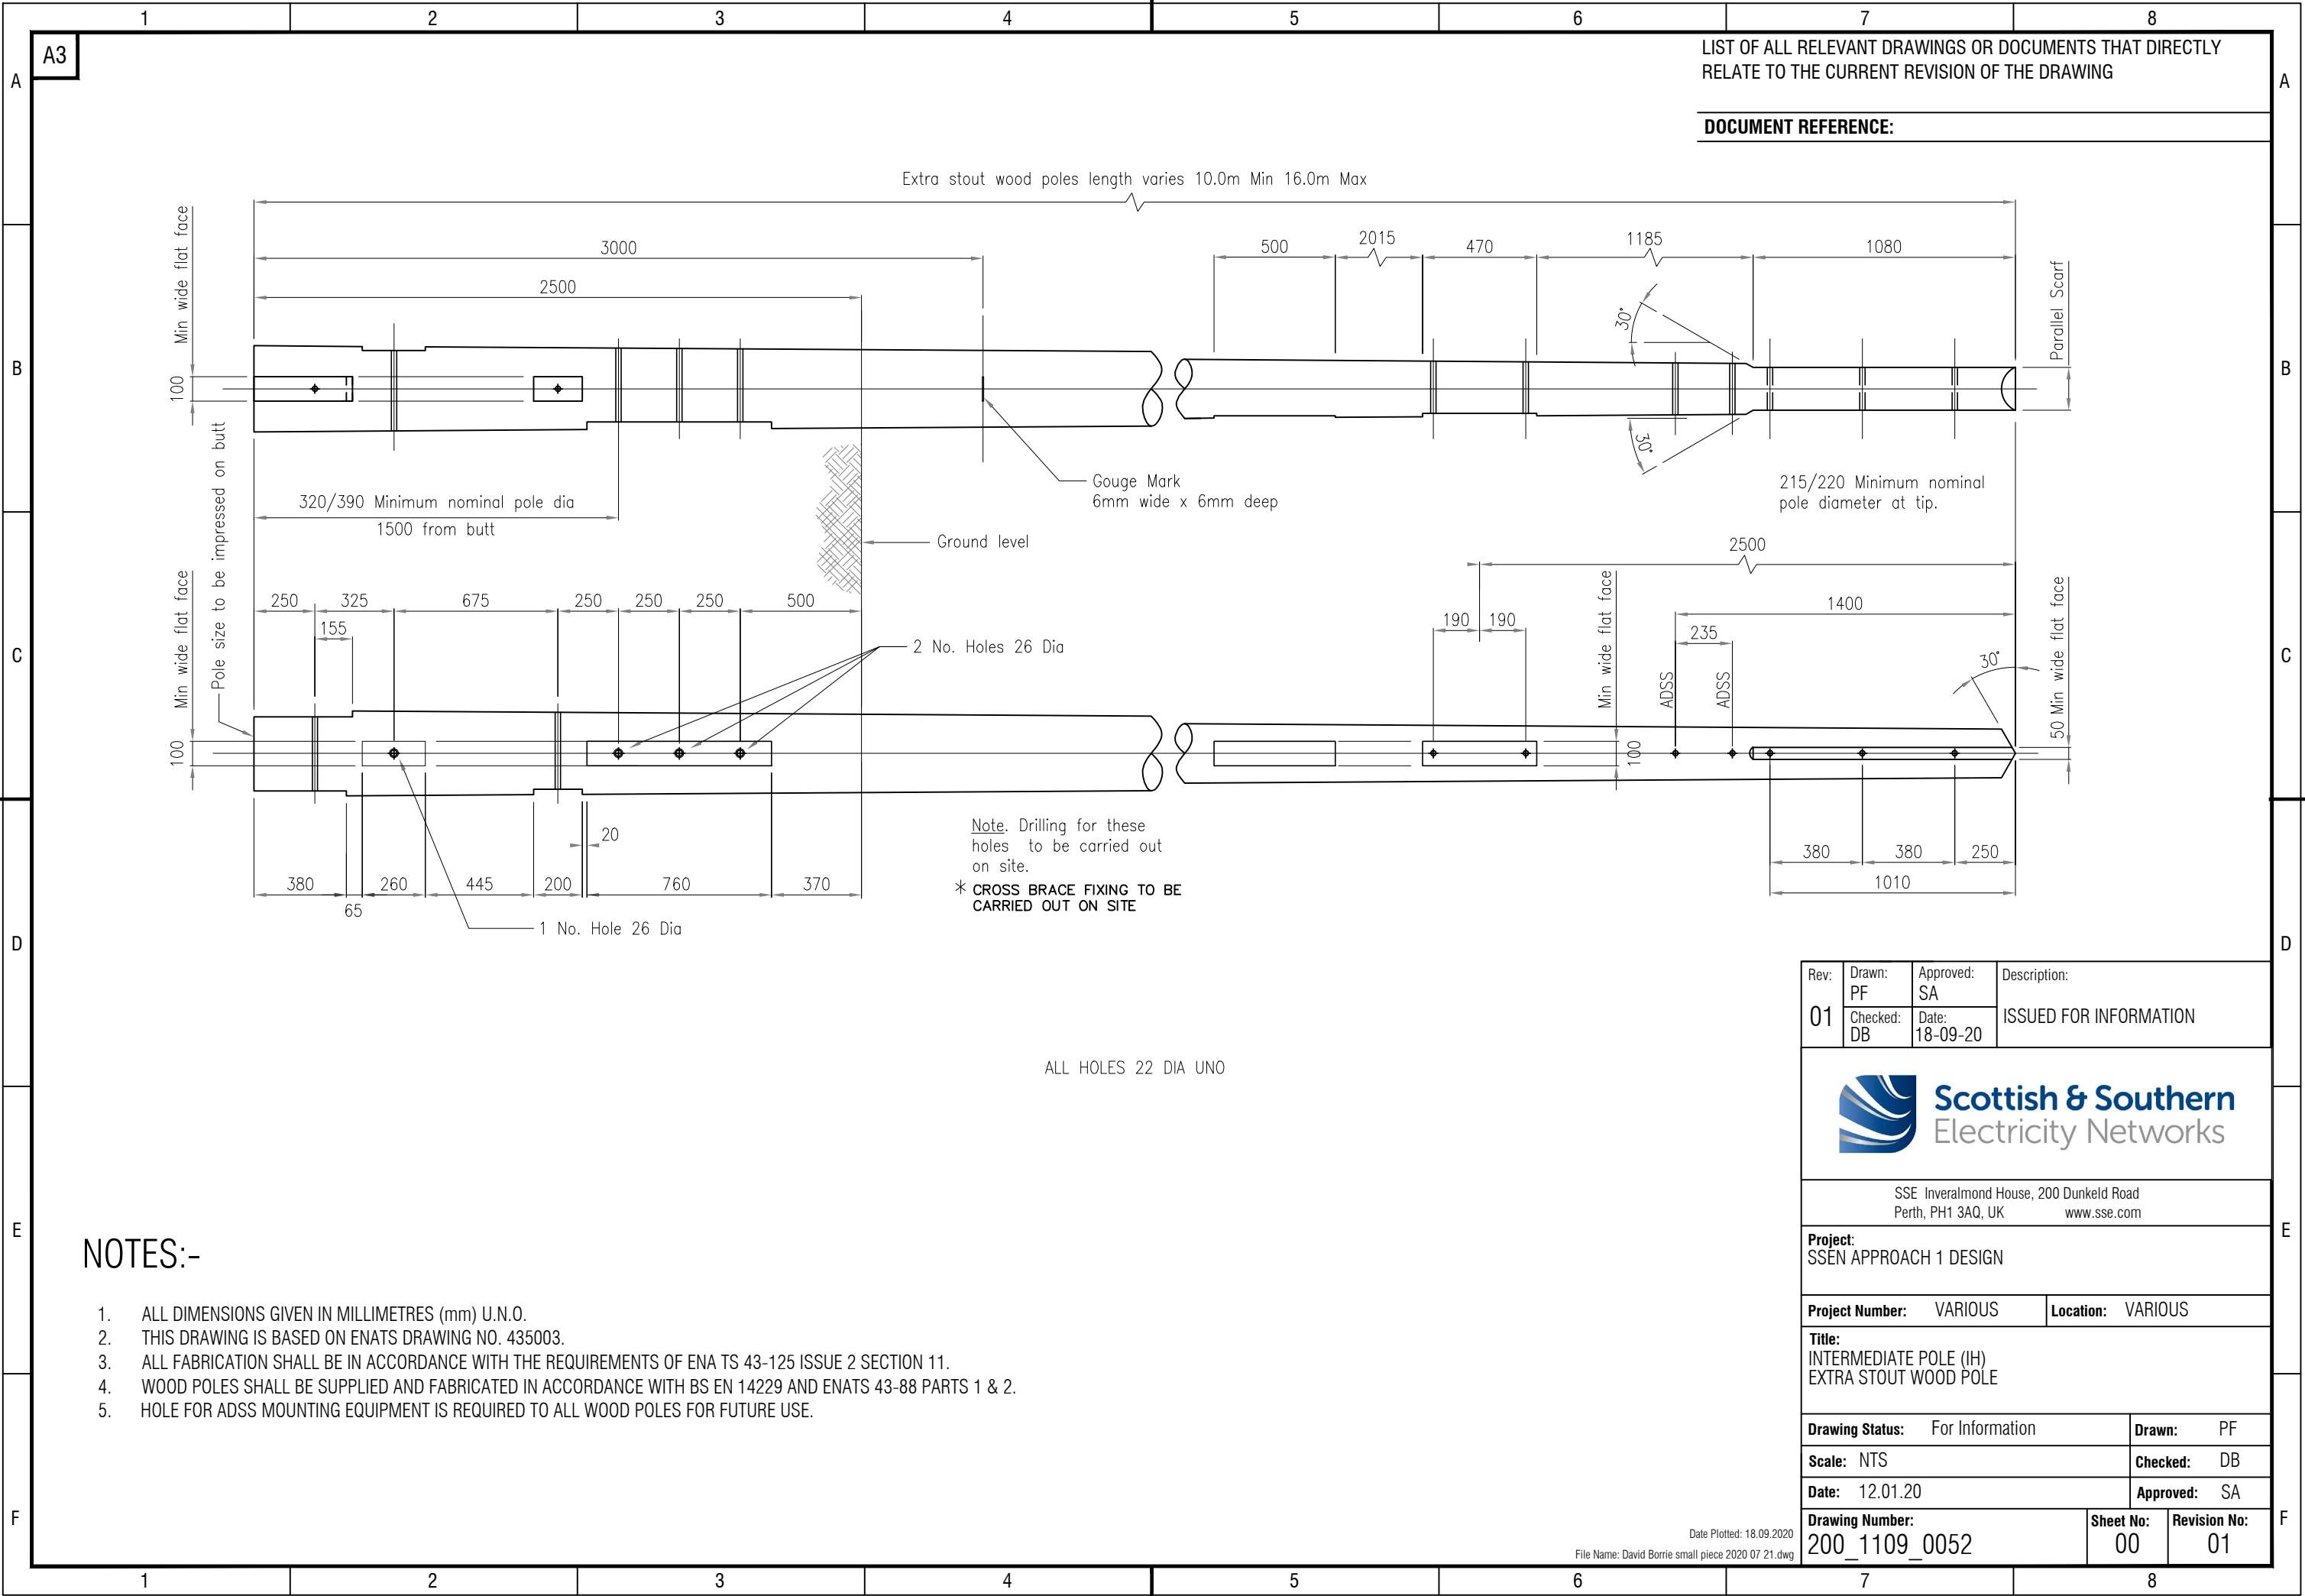

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. THIS DRAWING IS BASED ON ENATS DRAWING NO. 435003.
3. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 SECTION 11.
4. WOOD POLES SHALL BE SUPPLIED AND FABRICATED IN ACCORDANCE WITH BS EN 14229 AND ENATS 43-88 PARTS 1 & 2.
5. HOLE FOR ADSS MOUNTING EQUIPMENT IS REQUIRED TO ALL WOOD POLES FOR FUTURE USE.

Rev:	Drawn:	Approved:	Description:
01	PF	SA	ISSUED FOR INFORMATION
	Checked: DB	Date: 18-09-20	
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: INTERMEDIATE POLE (IH) EXTRA STOUT WOOD POLE			
Drawing Status: For Information			Drawn: PF
Scale: NTS			Checked: DB
Date: 12.01.20			Approved: SA
Drawing Number: 200_1109_0052			Sheet No: 00
			Revision No: 01

Date Plotted: 18.09.2020
File Name: David Borrie small piece 2020 07 21.dwg