


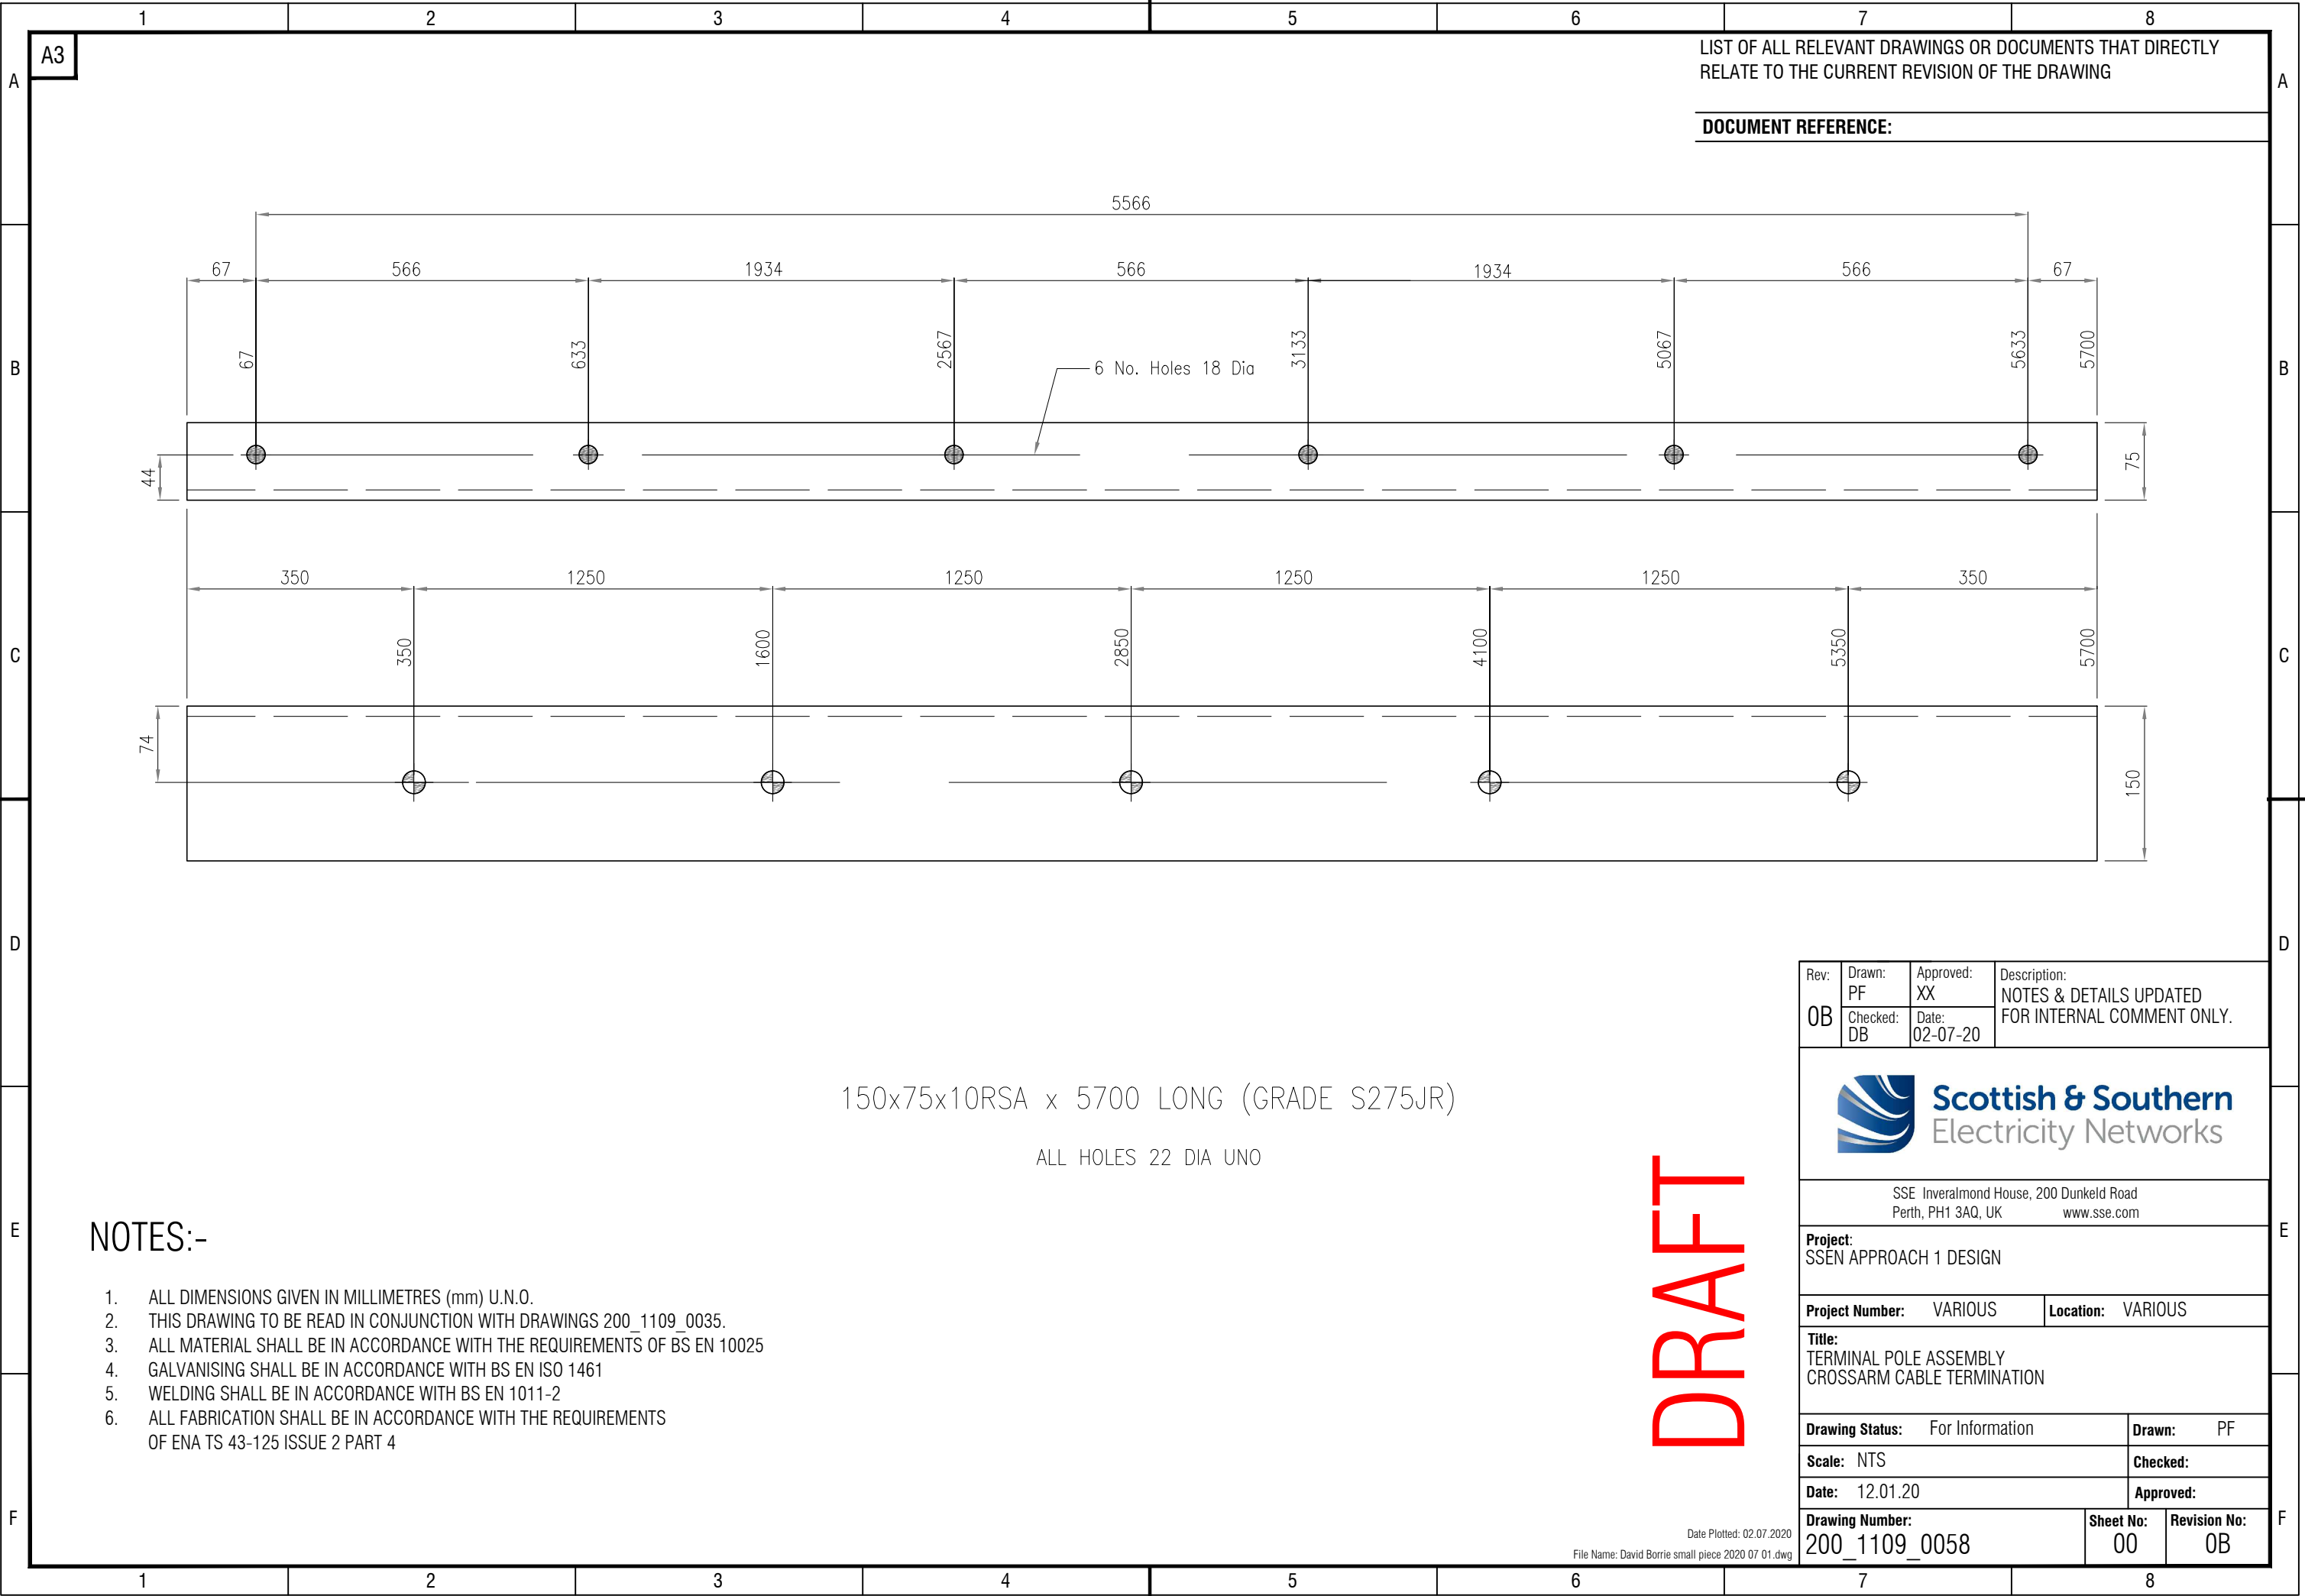

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

150x75x10RSA x 5700 LONG (GRADE S275JR)

ALL HOLES 22 DIA UNO

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0035.
- 3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
- 4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
- 6. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4

Rev: 0B	Drawn: PF	Approved: XX	Description: NOTES & DETAILS UPDATED FOR INTERNAL COMMENT ONLY.
	Checked: DB	Date: 02-07-20	
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: TERMINAL POLE ASSEMBLY CROSSARM CABLE TERMINATION			
Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked:	
Date: 12.01.20		Approved:	
Drawing Number: 200_1109_0058		Sheet No: 00	Revision No: 0B