


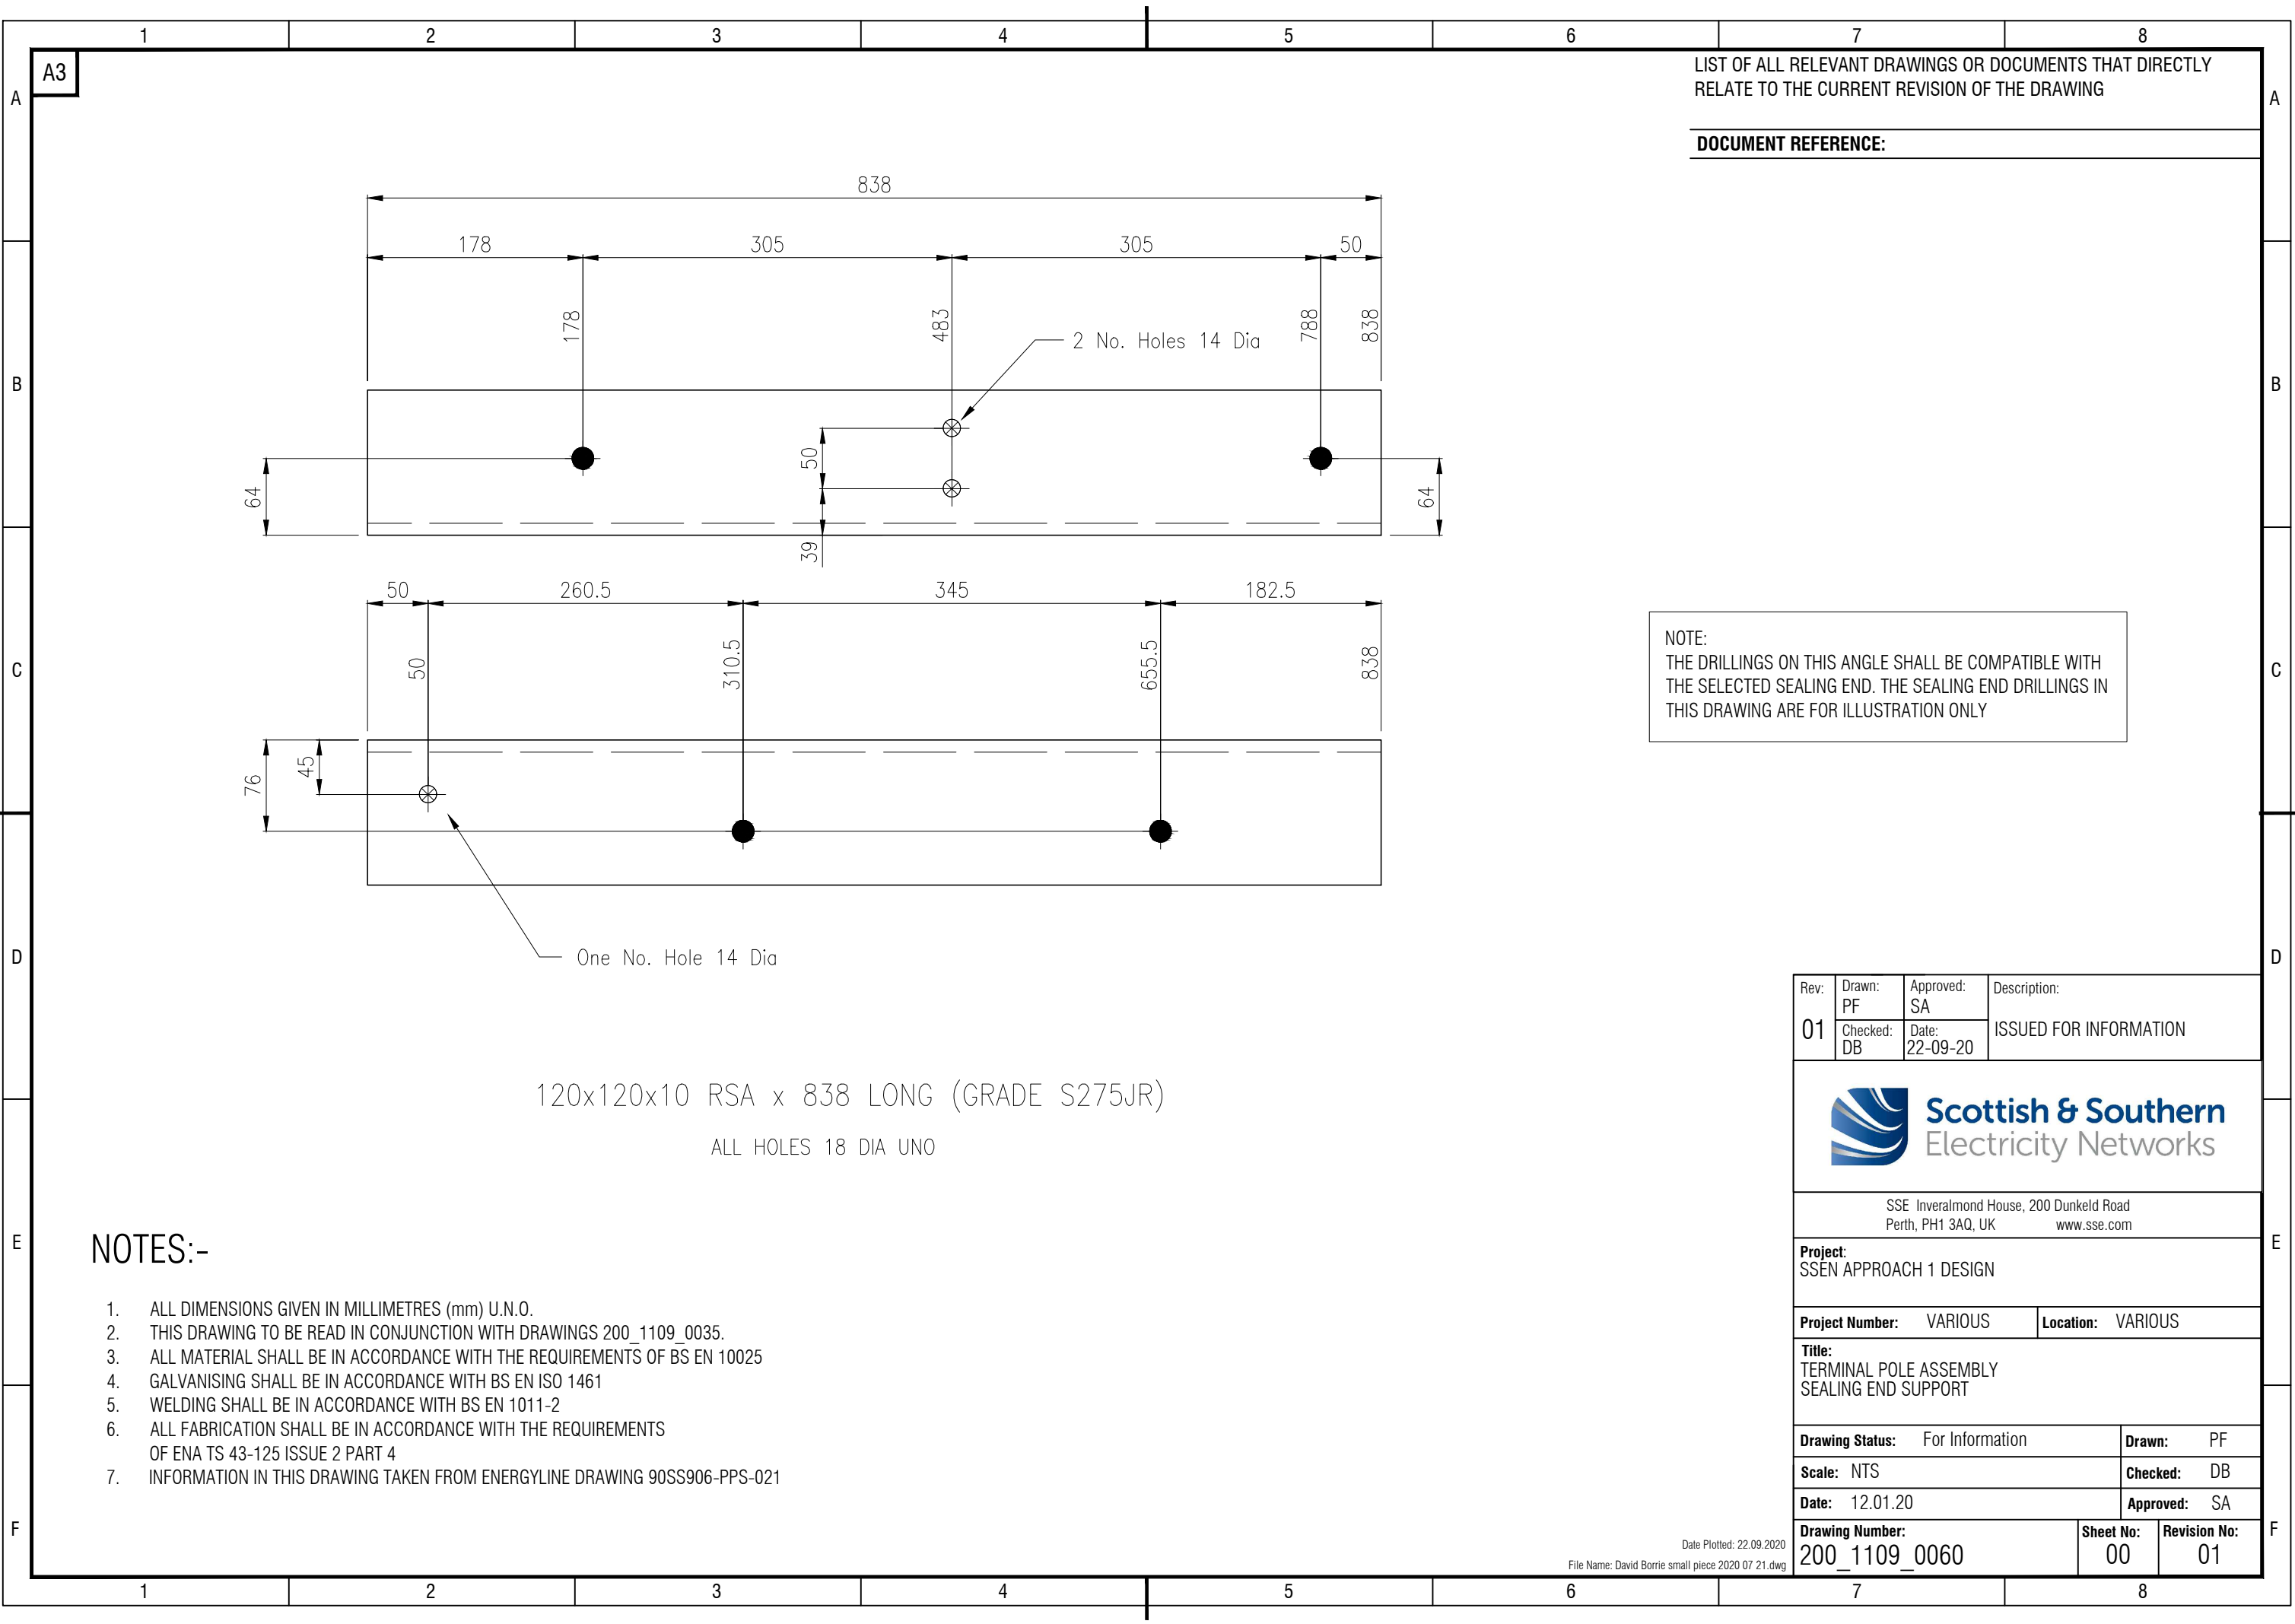

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTE:
THE DRILLINGS ON THIS ANGLE SHALL BE COMPATIBLE WITH THE SELECTED SEALING END. THE SEALING END DRILLINGS IN THIS DRAWING ARE FOR ILLUSTRATION ONLY

120x120x10 RSA x 838 LONG (GRADE S275JR)
ALL HOLES 18 DIA UNO

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0035.
3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
6. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4
7. INFORMATION IN THIS DRAWING TAKEN FROM ENERGYLINE DRAWING 90SS906-PPS-021

Rev:	Drawn: PF	Approved: SA	Description:
01	Checked: DB	Date: 22-09-20	ISSUED FOR INFORMATION
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UKwww.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: TERMINAL POLE ASSEMBLY SEALING END SUPPORT			
Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked: DB	
Date: 12.01.20		Approved: SA	
Drawing Number: 200_1109_0060		Sheet No: 00	Revision No: 01