


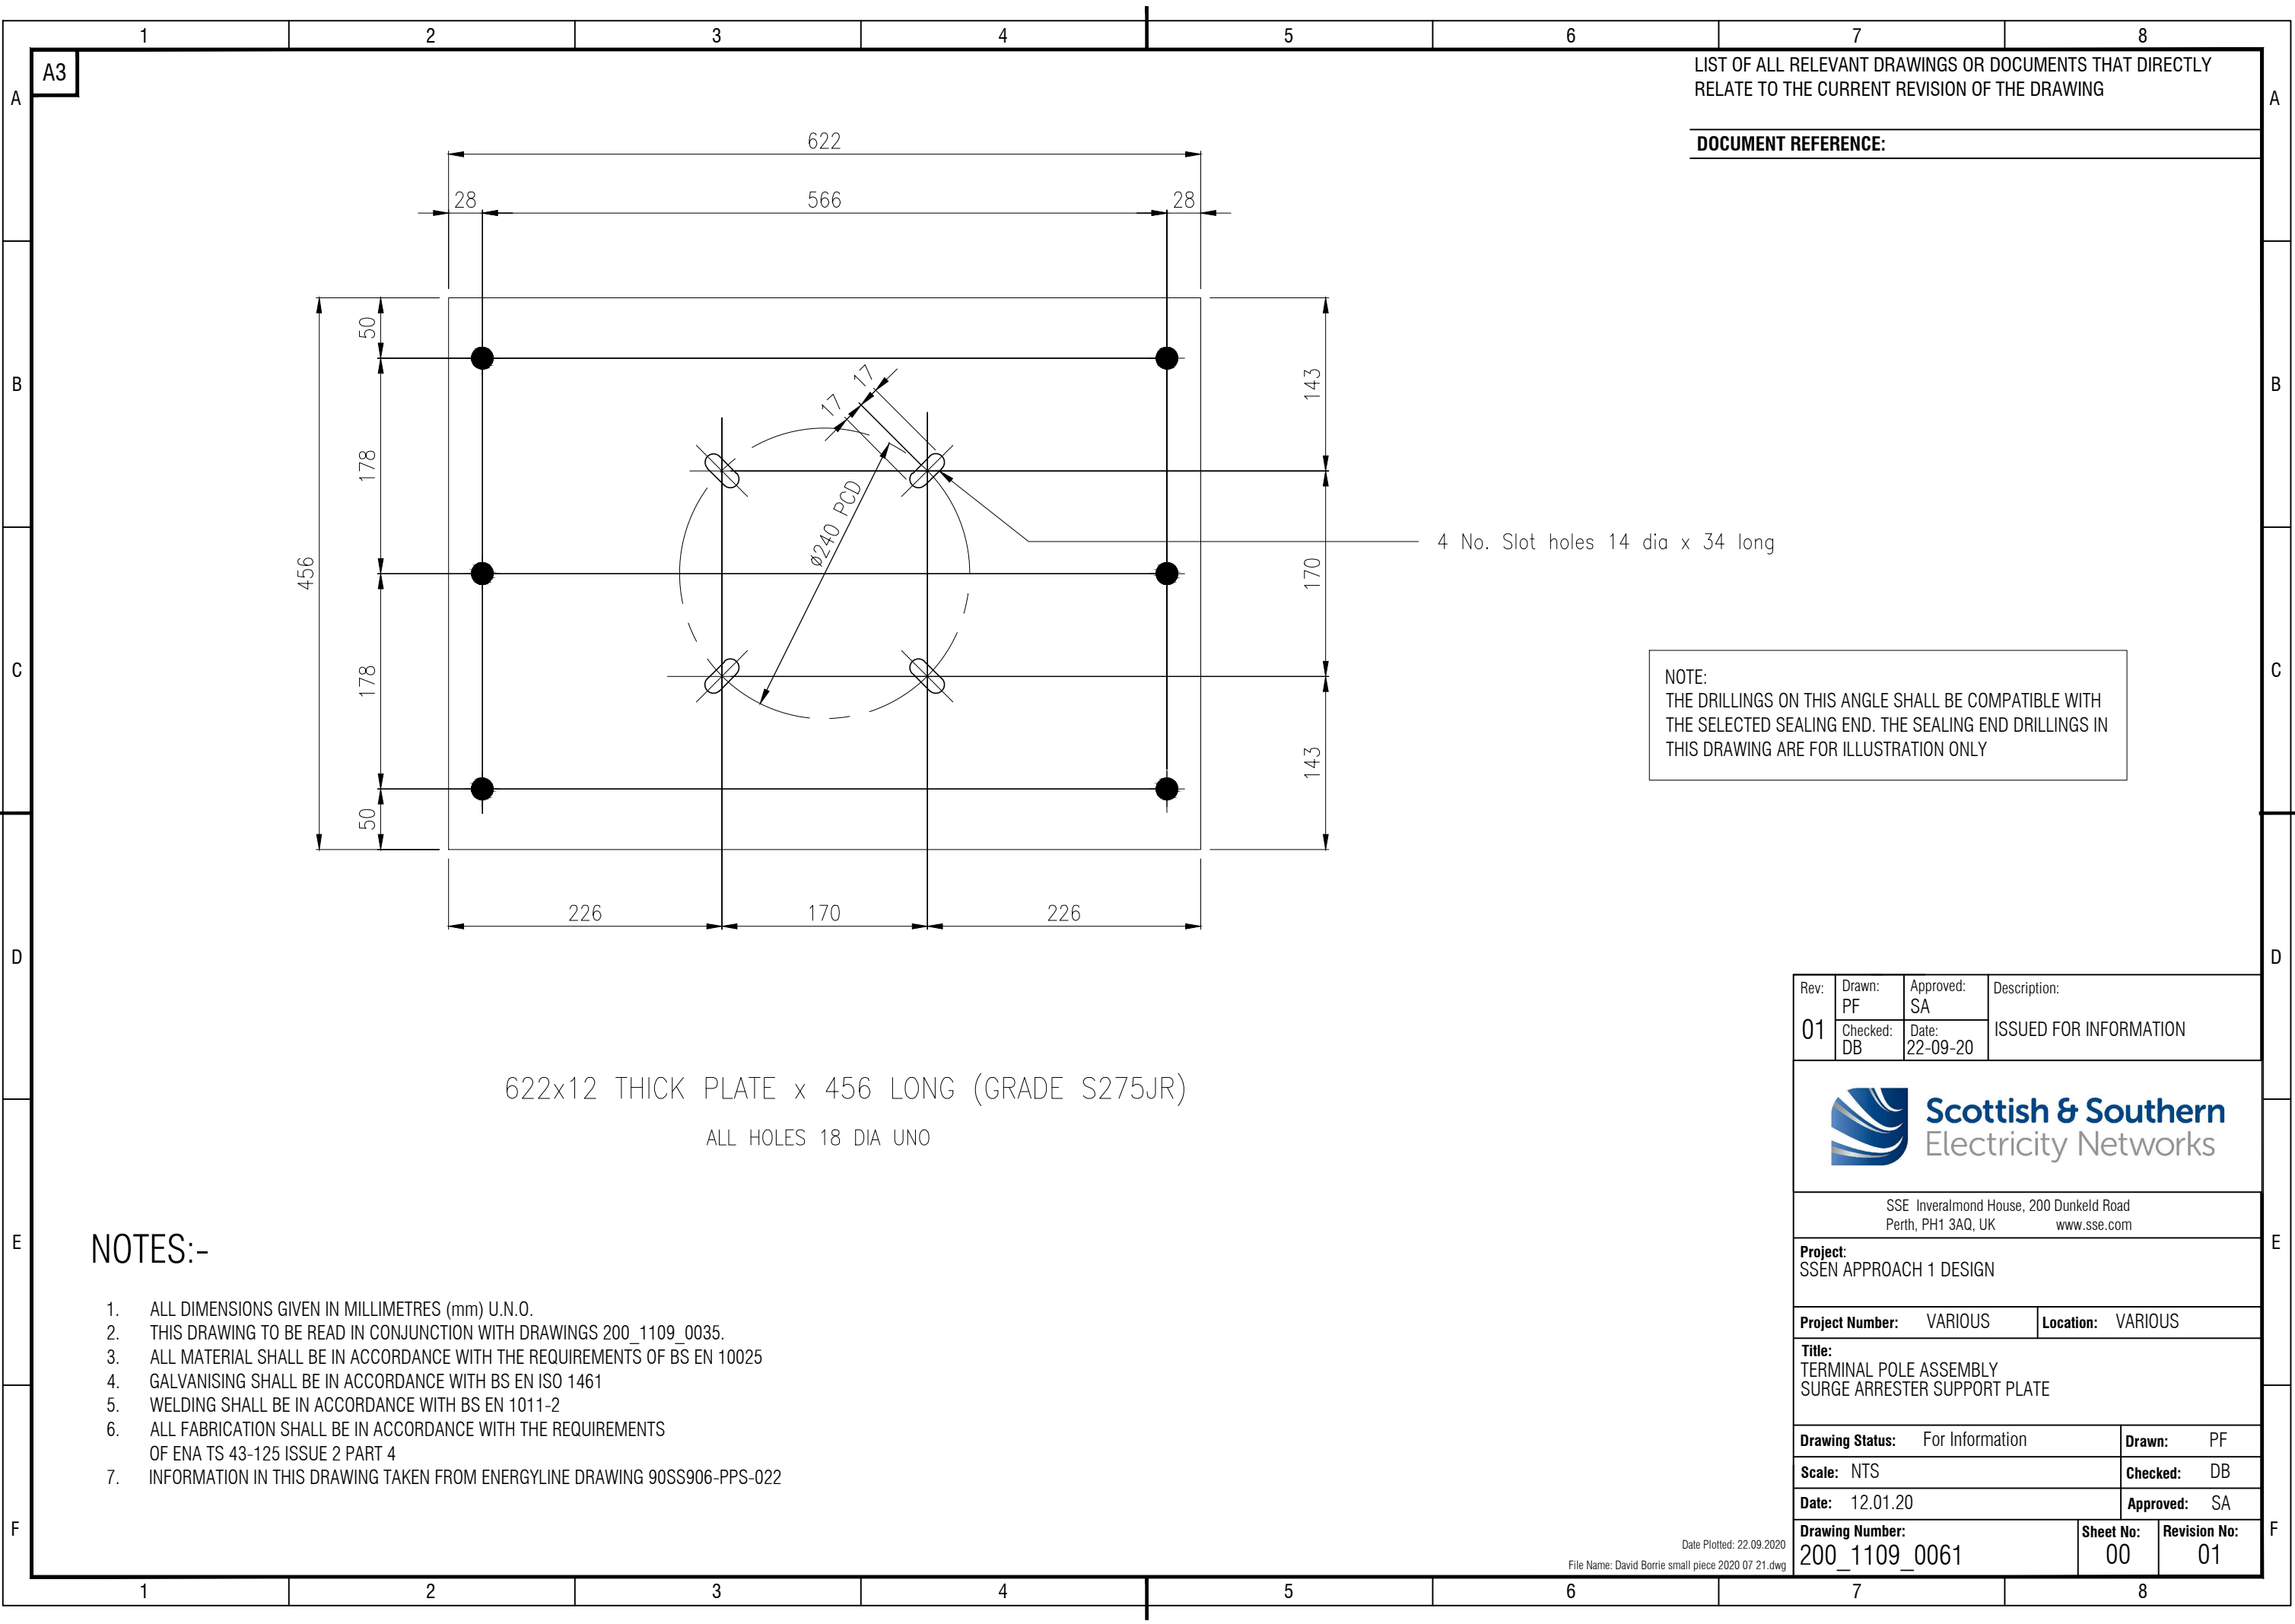

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

4 No. Slot holes 14 dia x 34 long

NOTE:
THE DRILLINGS ON THIS ANGLE SHALL BE COMPATIBLE WITH THE SELECTED SEALING END. THE SEALING END DRILLINGS IN THIS DRAWING ARE FOR ILLUSTRATION ONLY

622x12 THICK PLATE x 456 LONG (GRADE S275JR)
ALL HOLES 18 DIA UNO

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0035.
3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
6. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4
7. INFORMATION IN THIS DRAWING TAKEN FROM ENERGYLINE DRAWING 90SS906-PPS-022

Rev:	Drawn: PF	Approved: SA	Description: ISSUED FOR INFORMATION
01	Checked: DB	Date: 22-09-20	

			
Scottish & Southern Electricity Networks			

SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
--	--	--	--

Project: SSEN APPROACH 1 DESIGN			
---	--	--	--

Project Number: VARIOUS		Location: VARIOUS	
--------------------------------	--	--------------------------	--

Title: TERMINAL POLE ASSEMBLY SURGE ARRESTER SUPPORT PLATE			
---	--	--	--

Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked: DB	
Date: 12.01.20		Approved: SA	

Drawing Number: 200_1109_0061		Sheet No: 00	Revision No: 01
---	--	------------------------	---------------------------