


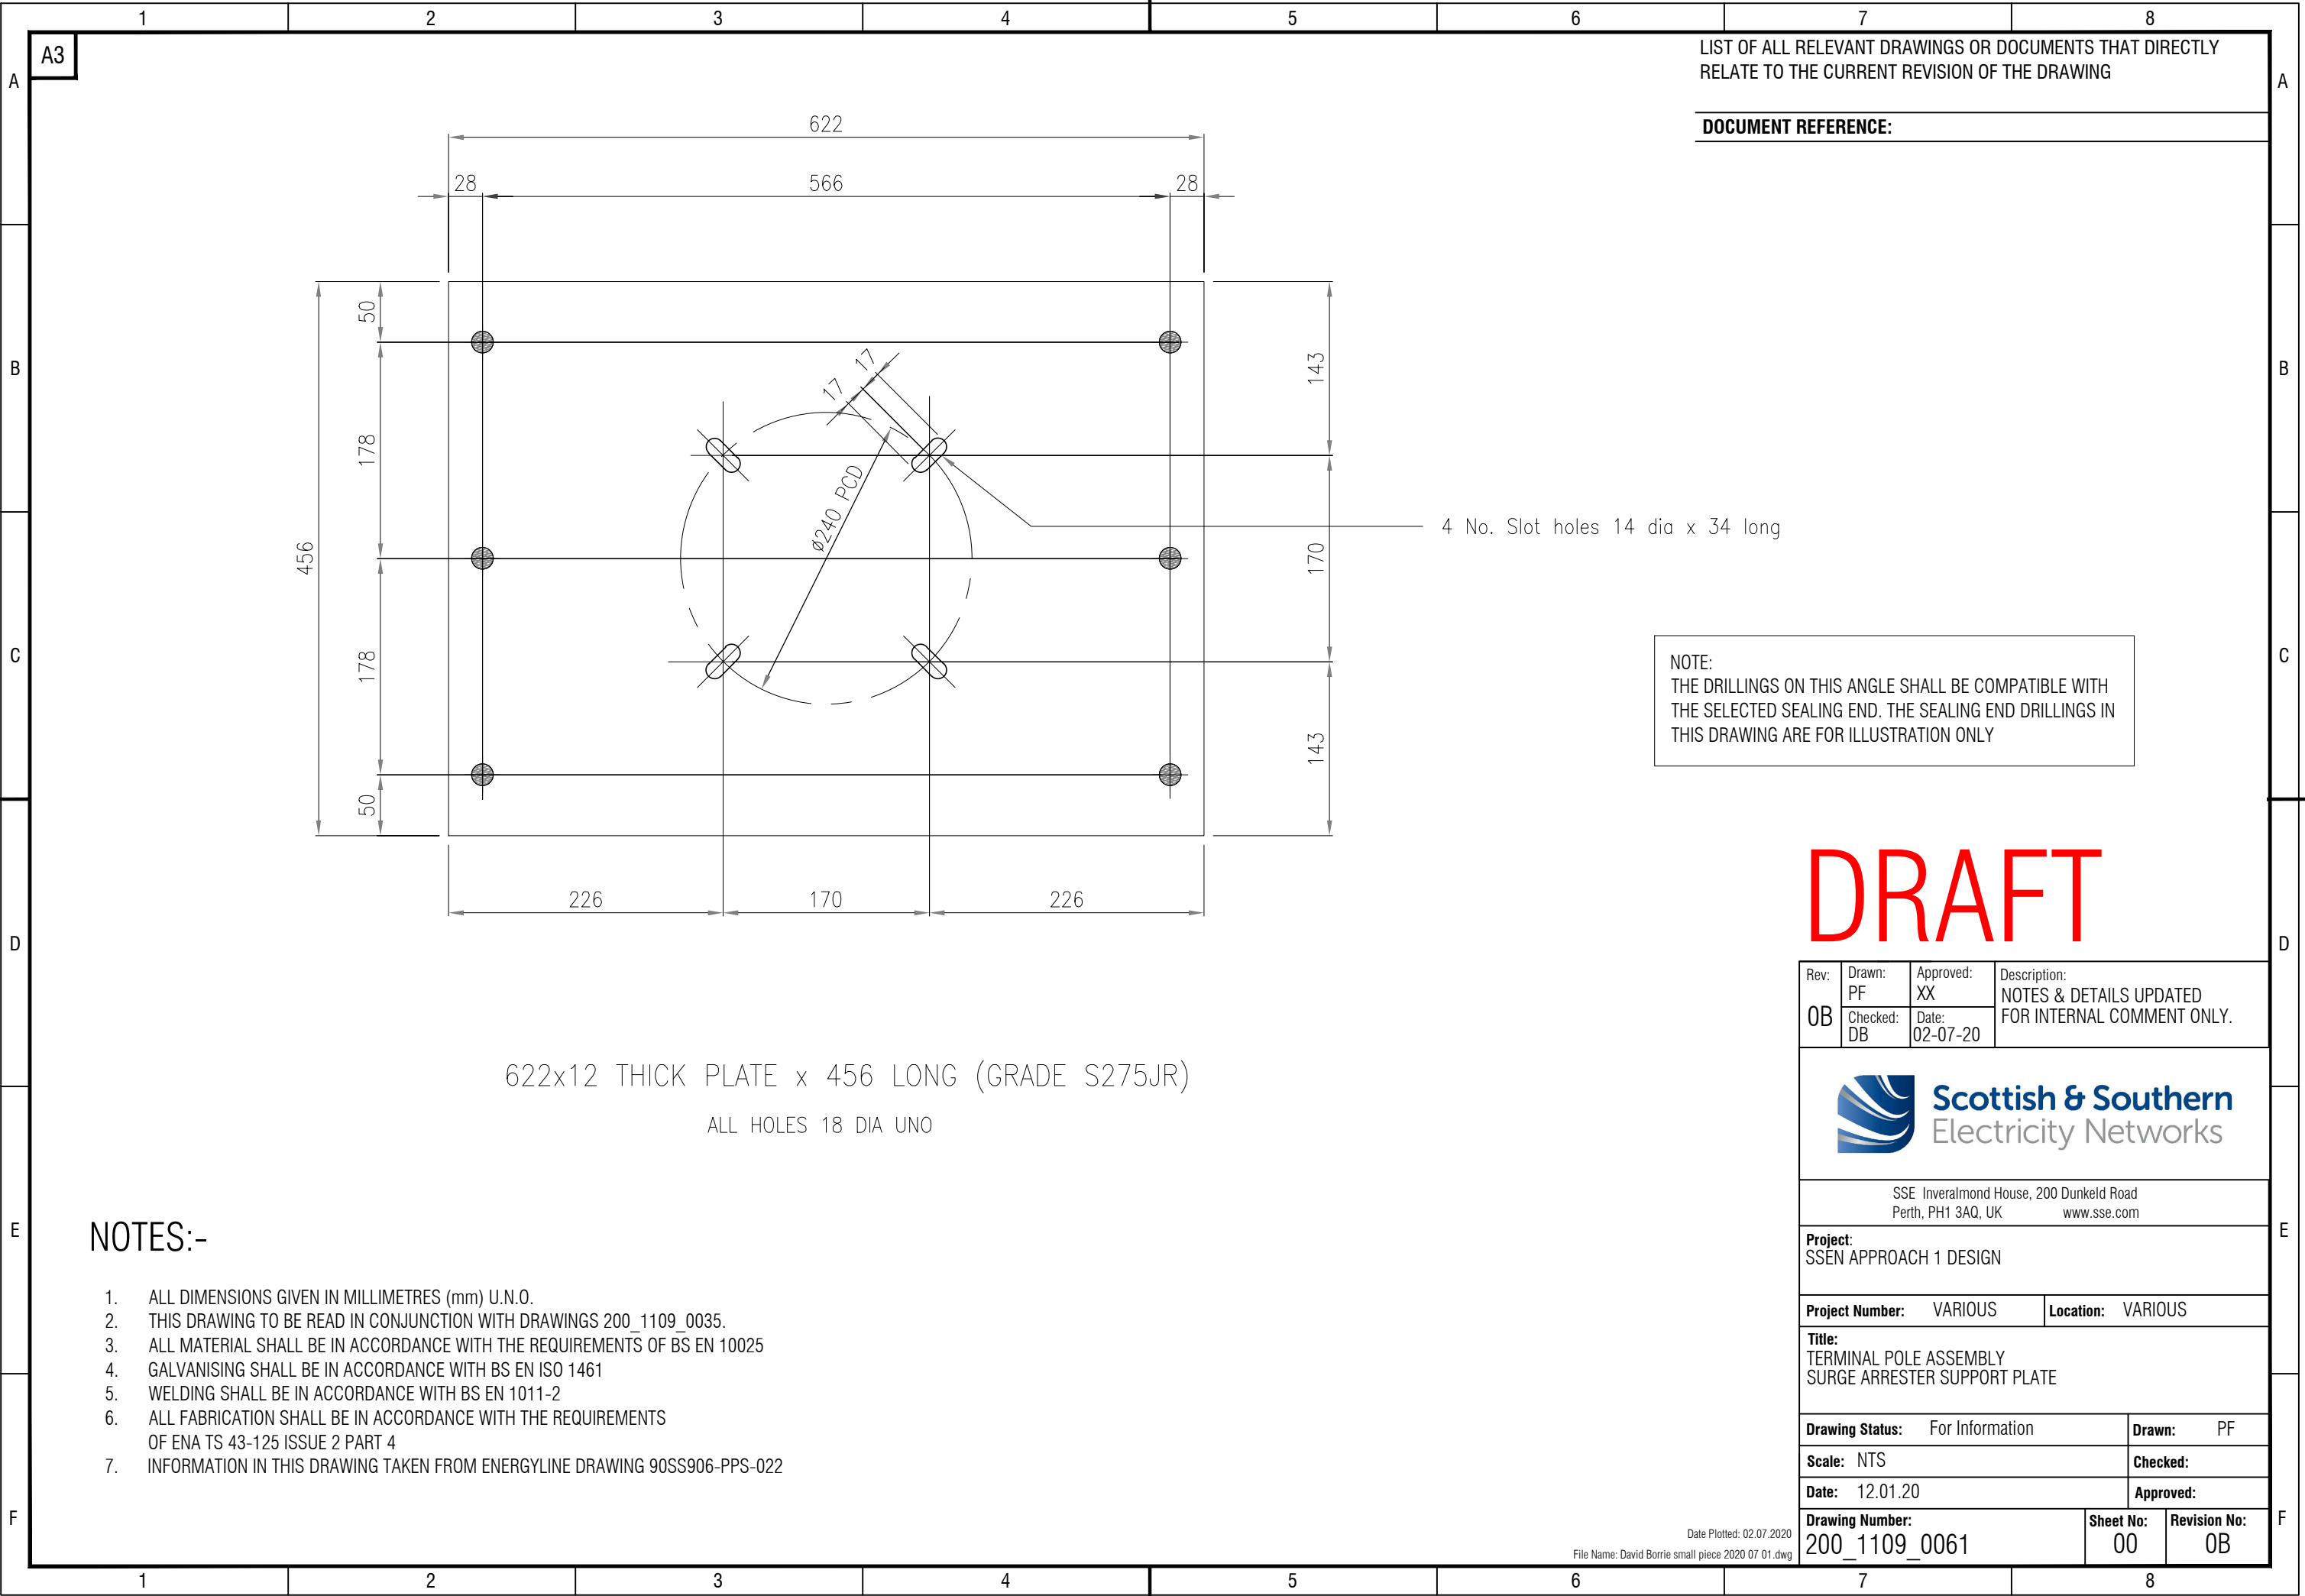

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTE:
THE DRILLINGS ON THIS ANGLE SHALL BE COMPATIBLE WITH THE SELECTED SEALING END. THE SEALING END DRILLINGS IN THIS DRAWING ARE FOR ILLUSTRATION ONLY

DRAFT

622x12 THICK PLATE x 456 LONG (GRADE S275JR)
ALL HOLES 18 DIA UNO

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS 200_1109_0035.
- 3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
- 4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
- 6. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4
- 7. INFORMATION IN THIS DRAWING TAKEN FROM ENERGYLINE DRAWING 90SS906-PPS-022

Rev:	Drawn:	Approved:	Description: NOTES & DETAILS UPDATED FOR INTERNAL COMMENT ONLY.
0B	PF	XX	
	Checked: DB	Date: 02-07-20	
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: TERMINAL POLE ASSEMBLY SURGE ARRESTER SUPPORT PLATE			
Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked:	
Date: 12.01.20		Approved:	
Drawing Number: 200_1109_0061		Sheet No: 00	Revision No: 0B