


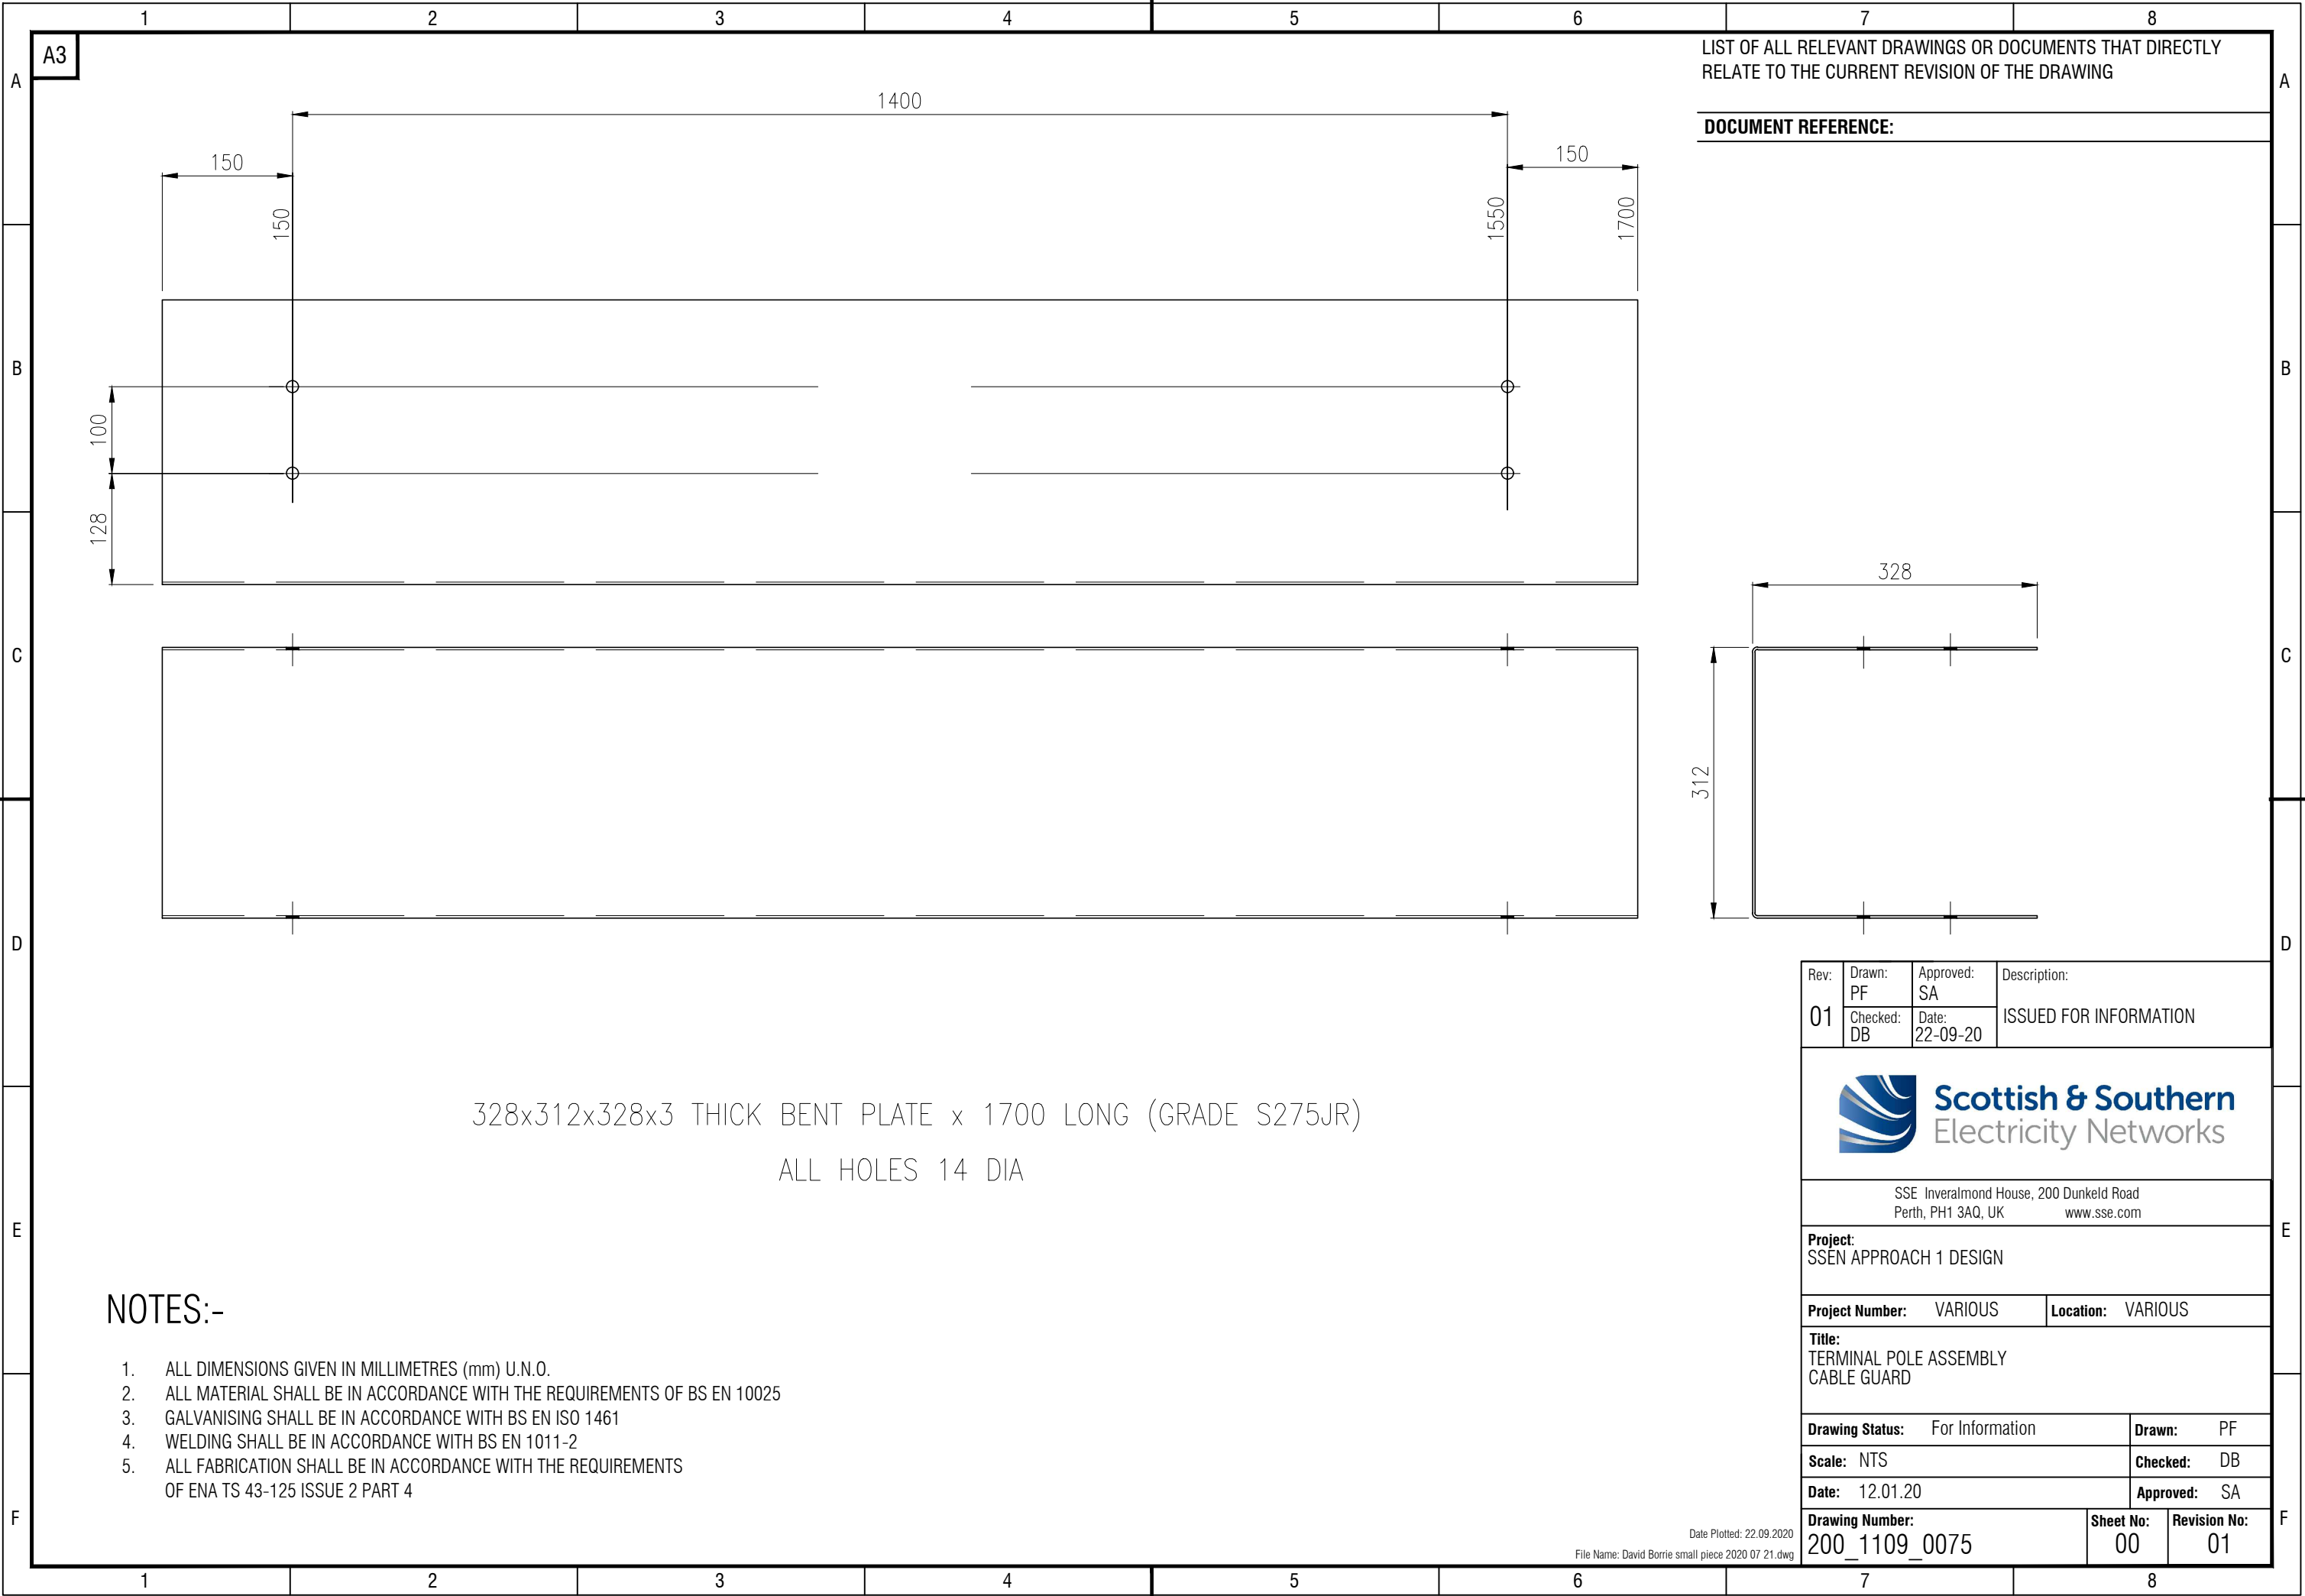

LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

328x312x328x3 THICK BENT PLATE x 1700 LONG (GRADE S275JR)
ALL HOLES 14 DIA

NOTES:-

- 1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
- 2. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025
- 3. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
- 4. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
- 5. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 PART 4

Rev:	Drawn:	Approved:	Description:
01	PF	SA	ISSUED FOR INFORMATION
	Checked: DB	Date: 22-09-20	

		Scottish & Southern Electricity Networks
---	--	--

SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com	
--	--

Project: SSEN APPROACH 1 DESIGN	
---	--

Project Number:	VARIOUS	Location:	VARIOUS
------------------------	---------	------------------	---------

Title: TERMINAL POLE ASSEMBLY CABLE GUARD	
--	--

Drawing Status:	For Information	Drawn:	PF
Scale:	NTS	Checked:	DB
Date:	12.01.20	Approved:	SA

Drawing Number: 200_1109_0075	Sheet No: 00	Revision No: 01
---	------------------------	---------------------------