


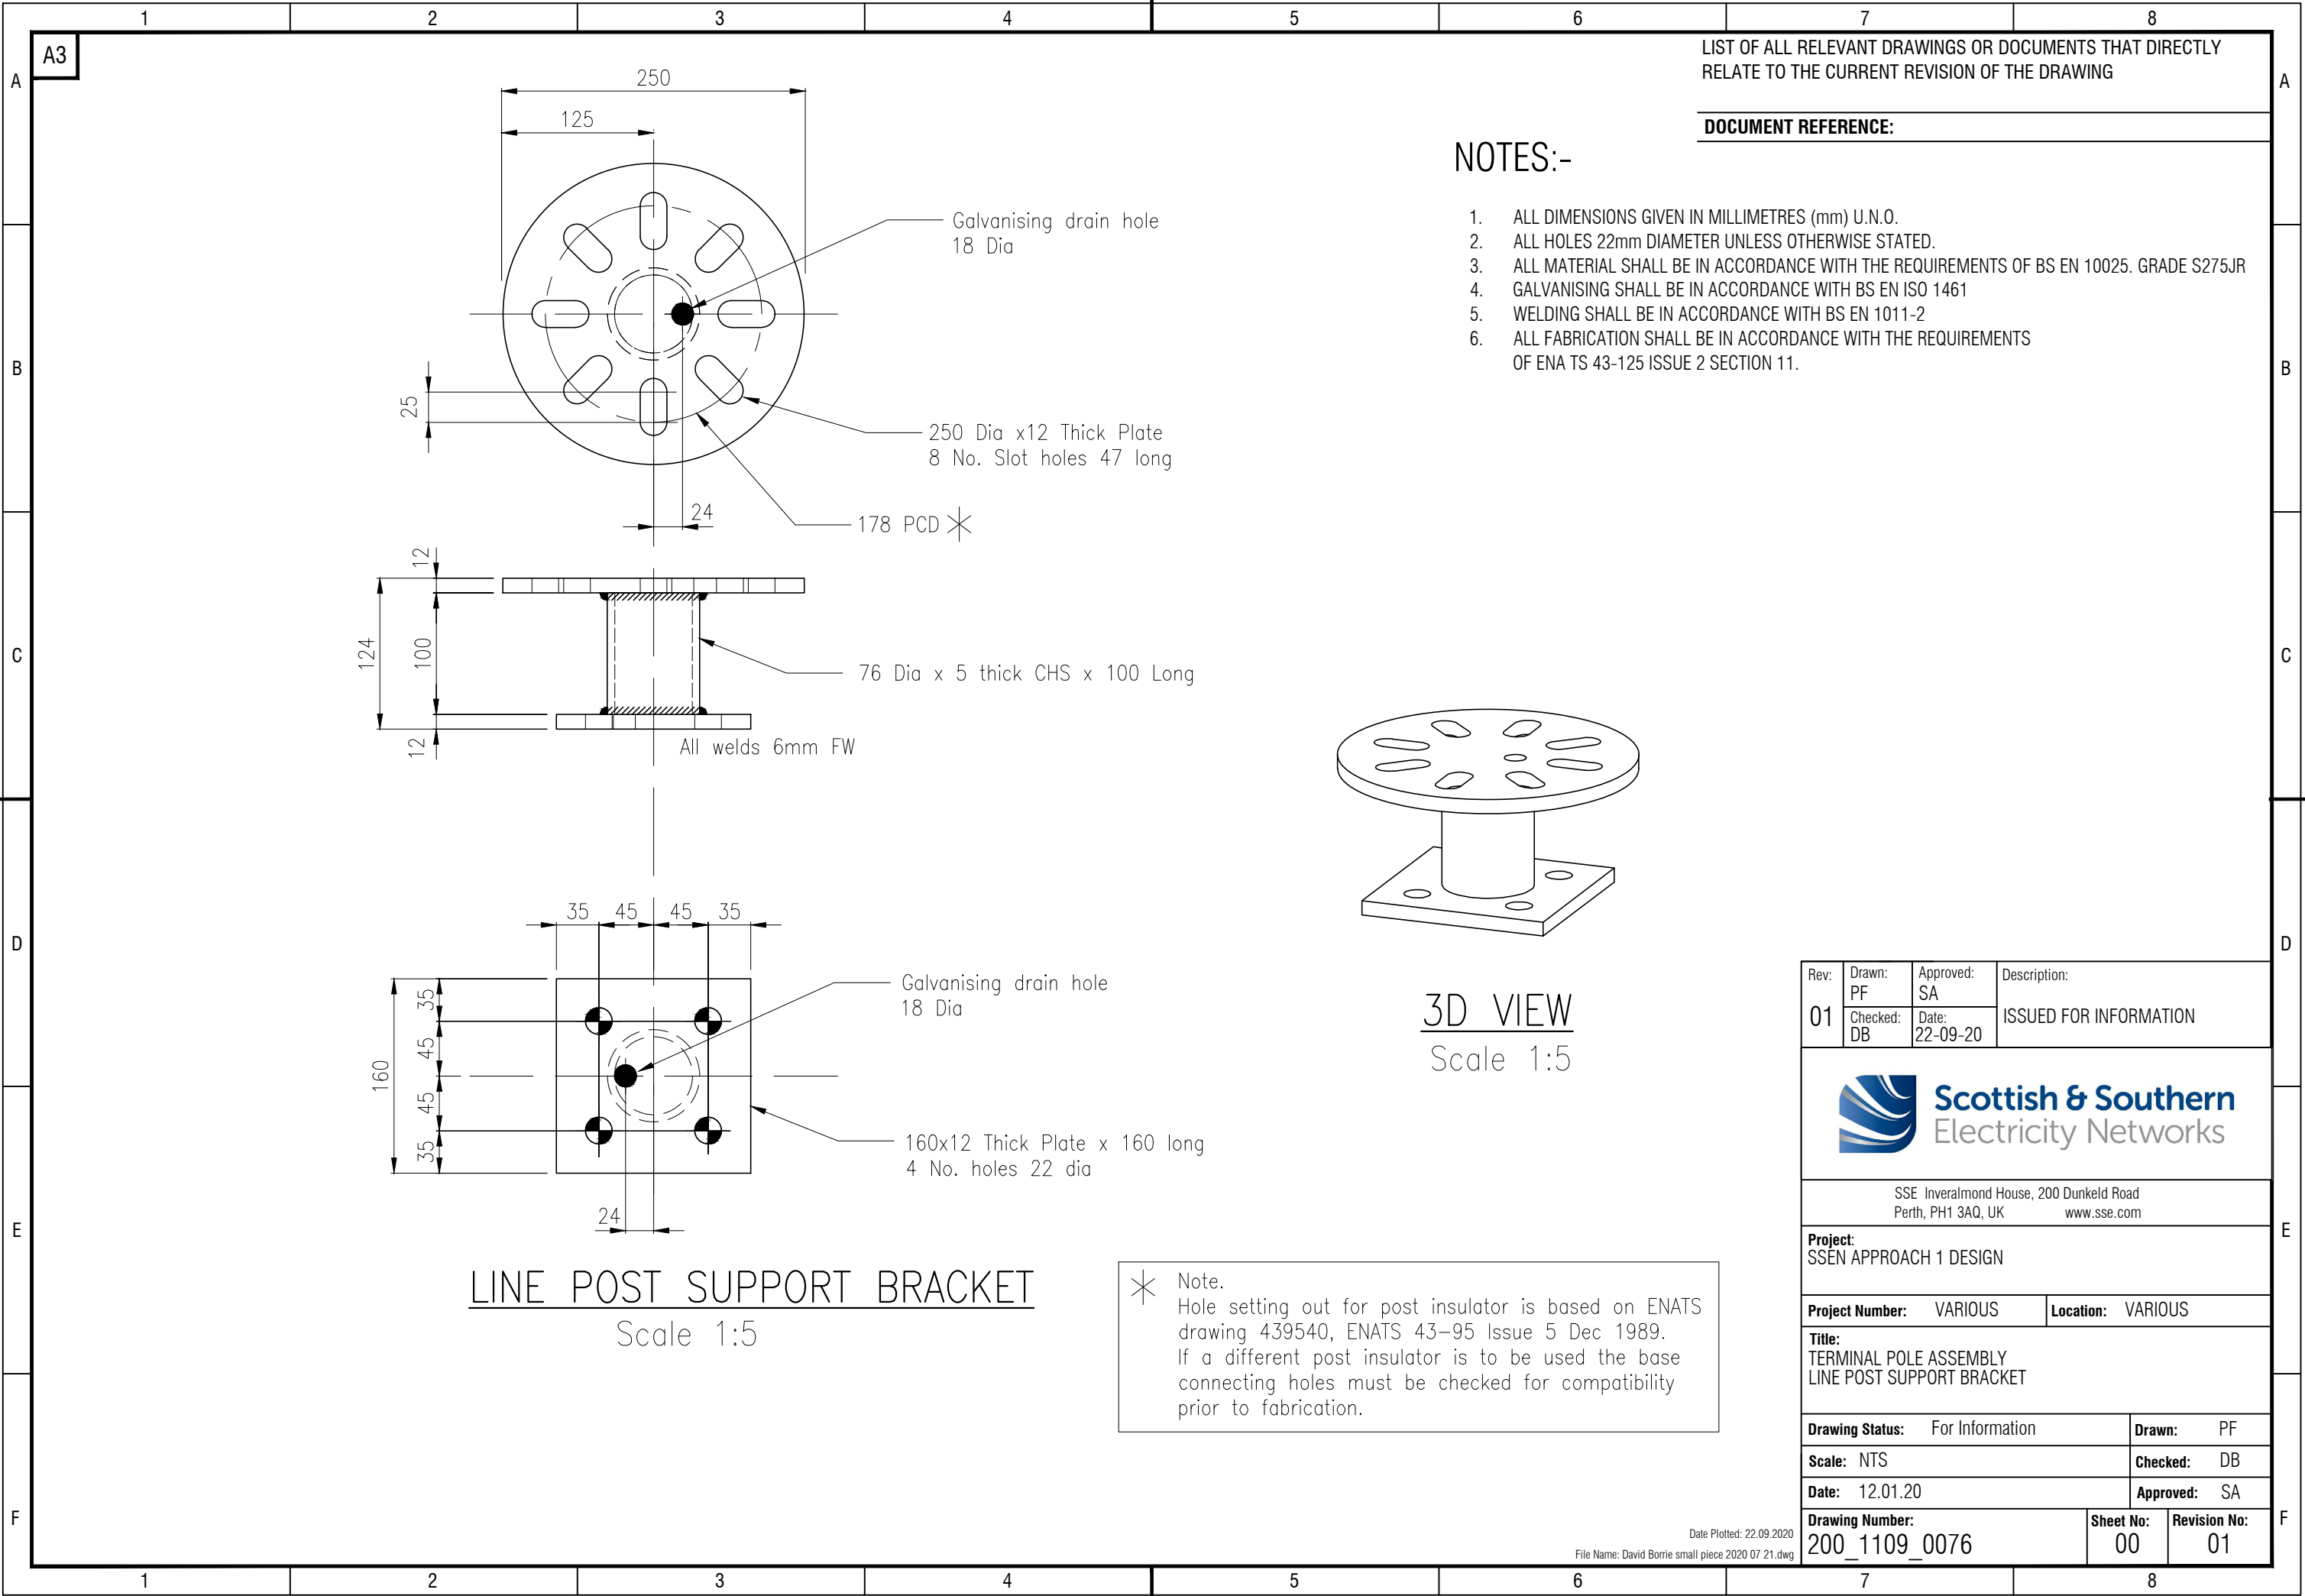


LIST OF ALL RELEVANT DRAWINGS OR DOCUMENTS THAT DIRECTLY RELATE TO THE CURRENT REVISION OF THE DRAWING

DOCUMENT REFERENCE:

NOTES:-

1. ALL DIMENSIONS GIVEN IN MILLIMETRES (mm) U.N.O.
2. ALL HOLES 22mm DIAMETER UNLESS OTHERWISE STATED.
3. ALL MATERIAL SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF BS EN 10025. GRADE S275JR
4. GALVANISING SHALL BE IN ACCORDANCE WITH BS EN ISO 1461
5. WELDING SHALL BE IN ACCORDANCE WITH BS EN 1011-2
6. ALL FABRICATION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ENA TS 43-125 ISSUE 2 SECTION 11.

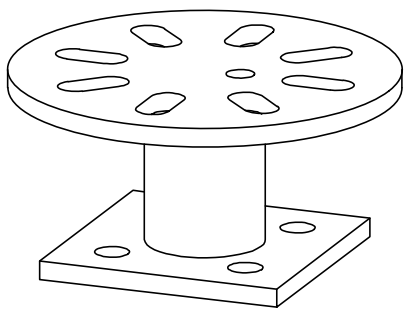

3D VIEW
Scale 1:5

LINE POST SUPPORT BRACKET
Scale 1:5

* Note.
Hole setting out for post insulator is based on ENATS drawing 439540, ENATS 43-95 Issue 5 Dec 1989.
If a different post insulator is to be used the base connecting holes must be checked for compatibility prior to fabrication.

Rev:	Drawn:	Approved:	Description:
01	PF	SA	ISSUED FOR INFORMATION
Checked:	Date:		
DB	22-09-20		
 Scottish & Southern Electricity Networks			
SSE Inveralmond House, 200 Dunkeld Road Perth, PH1 3AQ, UK www.sse.com			
Project: SSEN APPROACH 1 DESIGN			
Project Number: VARIOUS		Location: VARIOUS	
Title: TERMINAL POLE ASSEMBLY LINE POST SUPPORT BRACKET			
Drawing Status: For Information		Drawn: PF	
Scale: NTS		Checked: DB	
Date: 12.01.20		Approved: SA	
Drawing Number: 200_1109_0076		Sheet No: 00	Revision No: 01