




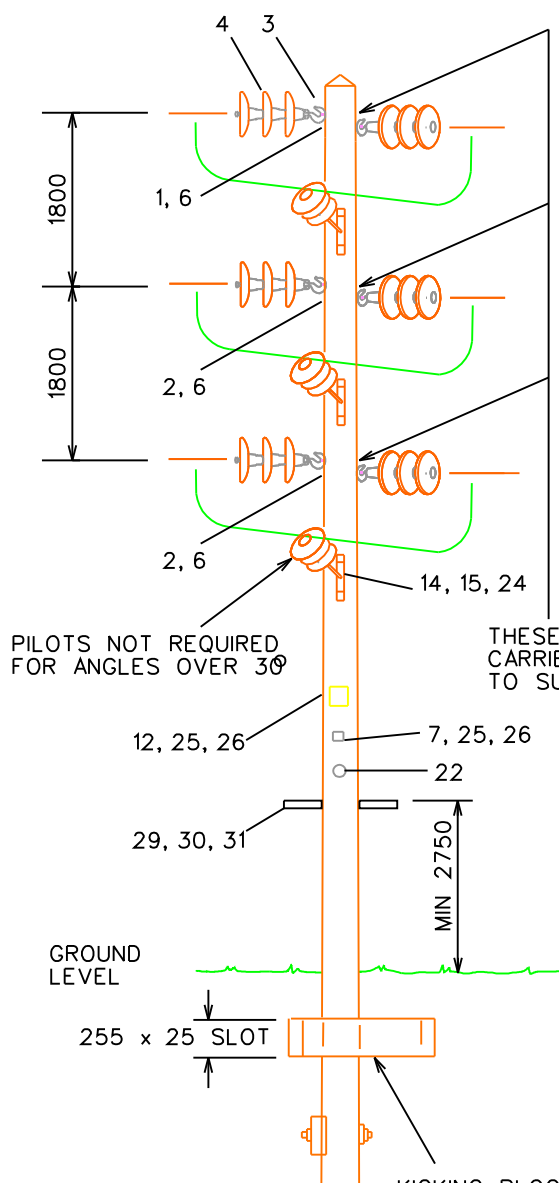

NO GO AREA
MIN SEPARATION
BETWEEN CIRCUITS

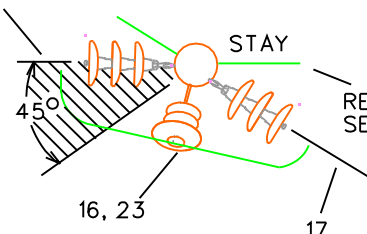

APPLICATION:- CONDUCTORS UP TO
AND INCLUDING 250 sq.mm ALUM. ALLOY
DEPENDANT ON POLE SIZE

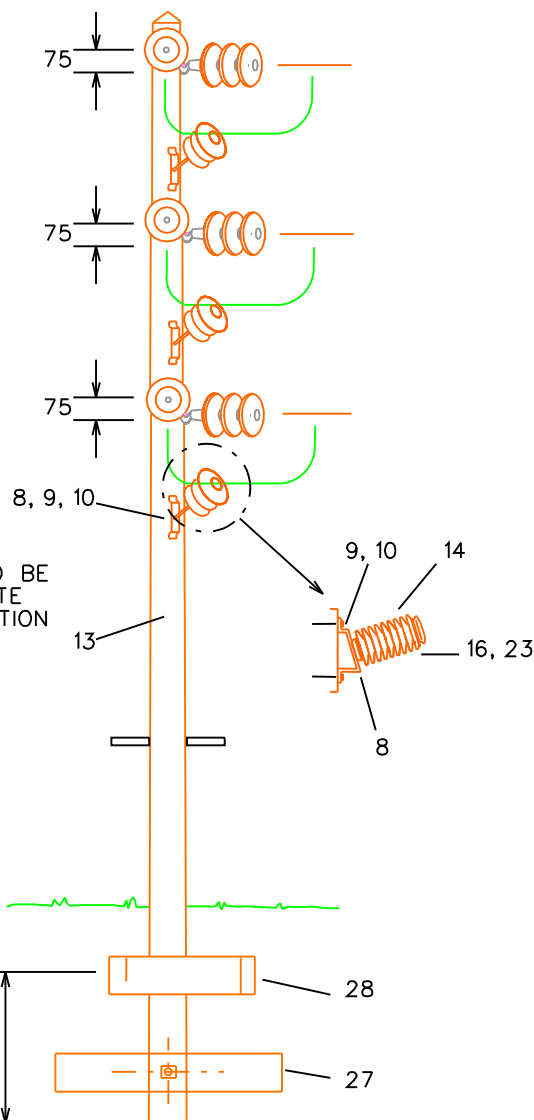

POLE LENGTH (m)	PLANTING DEPTH	DIM 'A'
UP TO 14	1800	1300
15 AND OVER	2100	1600

ITEM 13 :- POLE DRILLING AND SCARFING
ITEM 11 :- BONDING DETAILS SEE SCH E2009

SCHEDULE:- A2009
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF A2009

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc c 1992

SSE Power Distribution

**GENERAL ASSEMBLY 33kV SINGLE CIRCUIT
(1800 SPACING) SINGLE SECTION ANGLE
POLE. VERTICAL FORMATION. ABOVE 10°**

Scale:-	N.T.S.	Dimensions in millimetres
Drn. by:-	D.K.W.	Drawing no.
Tcd. by:-	D.K.M.	HO/37/2009 SHT 1 OF 3
Ckd. by:-	W.C.S.	C.A.D.Reference. HO2009.37
App. by:-	W.C.S.	

A4P

DATE PLOTTED \$\$\$\$date\$\$\$