


Original issue  
Date:- 14-10-92

ISSUE 1  
POLE MARKING &  
ROOFING ADDED.  
D.K.M. MAR 93

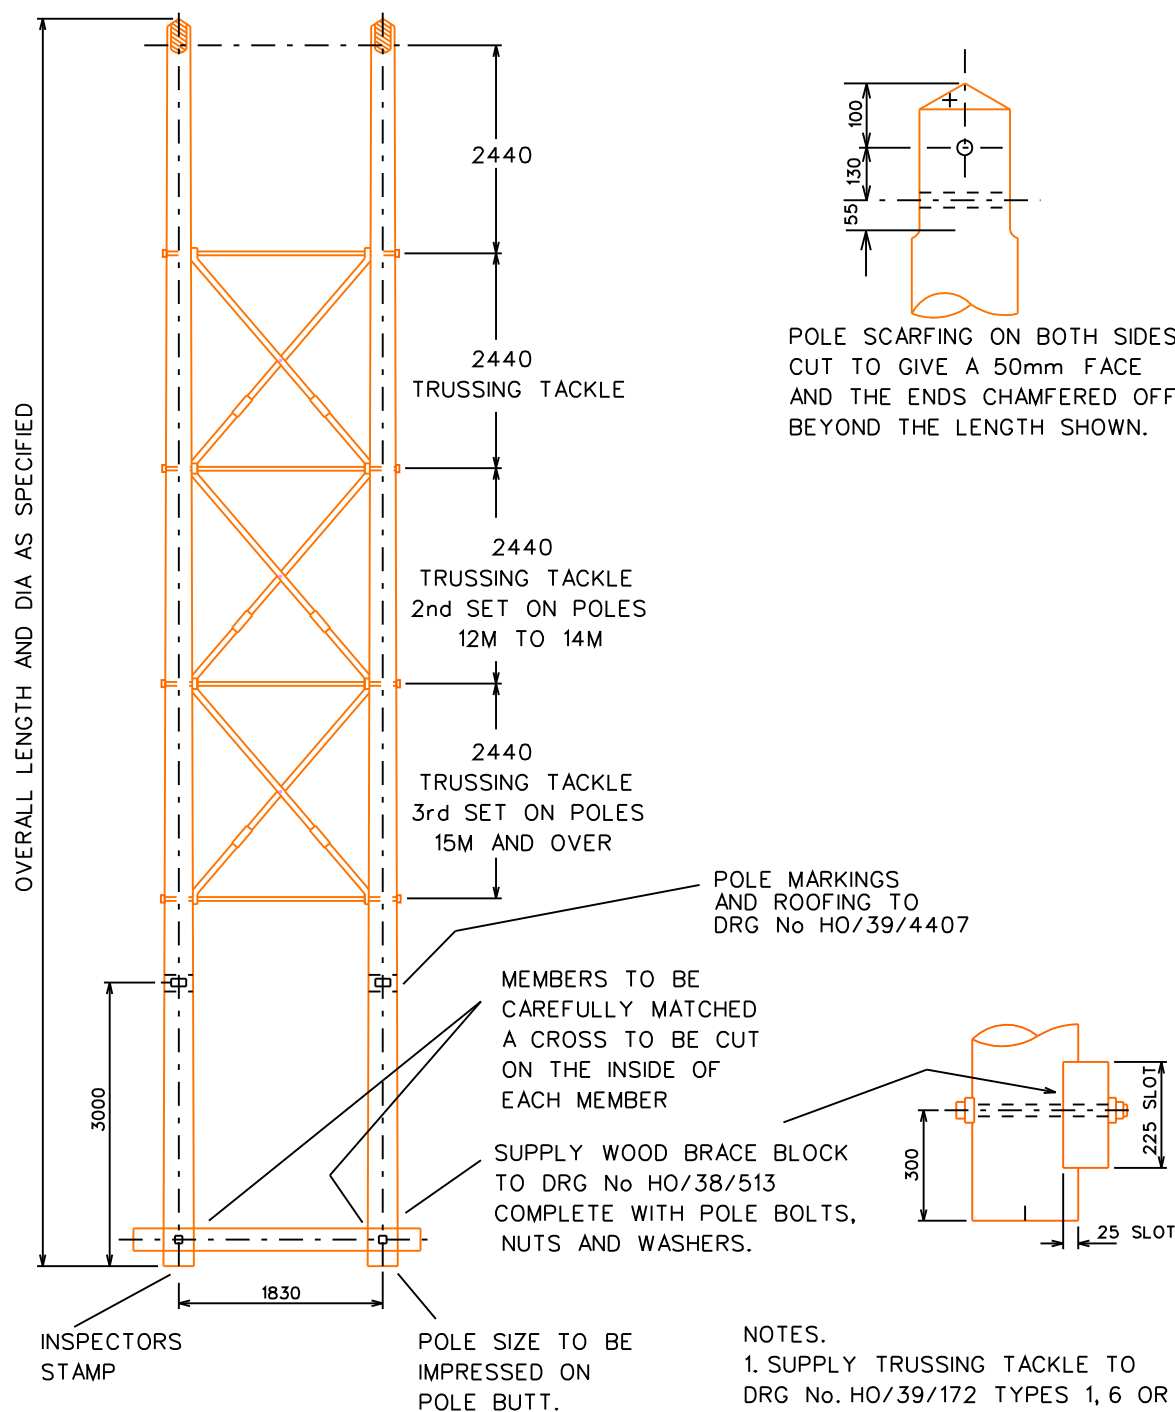

- NOTES.
1. SUPPLY TRUSSING TACKLE TO DRG No. HO/39/172 TYPES 1, 6 OR 11
  2. ALL DRILLING 22 DIA
- SCHEDULE:-P2010  
33kV HEAVY CONSTRUCTION  
SUPERSEDES DRG REF No:-A2010

FOR ASSEMBLY DRAWINGS NO. HO/37/2014, 2015, 2016

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc c 199 2

 **SSE Power Distribution**

**POLE DRILLING, SCARFING AND MARKING**  
**33kV S.C. 'H' POLE**  
**1830 POLE CENTRES**

Scale:- N.T.S.  
Drn. by:- D.K.W.  
Tcd. by:- D.K.M.  
Ckd. by:- W.C.S.  
App. by:- W.C.S.

Dimensions in millimetres

Drawing no.

**HO /37 /2010**

C.A.D.Reference. HO2010.37

A4P

DATE PLOTTED \$\$\$\$date\$\$\$