


Original Issue
Date:- FEB 97

REVISION A
AMENDMENTS
DE/JRB
20 JAN 99

DRG No.
HO/39/4700

3, 9 OR
30, 39, 35, 2
40, 41

REFER TO STAY
KIT SECTION
FOR DETAILS

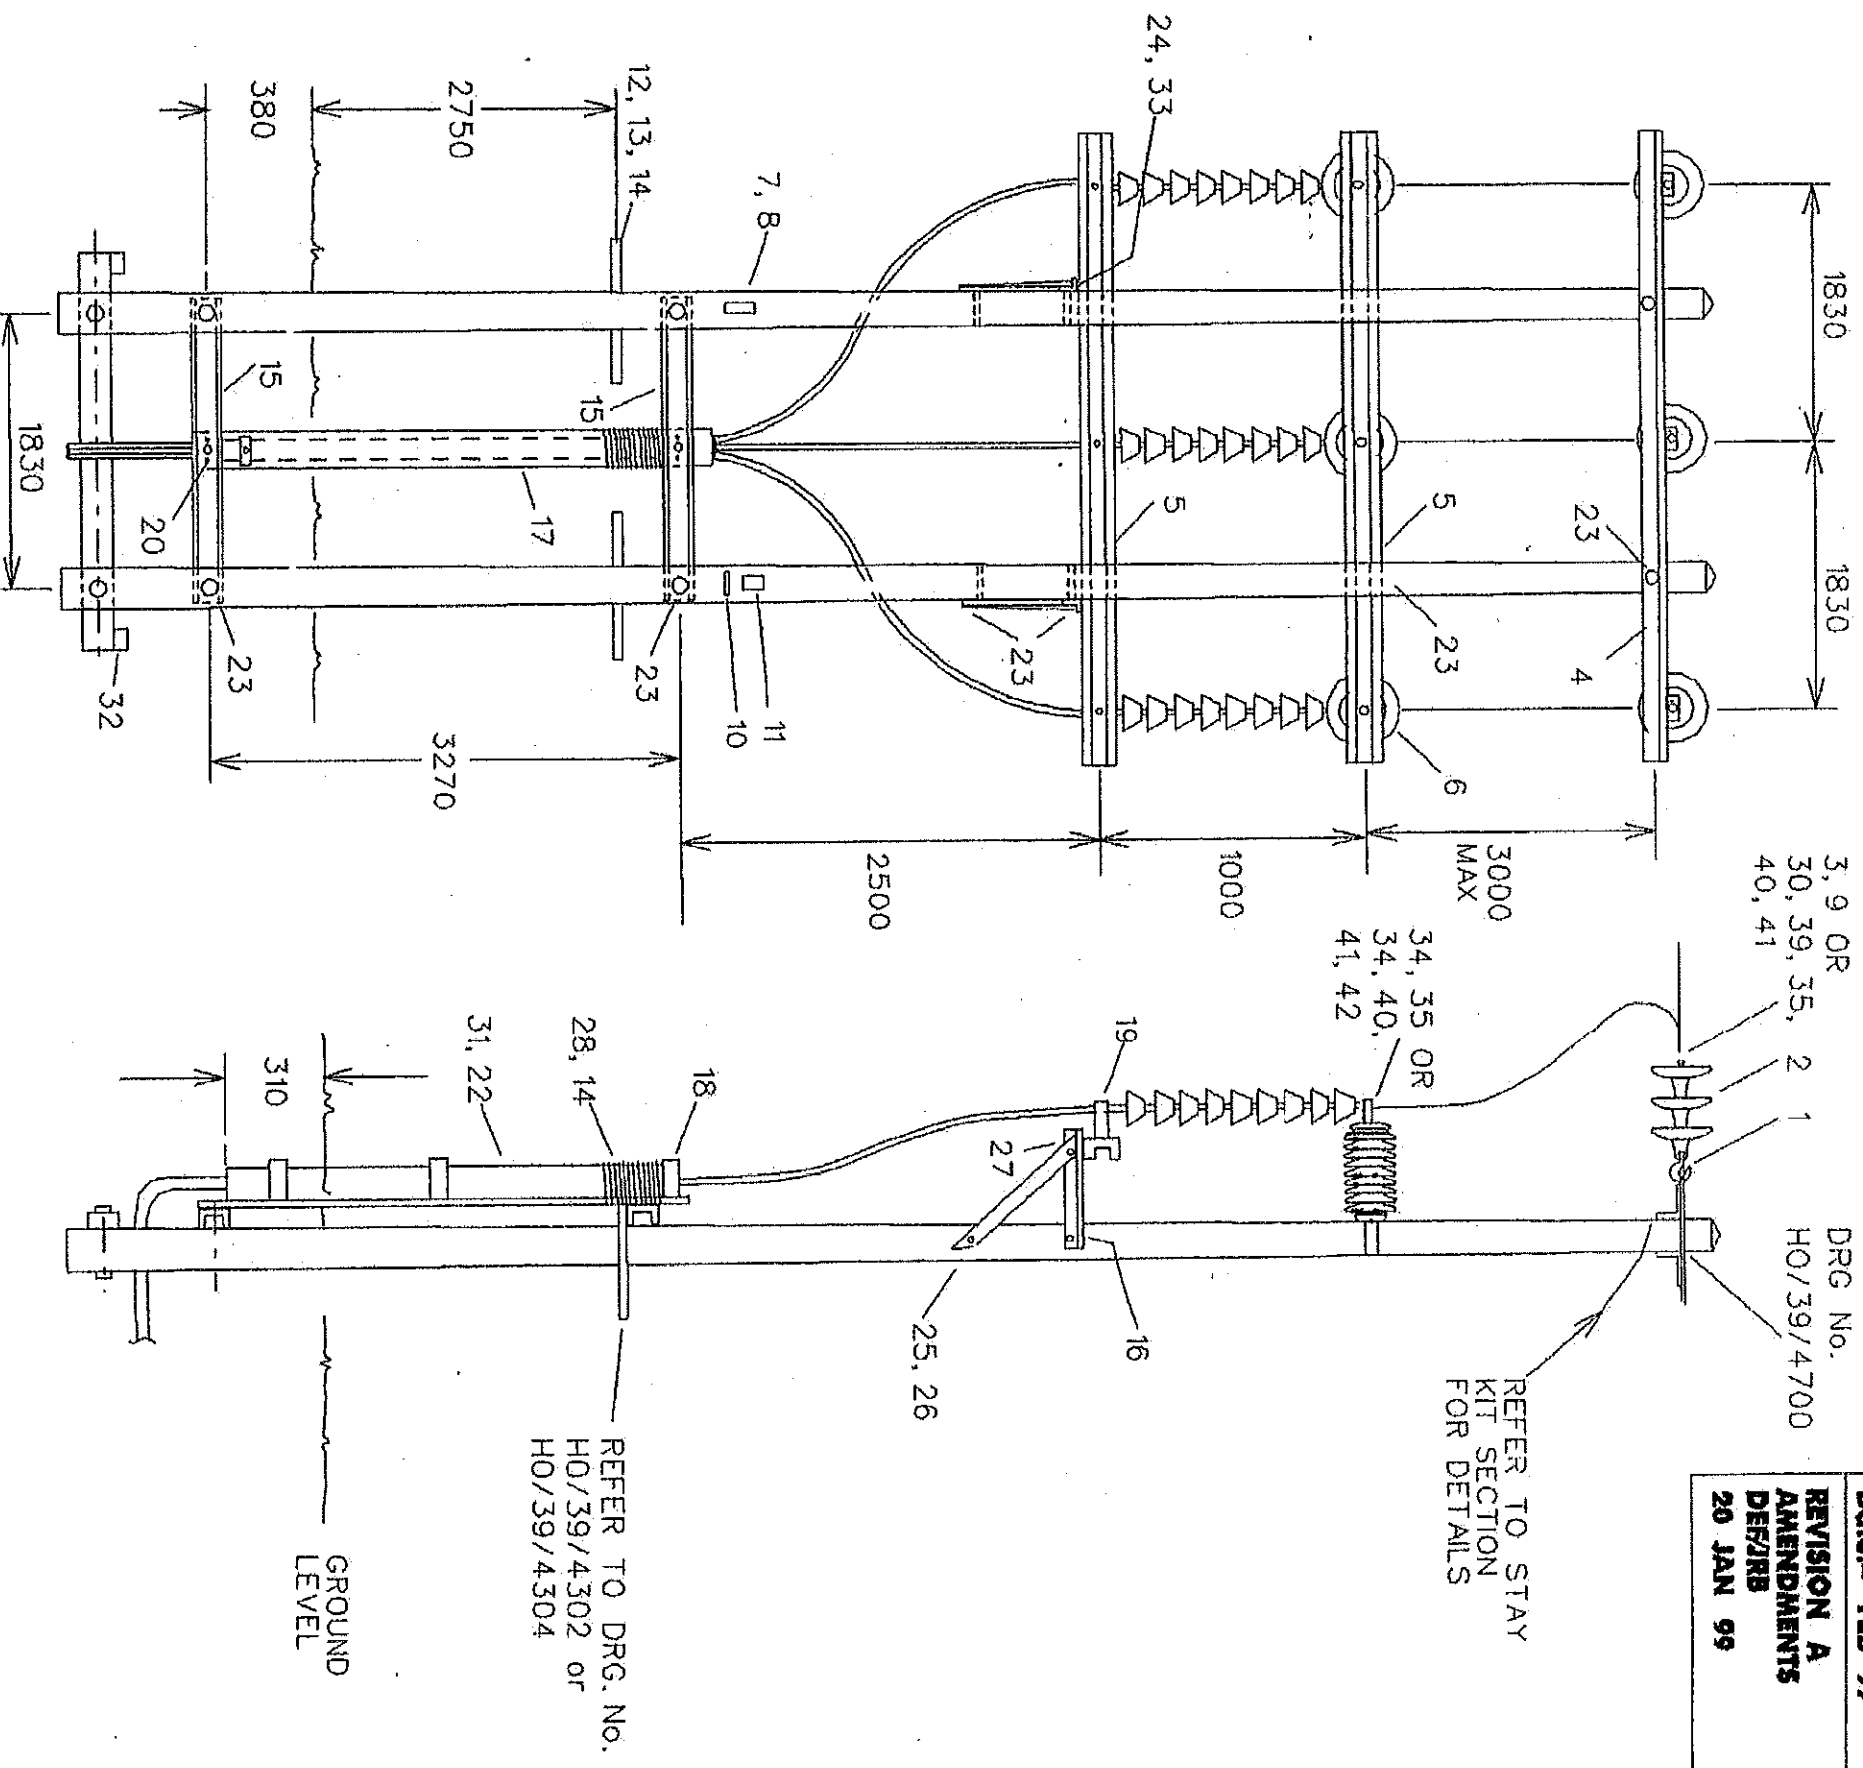

ITEM 36 WHERE THE DISTANCE BETWEEN THE LINE AND ARRESTER STEELWORK EXCEEDS 3000mm, INSTALL PILOT INSULATORS AND CHANNEL (SCHEDULE K8974 REFERS)

ITEM 37 POLE DRILLING DETAILS SEE DRG. No. HO/37/2021 SHEET 3

ITEM 38 EARTHING DETAILS SEE DRG. No. HO/37/2021 SHEET 2

SCHEDULE:- A2021

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SCOTTISH and SOUTHERN ENERGY plc 2006 ©



SSE Power Distribution

GENERAL ASSEMBLY 33kV 'H' TERMINAL POLE (SINGLE CIRCUIT) FOR POLYMERIC CABLE

Scale:-	N.T.S.	Dimensions in millimetres
Des. by:-	HMV	
Tcd. by:-		
Ckd. by:-	W.C.S.	
App. by:-	W.C.S.	
		Drawing no. HO/37/2021 SH1 1 OF 3
		C.A.D. Reference, HO2021.37

AAP

DATE PLOTTED 18-OCT-2006