


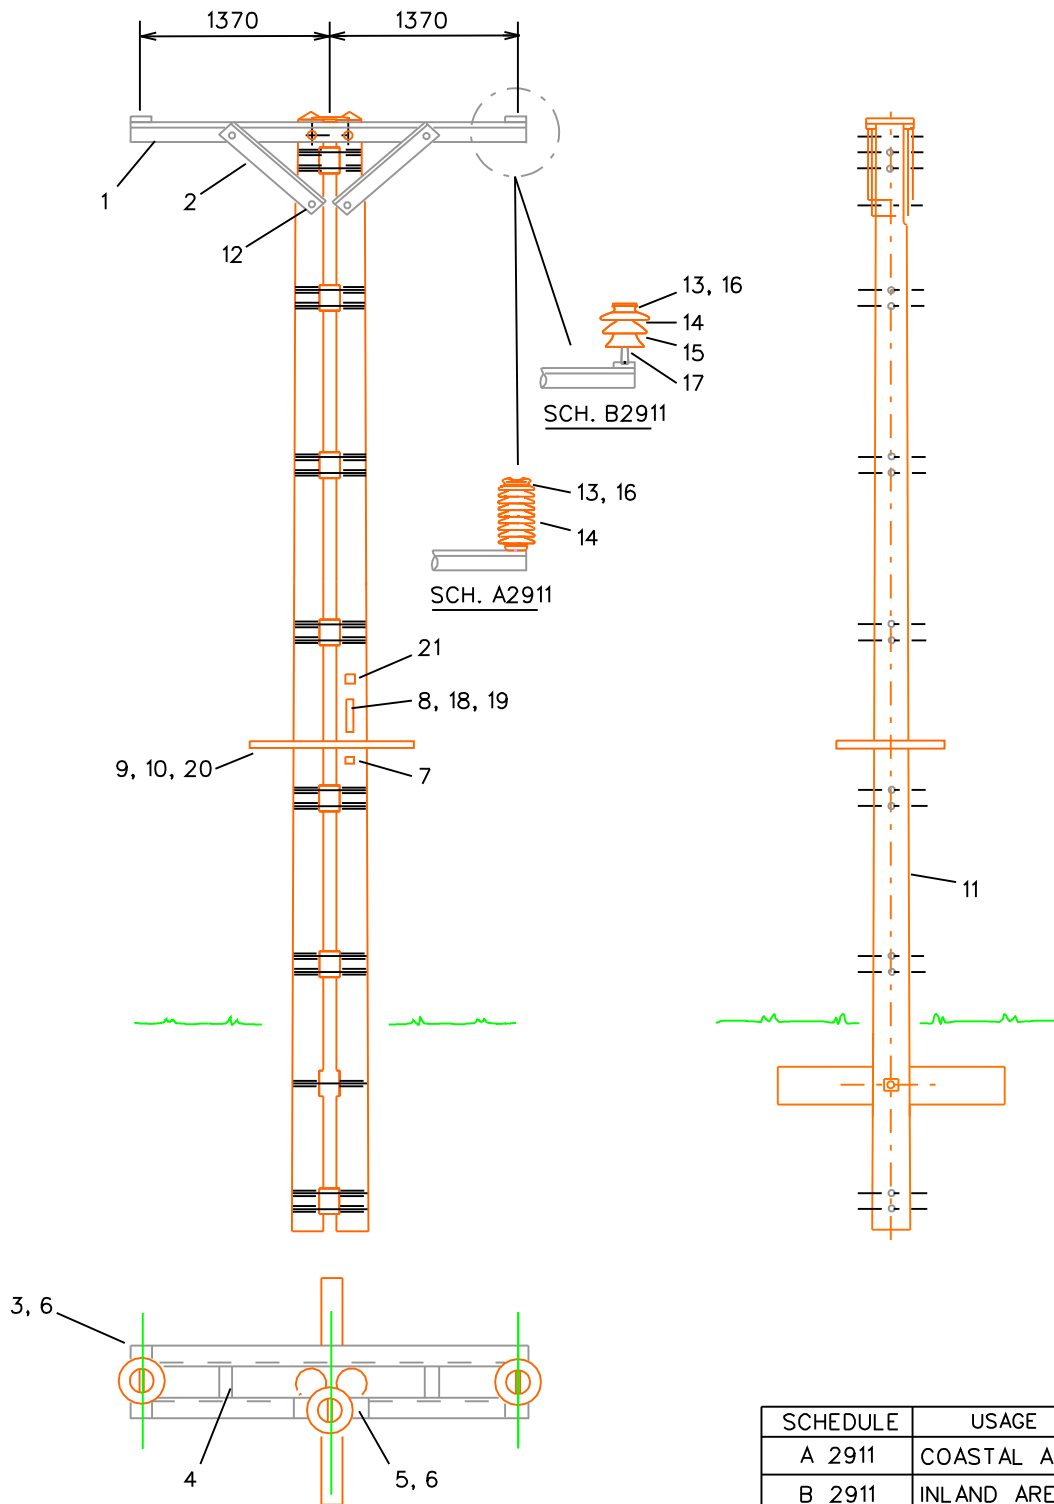

| SCHEDULE | USAGE         |
|----------|---------------|
| A 2911   | COASTAL AREAS |
| B 2911   | INLAND AREAS  |

LIMITATION:- 33kV CONDUCTORS UP  
0.2sq.in CU,250 sq.mm. A.A.A.

POLE DRILLING:- P2910  
33kv HEAVY CONSTRUCTION  
SUPERSEDES DRG REF:- A2911

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc c 1992 2

 **SSE Power Distribution**

**GENERAL ASSEMBLY  
33kV S.C. 1370 PHASE CENTRES  
INTERMEDIATE TWIN POLE**

|           |        |                            |
|-----------|--------|----------------------------|
| Scale:-   | N.T.S. | Dimensions in millimetres  |
| Drn. by:- | D.K.W. | Drawing no.                |
| Tcd. by:- | D.K.M. | <b>HO /37 / 2911</b>       |
| Ckd. by:- | W.C.S. | C.A.D.Reference. HO2911.37 |
| App. by:- | W.C.S. |                            |

A4P

DATE PLOTTED \$\$\$\$date\$\$\$