


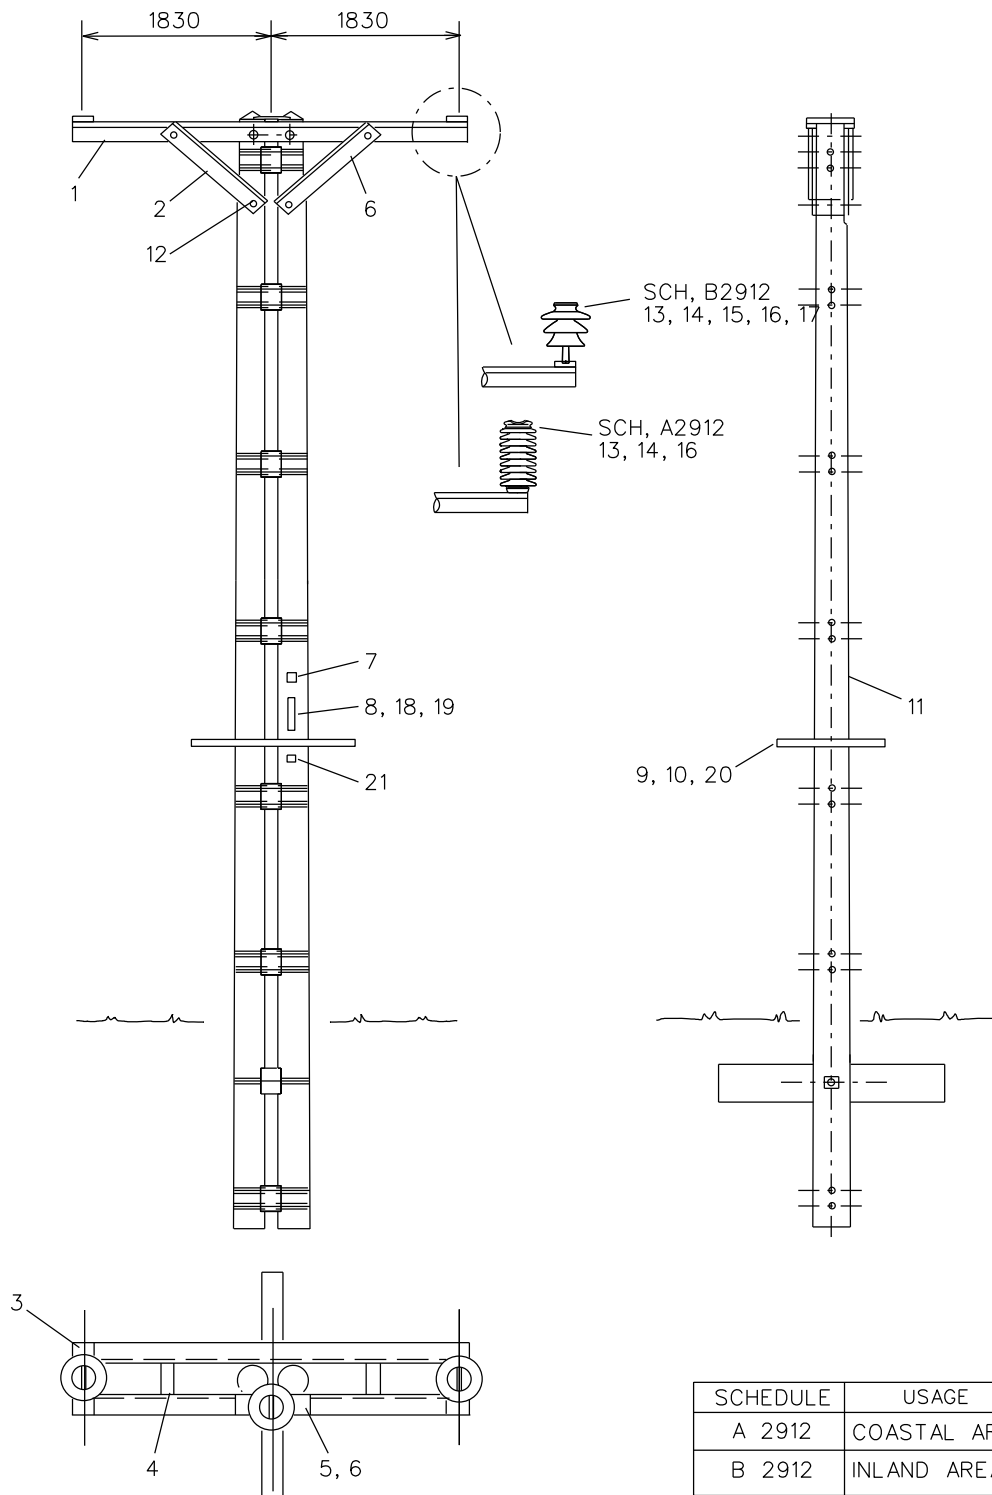

SCHEDULE	USAGE
A 2912	COASTAL AREAS
B 2912	INLAND AREAS

LIMITATION:- 33kv CONDUCTORS UP TO
0.2sq.in CU,250 sq.mm. A.A.A.

POLE DRILLING:- P2910
33kv HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A2912

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc c 1992 2



SOUTHERN
Z V X Q Y W I Q

GENERAL ASSEMBLY
33kv S.C. 1830 PHASE CENTRES
INTERMEDIATE TWIN POLE

Scale:- N.T.S.	Dimensions in millimetres
Drn. by:- D.K.W.	Drawing no.
Tcd. by:- D.K.M.	HO / 37 / 2912
Ckd. by:- W.C.S.	C.A.D. Reference
App. by:- W.C.S.	2912.37

A4P

DATE PLOTTED \$\$\$\$date\$\$\$