


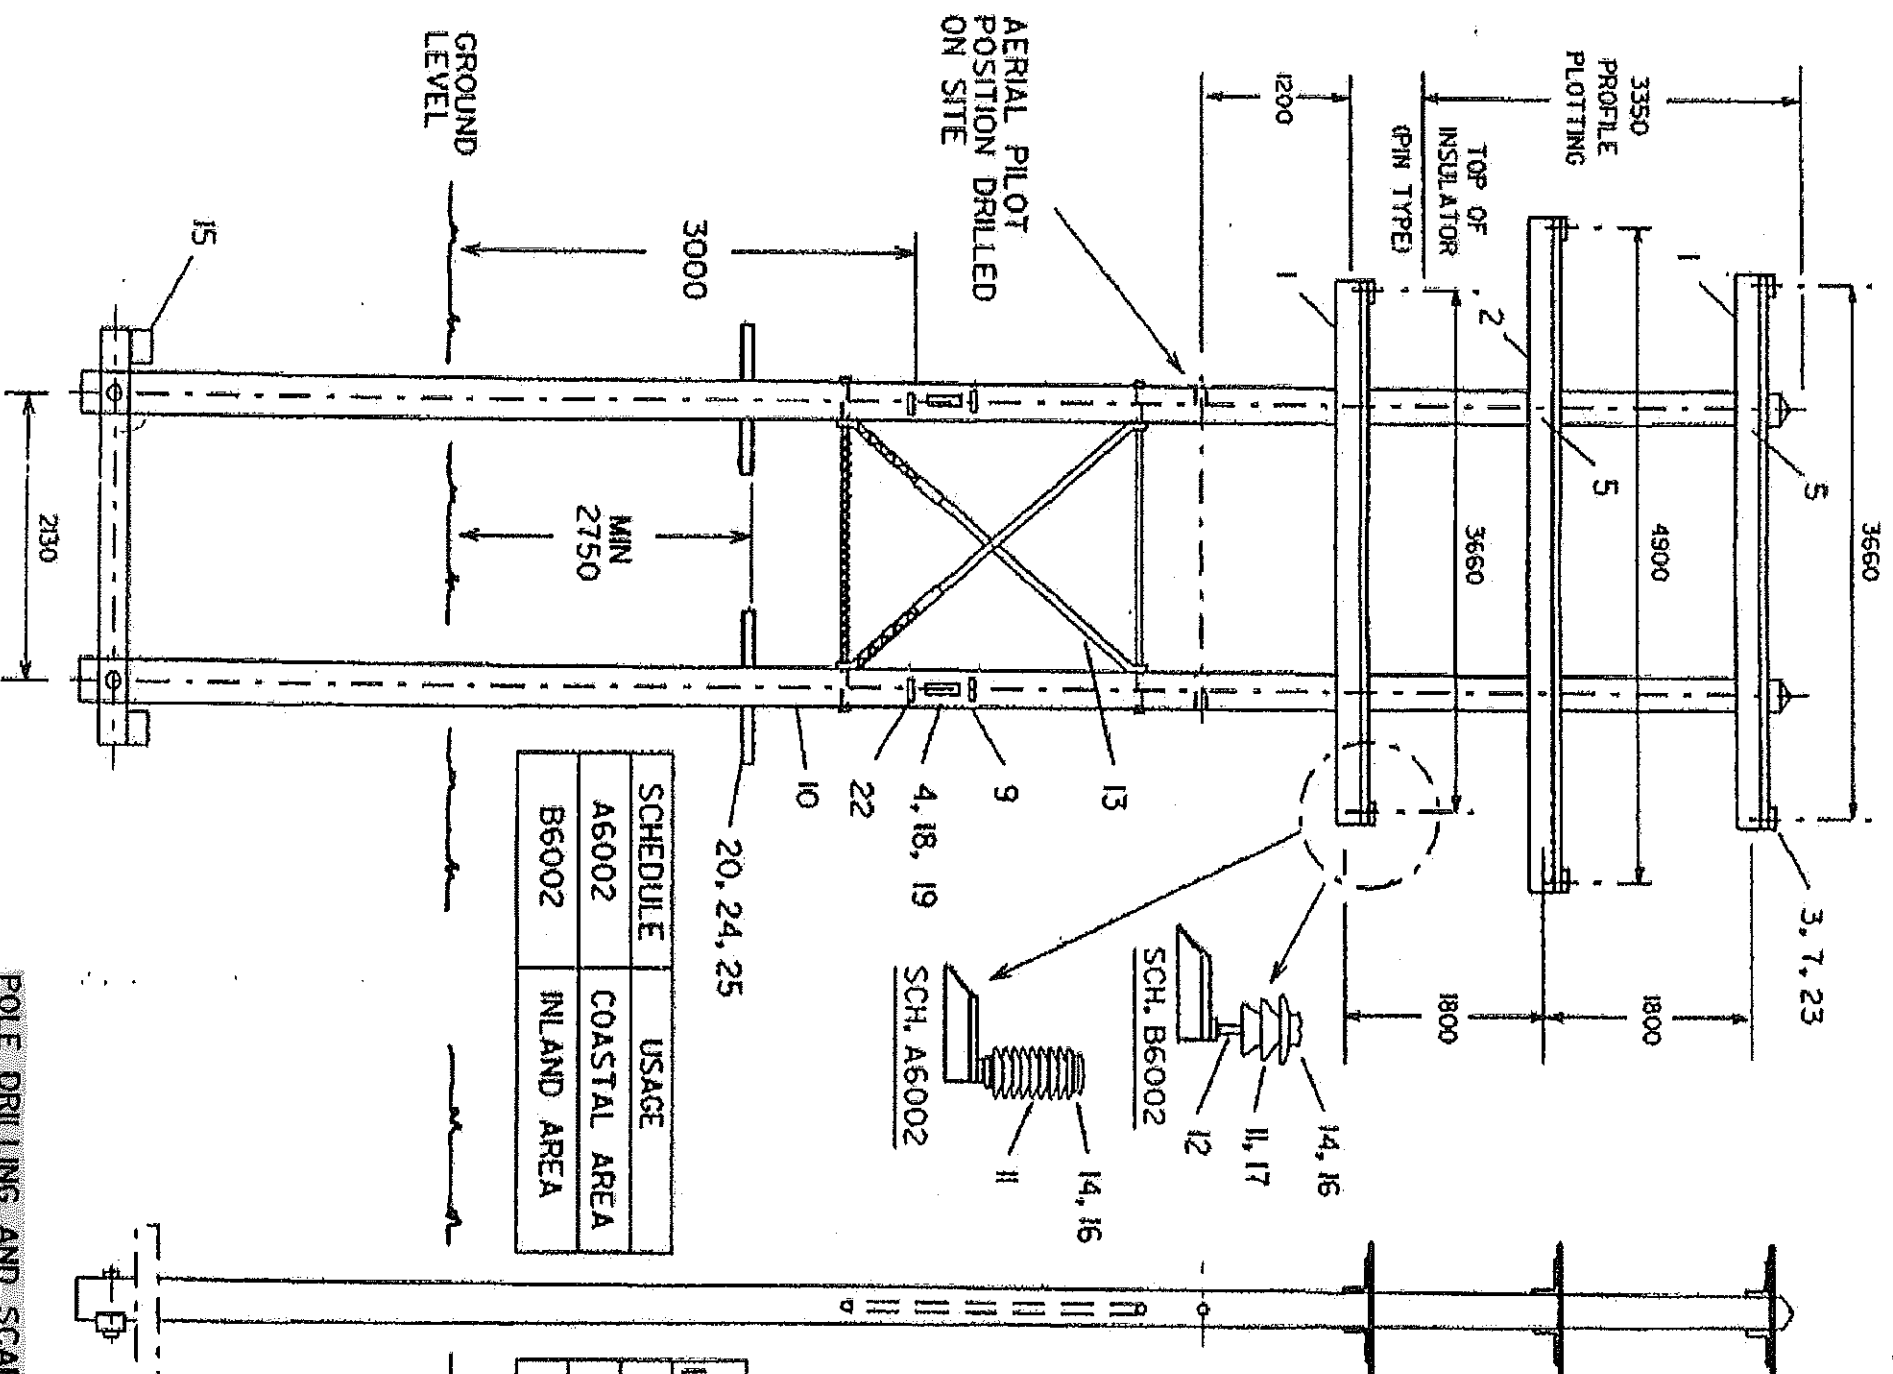

POLE DRILLING AND SCARFING IN ACCORDANCE WITH DRG. NO. HO/37/6002 SHT 3/

ITEM 26 EARTHING KIT FOR TRUSSING TACKLE SEE DRG. NO. HO/37/8983

ITEM 8 BONDING DETAILS SEE DRG. NO. HO/37/6002 SHT 2

SCHEDULE:- A6002

33KV HEAVY CONSTRUCTION

SUPERSEDES DRG REF:- A6002

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied or the information contained therein may not be used, or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

GENERAL ASSEMBLY

33KV DOUBLE CIRCUIT

INTERMEDIATE P; POLE 1800 Ph. SPACING

Scale:-	N.T.S.	Dimensions in millimetres	
Dwn. by:-	D.K.W.	Drawing no.	
Ted. by:-	D.K.M.		
Chd. by:-	W.C.S.		
App. by:-	W.C.S.	HO/37/6002 SHT 1 OF 3	
		C.A.D. Reference. HO6002.37	