


Christened Volume
Number OCT 92

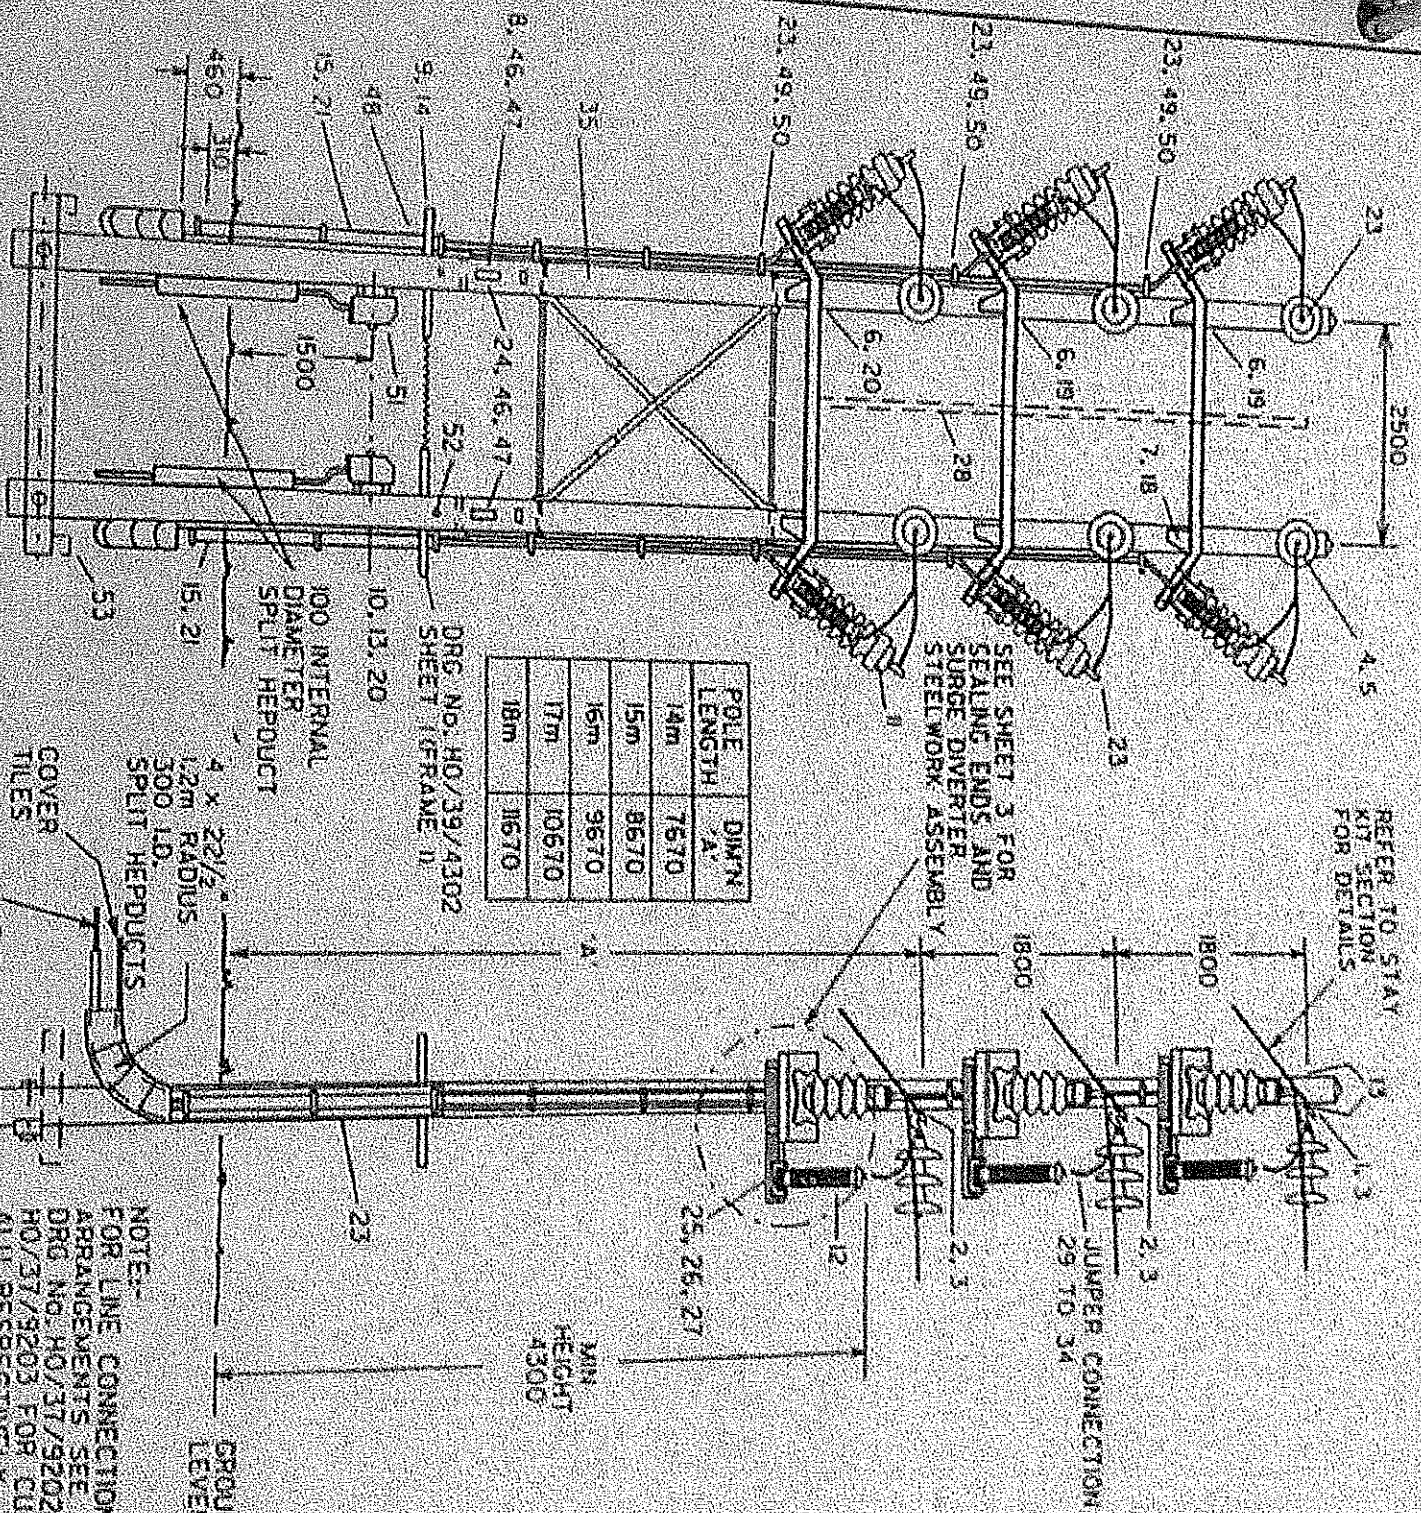


45°C. CATION- 0.1, 0.2 sq in. COPPER
 10.175 sqmm AL. AL. CONDUCTOR
 10.175 sqmm AL. AL. CONDUCTOR
 10.175 sqmm AL. AL. CONDUCTOR

TRFURCATING STOP JOINT
ITEM 22 EARTHING DETAILS SEE SCHEDULES
ITEM 45 EARTHING FOR TRUSSING TACKLE
TO SCHEDULE X8983
SCHEDULE:- A6005
33KV HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A6005 SH1

33KV HEAVY CONSTRUCTION
SUPERSEDES DRG REF-- A6005 SHT 1

UNCONTROLLED COPY
SUBJECT TO REVISION
MASTER HELD AT HEAD OFFICE
Telephone 0628 584146

This document is protected by copyright and the information contained therein is confidential. This document may not be copied and the information contained therein may not be used or disclosed to a third party orally or in print except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC CO. ©1993



**SOUTHERN
ELECTRIC**

**GENERAL ASSEMBLY
33KV DOUBLE CIRCUIT
1/4" TERMINAL POLE (CABLE)**

Scale:-	N.T.S.	Dimensions in millimetres
Drawn by:-	D.K.W.	
Red. by:-	D.K.W.	
Chd. by:-	W.C.S.	
App. by:-	W.C.S.	
Drawing no.		HO/37/6005 SHT 1 OF 3
C.A.D. Reference		
HO/6005/37		

DATE PLOTTED 27-OCT-1995