


Original Issue
Date:- FEB 97

DRG No.
HO/39/4700

REFER TO STAY
KIT SECTION
FOR DETAILS

REFER TO DRG. No.
HO/39/4302 or
HO/39/4304

GROUND
LEVEL

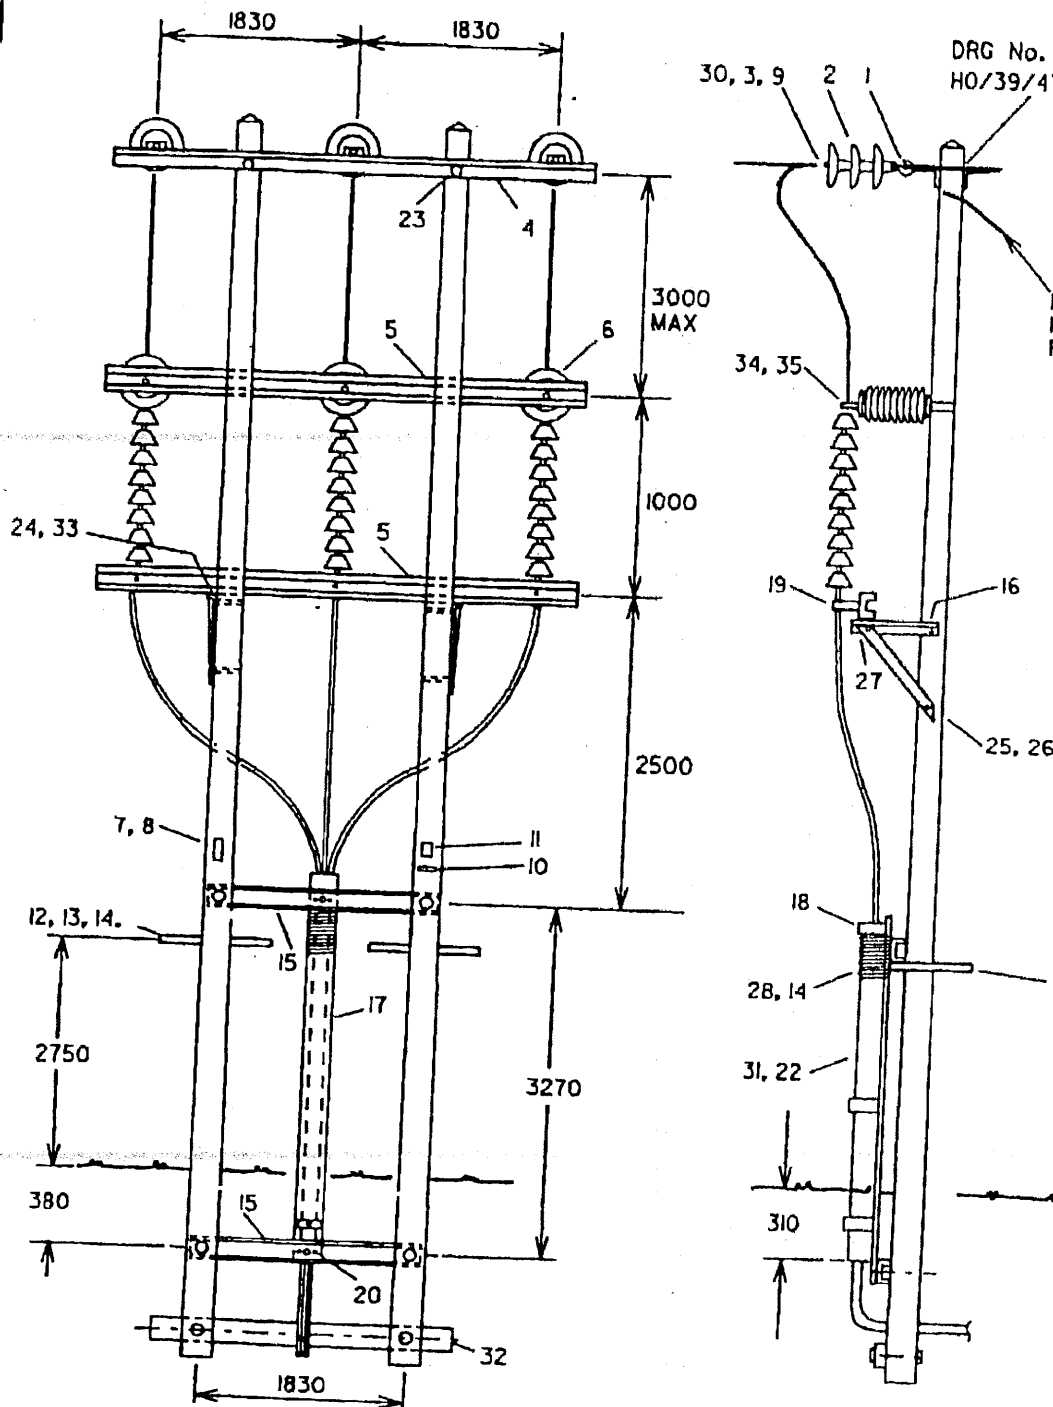

ITEM 36 WHERE THE DISTANCE BETWEEN THE LINE AND
ARRESTER STEELWORK EXCEEDS 3000mm, INSTALL PILOT
INSULATORS AND CHANNEL (SCHEDULE K8974 REFERS)

ITEM 37 POLE DRILLING DETAILS SEE DRG. No. HO/37/2021 SHEET 3

ITEM 38 EARTHING DETAILS SEE DRG. No. HO/37/2021 SHEET 2

SCHEDULE:- A2021

This drawing is protected by copyright and the information contained
therein is confidential. The drawing may not be copied and the
information contained therein may not be used, or disclosed to
any third party wholly or in part except with the written permission
of SOUTHERN ELECTRIC in the manner prescribed by SOUTHERN ELECTRIC plc ©1997



**SOUTHERN
ELECTRIC**

**GENERAL ASSEMBLY
33kV 'H' TERMINAL POLE (SINGLE CIRCUIT)
FOR POLYMERIC CABLE**

Scale:- N.T.S.

Des. by:- HMW

Ted. by:-

Chd. by:- W.C.S.

App. by:- W.C.S.

Dimensions in millimetres

Drawing no.

HO/37/2021 SHT 1 OF 3

C.A.D. Reference. HO2021.37

