


Original frame size 287 mm x 180 mm

southern electricity

All holes 22 mm Dia

Pole to be evenly quartered Apex 120°



Overall Length and Dia as Specified

Reference

12 = Length of pole in metres.

+ = Denotes Large Pole Head

M = Grade of pole

Medium or Stout



as defined in BS 1990

I.F. = Imported Scots Pine

83 = Year of preservation

ABC = Suppliers name or mark

Gouge mark
approx 6mm wide
and 6mm deep.

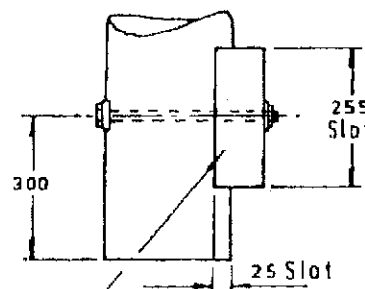

Supply:-

Kicking blocks to Org. Ref. 19-117-3 and 17-410-9 complete with pole bolts, nuts, flat and square curved washers.

Slot and drilling for upper Kicking Block to be carried out on site, by Board's Staff.

Board's Inspectors Brand

Pole size to be Impressed on pole butt.

Heavy Construction

Dimensions in Millimetres

Drawing Replaces:- 4/474 (part)

Pole Drilling and Marking.
33kV Single Circuit. (1500 Spacing)
Single Pole Vertical Formation

Scale :- N.T.S.
Drn by :- D.K.W.
App by :- A.T.R.
Issue 1 / Sept-84

E.S.I.
Ref :-
Drawing
Ref :-

A2008-2