


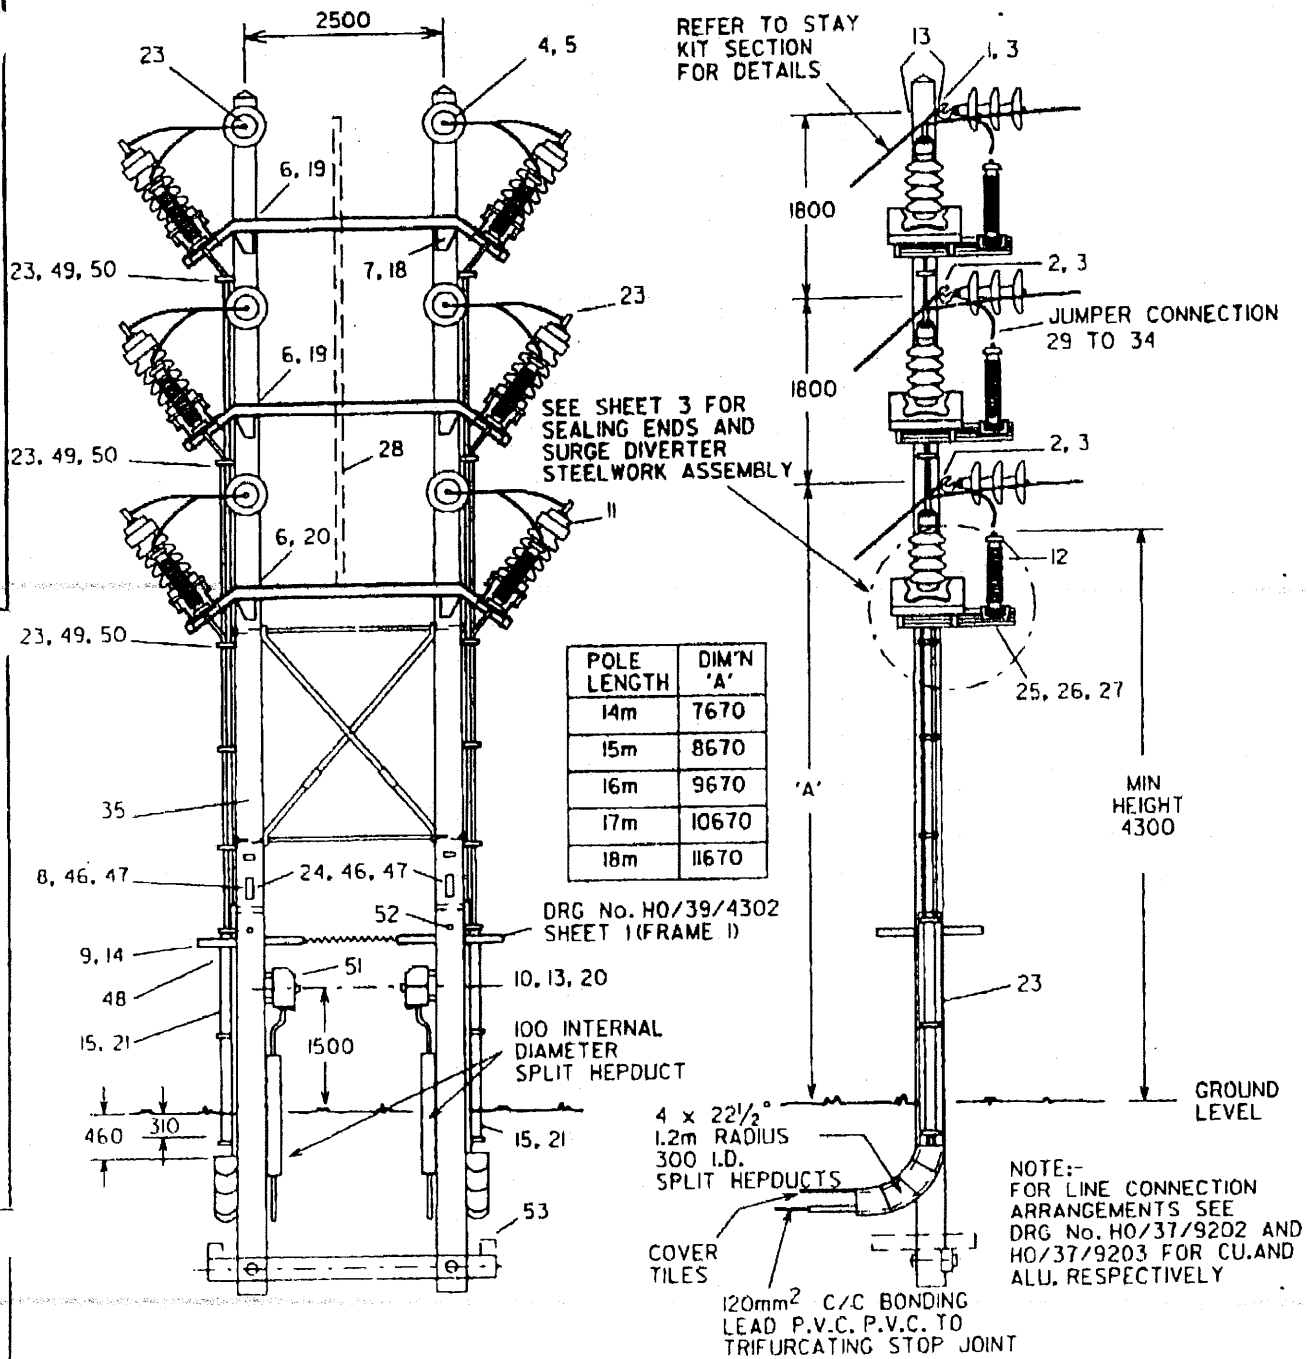

APPLICATION:- 0.1, 0.2 sq in COPPER
UP TO 175 sq.mm AL.AL. CONDUCTOR
300mm² (SINGLE) CABLE

ITEM 22 EARTHING DETAILS SEE SCH.E6005
ITEM 45 EARTHING FOR TRUSSING TACKLE
TO SCHEDULE K8983
SCHEDULE:- A6005
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A6005 SHT 1

**UNCONTROLLED COPY
SUBJECT TO REVISION
MASTER HELD AT HEAD OFFICE
Telephone 0628 584146**

Revision:-

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc ©1993



**SOUTHERN
ELECTRIC**

**GENERAL ASSEMBLY
33kV DOUBLE CIRCUIT
'H' TERMINAL POLE (CABLE)**

Scale:- N.T.S.
Dwn. by:- D.K.W.
Tcd. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres
Drawing no.
HO/37/6005 SHT 1 OF 5
C.A.D. Reference. HO6005.37

