

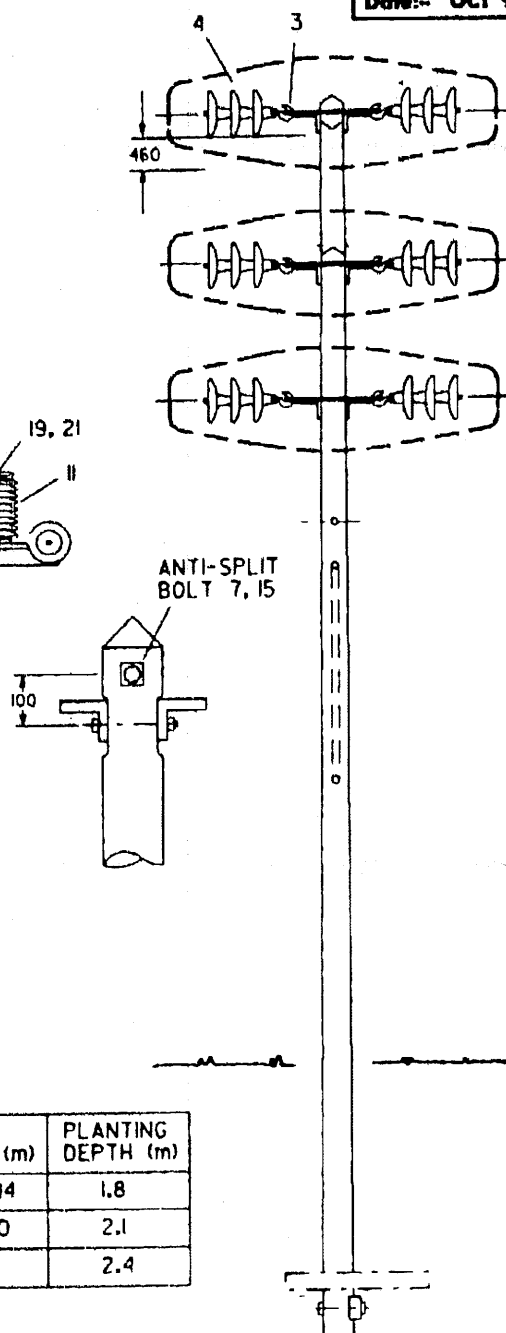


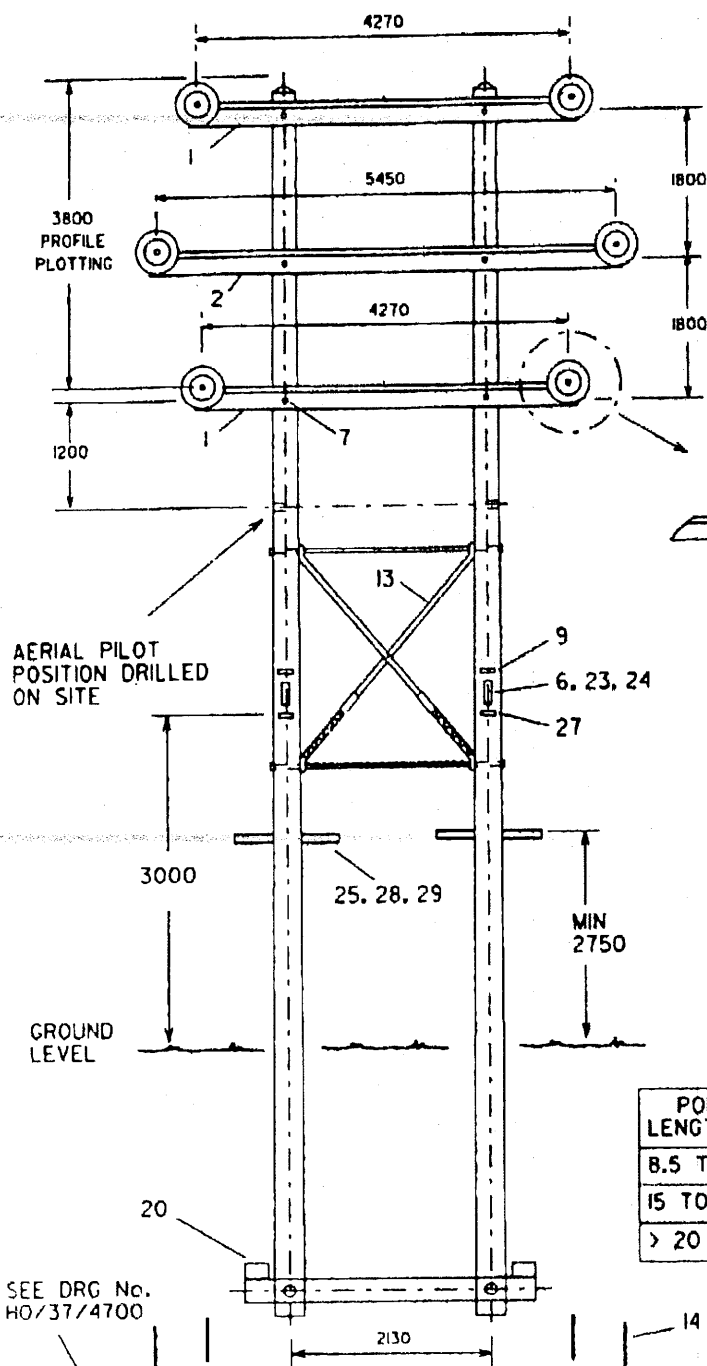

POLE LENGTH (m)	PLANTING DEPTH (m)
8.5 TO 14	1.8
15 TO 20	2.1
> 20	2.4

SEE DRG No.
HO/37/4700

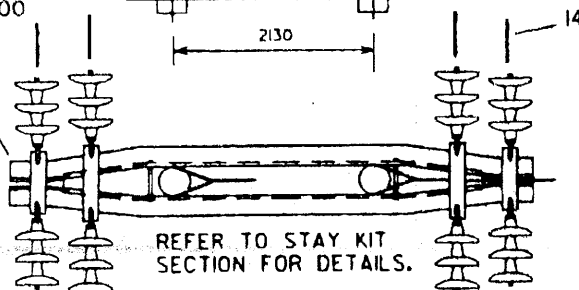

APPLICATION :- CONDUCTORS UP TO
AND INCLUDING 250 sq.mm ALUM. ALLOY.
0.2 sq.in CU

ITEM 10 POLE DRILLING AND SCARFING IN
ACCORDANCE WITH DRG. No. HO/37/6004 SHT 3

ITEM 8 BONDING DETAILS
SEE DRG. No. HO/37/6004 SHT 2

ITEM 12 EARTHING KIT FOR TRUSSING TACKLE
SEE DRG. No. HO/37/8983

SCHEDULE:- A6004
33kv HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A6004

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc © 1992



**SOUTHERN
ELECTRIC**

**GENERAL ASSEMBLY
33kv DOUBLE CIRCUIT**

Scale:- N.T.S.
Dm. by:- D.K.W.

Dimensions in millimetres

HO/37/6004
SHT 1 OF 3

Original Issue
Date:- OCT 92

