


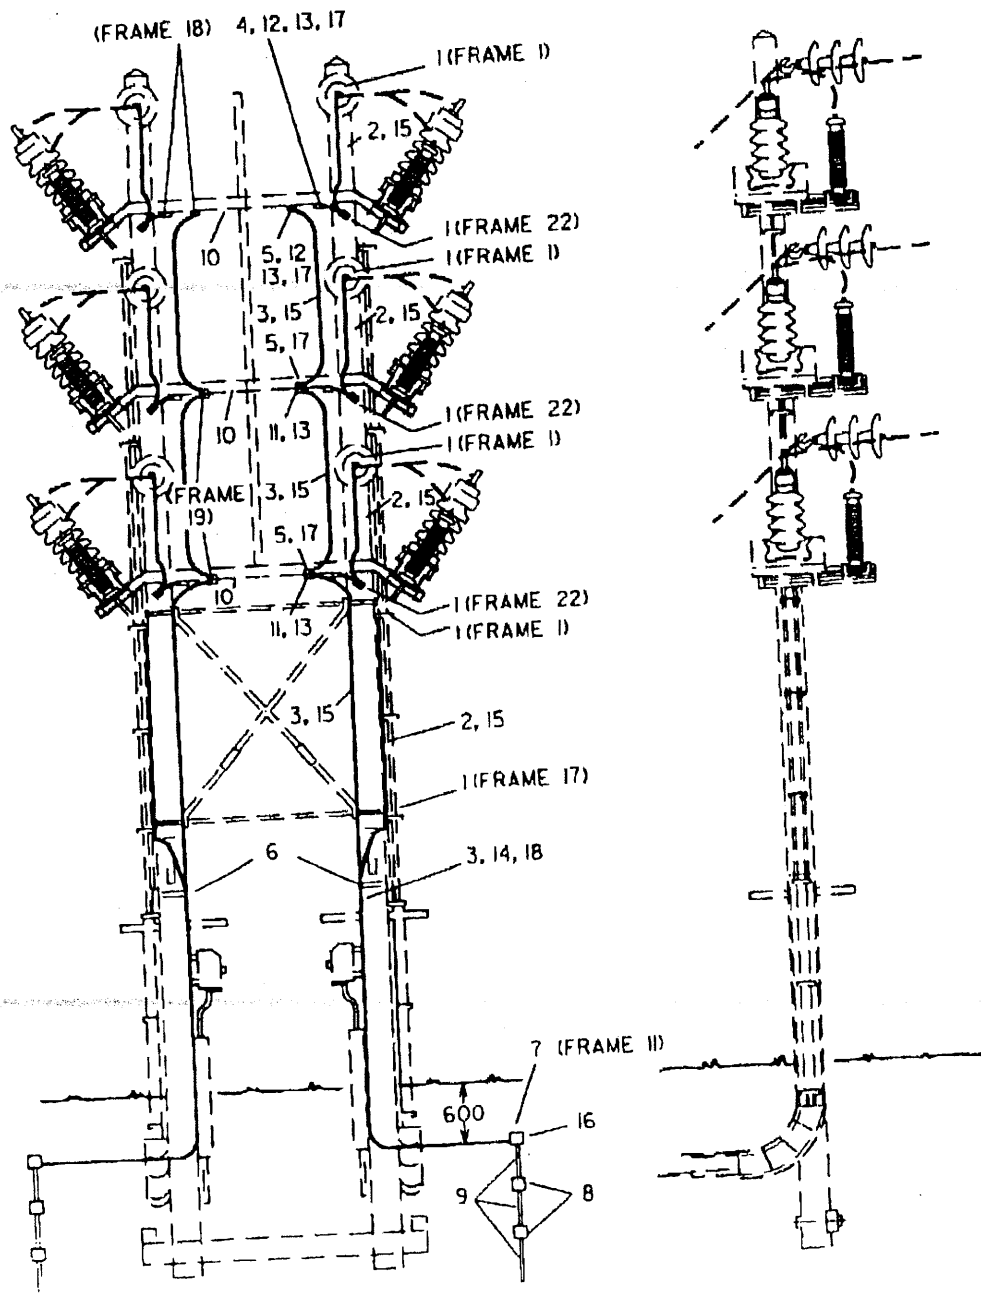

BONDING AND EARTHING CONNECTIONS
TO DRG No. HO/39/4206
AS SHOWN IN BRACKETS

SCHEDULE:- E6005
33kV HEAVY CONSTRUCTION
SUPERSEDES DRG REF:- A6005-1 SHT 1

**UNCONTROLLED COPY
SUBJECT TO REVISION
MASTER HELD AT HEAD OFFICE
Telephone 0628 584146**

Revision:-

This drawing is protected by copyright and the information contained therein is confidential. The drawing may not be copied and the information contained therein may not be used or disclosed to a third party wholly or in part except with the written permission of, and in the manner prescribed by SOUTHERN ELECTRIC plc ©1993



**SOUTHERN
ELECTRIC**

**33kV DOUBLE CIRCUIT
'H' TERMINAL POLE (CABLE)
EARTHING DETAILS (LINE)**

Scale:- N.T.S.
Dwn. by:- D.K.W.
Ycd. by:- D.K.M.
Ckd. by:- W.C.S.
App. by:- W.C.S.

Dimensions in millimetres

Drawing no.
HO/37/6005 SHT 2 OF 5
C.A.D. Reference. HO6005.37

DATE PLOTTED , 27-OCT-1993

